


Fault table			
Code	Fault content	Code	Fault content
E1	Phase sequence fault(Reserved)	H12	3 times Pb protection in 10 min
E2	Hydronic box and ODU communication fault(Reserved)	P1	High pressure protection
E4	Outdoor ambient temperature sensor (T4) fault	P2	Low pressure protection
E6	Condenser temperature sensor (T3) fault	P3	AC over-current protection
E8	Discharged temperature sensor (Tp) fault P4 Over	P4	Over-high discharge temperature protection
E9	AC overvoltage/undervoltage fault	P5	High temperature protection of condenser
E10	EEPROM fault	P6	IPM module protection
E4	Condenser temperature sensor (T3B) fault(Reserved)	P9	DC fan motor protection
Ec	Refrigerant cooling outlet pipe temperature sensor (T7) fault P10 Anti	P10	Anti typhoon protection(Reserved)
H0	Communication fault between main PCB and IPM	P11	T2 low temperature protection
H1	Communication fault between ODU main board and IDU main board	P13	Current detection abnormal protection(Reserved)
H4	3 times P6 protection in 30 min	Pb	IPM module high temperature protection
H5	3 times P2 protection in 30 min		
H6	3 times P4 protection in 100 min		
H7	The quantity of IDU is descreased(Reserved)		
H9	2 times P9 protection in 10 min		
H10	3 times P3 protection in 60 min		
H11	2 times P13 protection in 10 min(Reserved)		

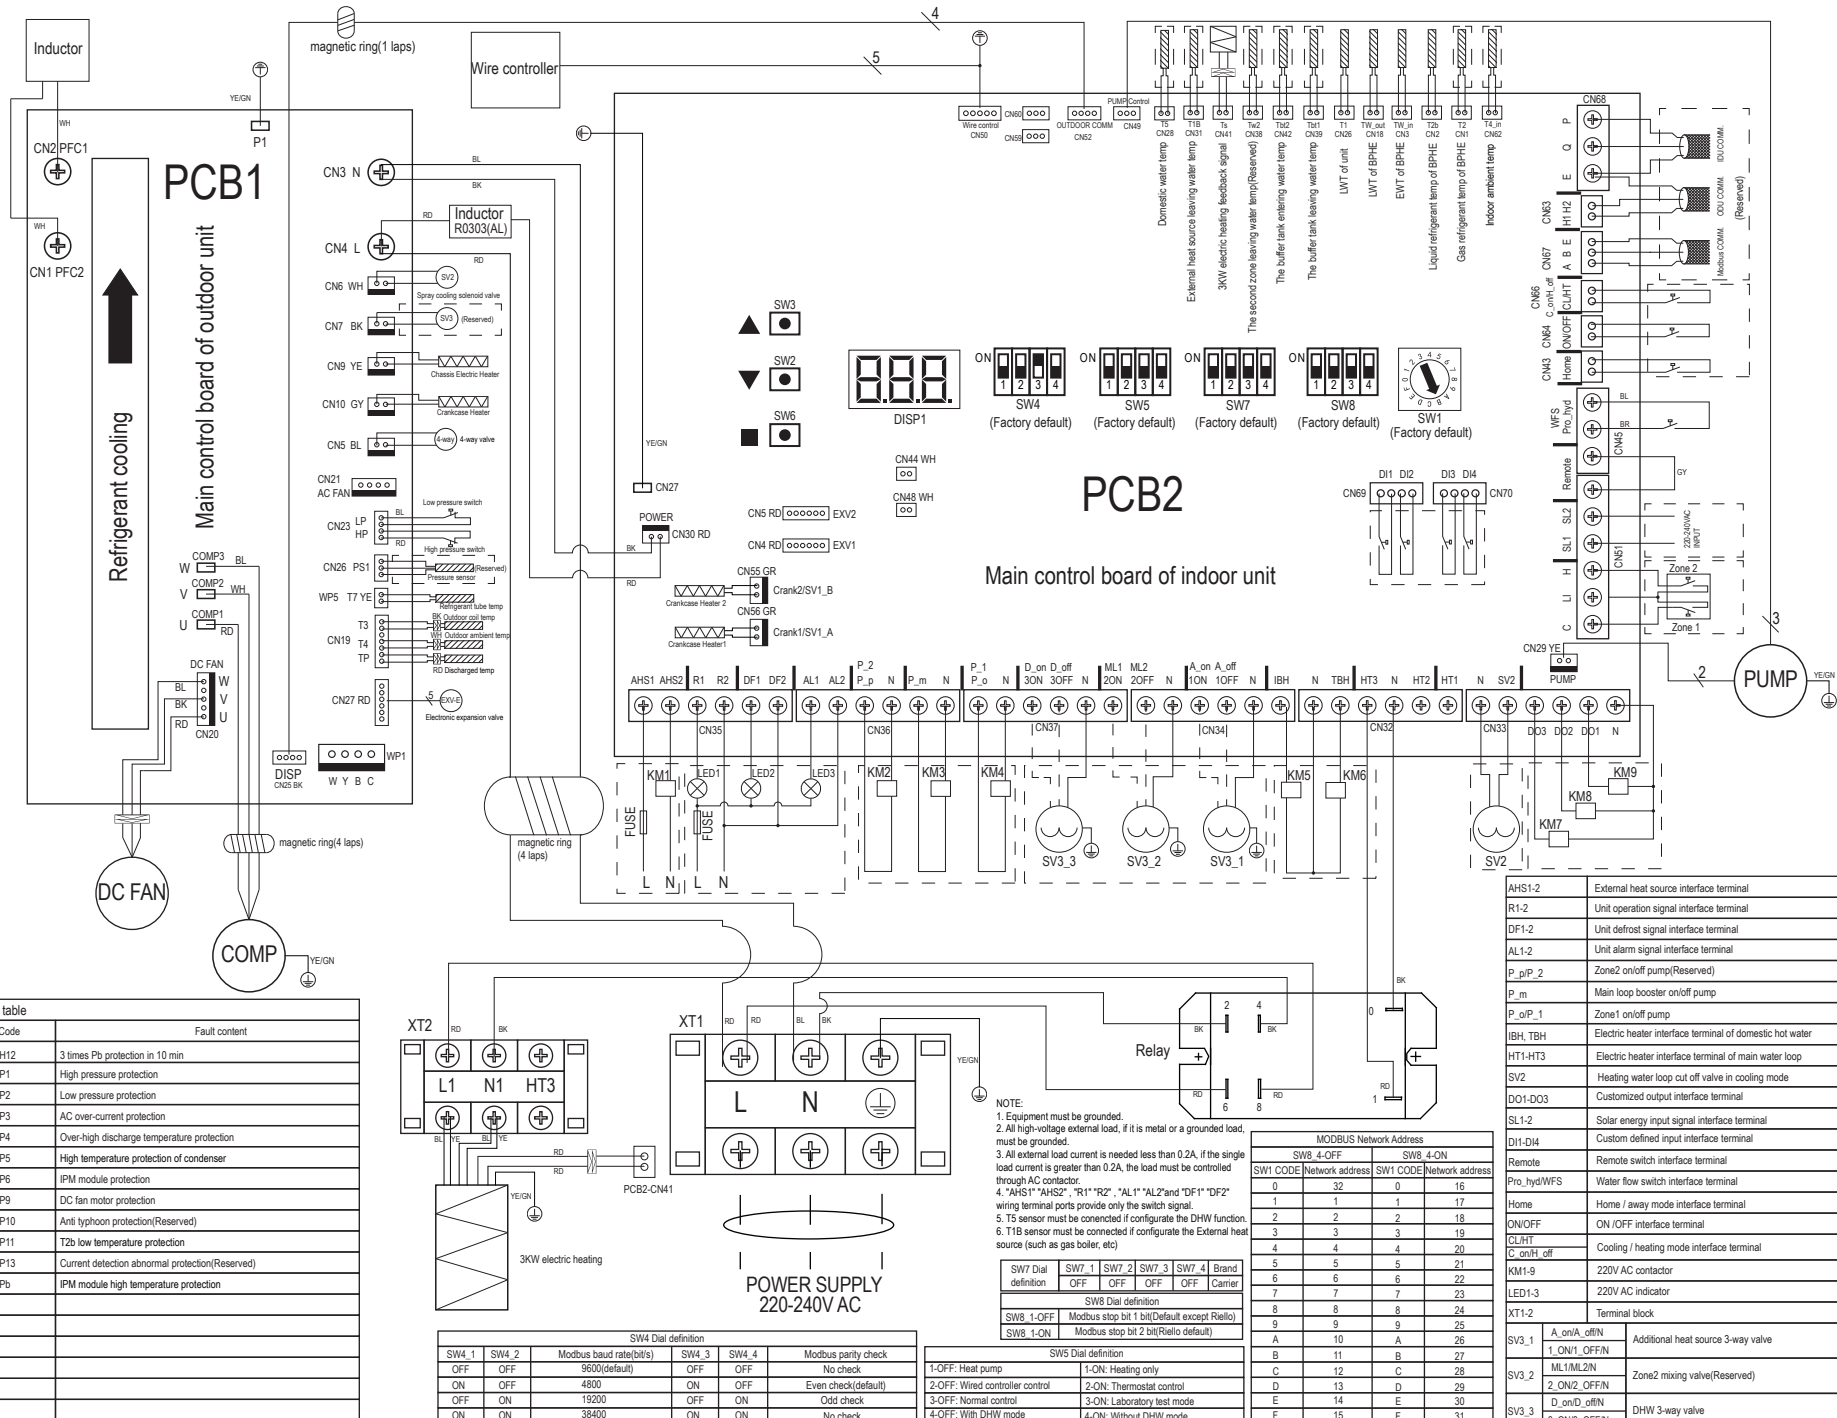

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузка в транспортную компанию

Технические данные файла

Документ: Схема Carrier 30AWH-R 4-6 кВт

Идентификатор библиотеки: LIB-004007

Исходный файл: carrier-30awh-r-4-6kw-models-pdf-shema.pdf

SHA-256 оригинала: 89a2b0b78b237d997d295f93de8e50cb5958a35646d2bffa1fbe0c26b6cb540a

Постоянная ссылка: <https://iclim.ru/library/carrier-30awh-r-4-6kw-models-pdf-shema.pdf>

Копия сформирована: 03.10.2026 21:06 UTC