


30KAV1100-OPT119 / 30KAVZE0800-OPT119 /
30KAVP1100 / 30KAVPZE0800

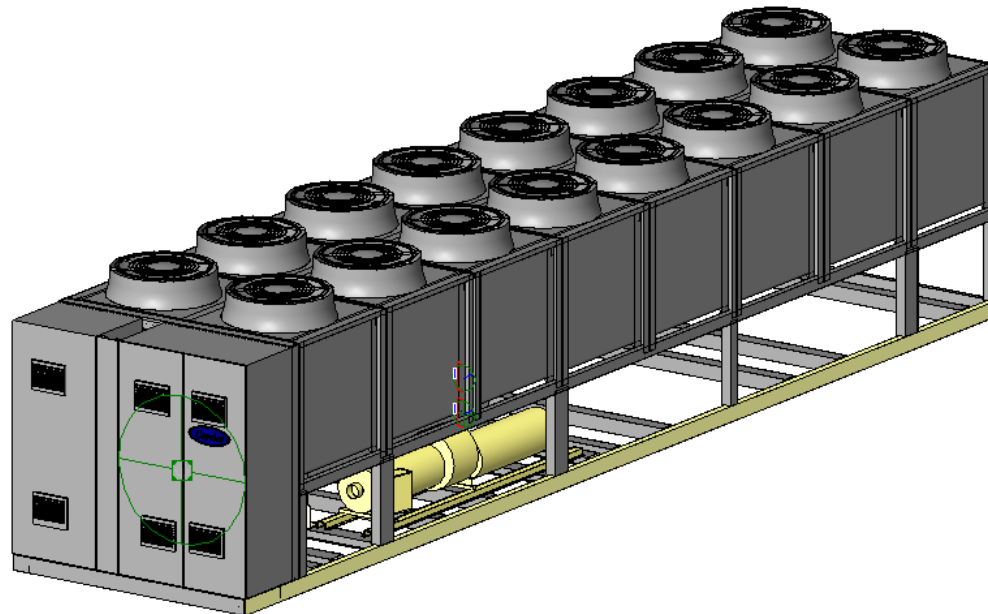

INDEX

Slide Number

- | | | |
|----|----------------------------------|-------|
| 1. | Excel sheet Data to Revit Option | 3 |
| 2. | Operation of Revit file | 4-21 |
| 3. | Connector Information | 22-29 |

Excel To Revit File Conversion

30KAV / 30KAVZE / 30KAVP / 30KAVPZE REVIT DATABASE

30KAV / 30KAVZE / 30KAVP / 30KAVPZE RANGE	<u>Standard Components</u>	<u>Options</u>					
	Chassis/structure/wcoil/cooler / electrical box/suction line	Grill Panel(opt23)	Coil panel(opt23a)	Comp enclosure (opt 15 or 15LS)	Total Heat Recovery (opt 50)	Partial Heat Recovery (opt 49)	Cooler hydraulic connection (opt 266)
30KAV1100-OPT119 / 30KAVZE0800- OPT119 / 30KAVP1100 / 30KAVPZE0800	x	x	x	x	x	x	x

SL NO	Revit Option	Description
1	30KAV1100-OPT119 / 30KAVZE0800-OPT119 / 30KAVP1100 / 30KAVPZE0800	Standrad components
2	Option 15/15ls	Standard Unit + Comp Enclosure
3	Option 23	Standard Unit + Coil Protection+grill
4	Option 23a	Standard Unit + Coil Protection
5	Option 50	Total Heat Recovery
6	Option 49	Partial Heat Recovery
7	Option 266	Cooler hydraulic connection
8	Opt 15L/LS + OPT 23	Comp Enclosure+ Grill/panel
9	Opt 15L/LS + OPT 23a	Comp Enclosure+ panel
10	Opt 50 + Opt 325	Total Heat Recovery + Water Pipe
11	Opt 49 + Opt 325	Partial Heat Recovery + Water Pipe
12	OPT 50 + OPT 266 + Opt267	Total Heat Recovery + Cooler hydraulic connection + BPHE hydraulic connection
13	OPT 49 + OPT 266 + Opt267	Partial Heat Recovery + Cooler hydraulic connection + BPHE hydraulic connection
14	OPT 50 + OPT325 + OPT 266 + Opt267	Total Heat Recovery + Water pipe + Cooler hydraulic connection + BPHE hydraulic connection
15	OPT 49 + OPT325 + OPT 266 + Opt267	Partial Heat Recovery + Water pipe + Cooler hydraulic connection + BPHE hydraulic connection

REVIT FAMILY TABLE

Family Types

Type name: 30KAV1100-OPT119 / 30KAVZE0800-OPT119 / 30KAVP1100 / 30KA

Search param

par

Construction

ATEX Zone

OPT266

OPT49+ OPT

OPT49+ OPT

OPT49_ OPT

OPT50+ OPT

OPT50+ OPT

OPT50_ OPT

Service Area

Service Area + ATEX Zone - Only ZE Units

OPT50	☐	=
OPT325 for OPT50	☐	=
OPT49	☐	=
OPT325 for OPT49	☐	=
Service Area	☐	=
Option23a	☐	=
Option 23	☐	=
15LS/15L	☐	=



Identity Data

How do I manage family types?

OK Cancel

Operating Revit file

Step 1-After Opening Revit file. Please Click on “Family Type Console” as Shown below to view Multiple Options

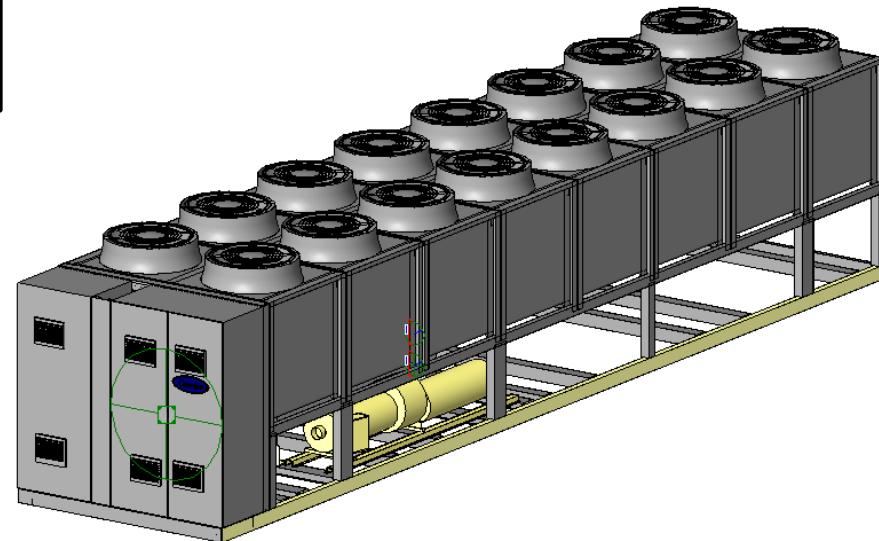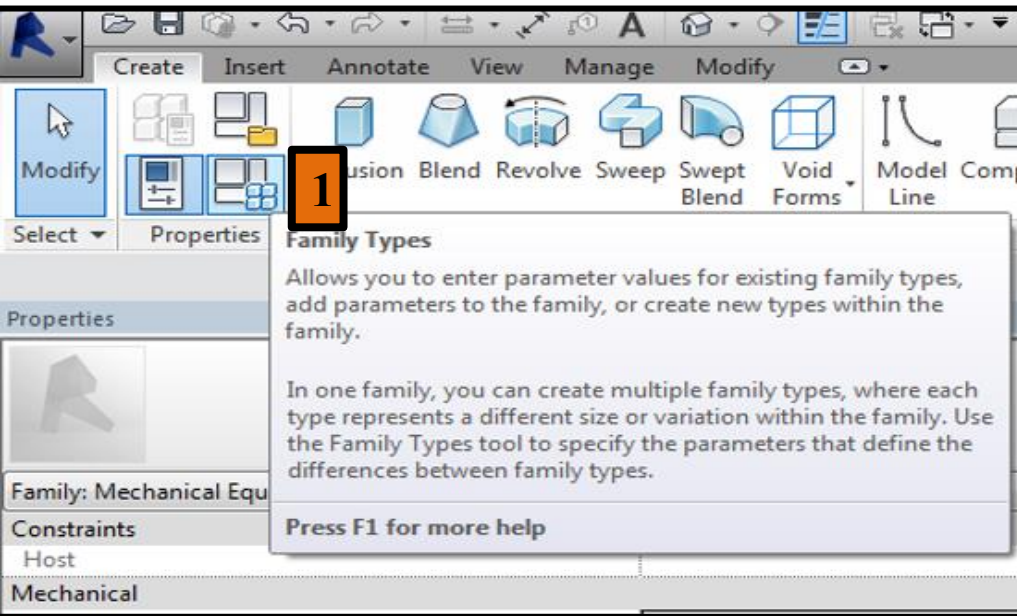

Options are Configured for users.

Family Types

Type name: 30KAV1100-OPT119 / 30KAVZE0800-OPT119 / 30KAVP1100 / 30KAVZ

Search parameters

Parameter	Value	Formula
Construction		
ATEX Zone	☐	=
OPT266	☐	=
OPT49+OPT325_OPT266	☐	=
OPT49+OPT325_OPT267	☐	=
OPT49_OPT267	☐	=
OPT50+OPT325_OPT266	☐	=
OPT50+OPT325_OPT267	☐	=
OPT50_OPT267	☐	=
OPT50	☐	=
OPT325 for OPT50	☐	=
OPT49	☐	=
OPT325 for OPT49	☐	=
Service Area		
Option23a	☐	=
Option 23	☐	=
15LS/15L	☐	=
Identity Data		

2

↑↓

↕

↕

How do I create family types?

OK

Cancel

6

Standard Unit Creation

30KAV1100-OPT119 / 30KAVZE0800-OPT119 / 30KAVP1100 / 30KAVPZE0800

Family Types

Type name: 30KAV1100-OPT119 / 30KAVZE0800-OPT119 / 30KAVP1100 / 30KAVPZE0800


Search parameters

Parameter	Value	Formula
Construction		
ATEX Zone	☐	=
OPT266	☐	=
OPT49+ OPT325_OPT266	☐	=
OPT49+ OPT325_OPT267	☐	=
OPT49_OPT267	☐	=
OPT50+ OPT325_OPT266	☐	=
OPT50+ OPT325_OPT267	☐	=
OPT50_OPT267	☐	=
OPT50	☐	=
OPT325 for OPT50	☐	=
OPT49	☐	=
OPT325 for OPT49	☐	=
Service Area	☐	=
Option23a	☐	=
Option 23	☐	=
15LS/15L	☐	=
Identity Data		

How do I manage family types?

OK Cancel

Note: Follow Step 1&2 as explained in previous slides, to select options

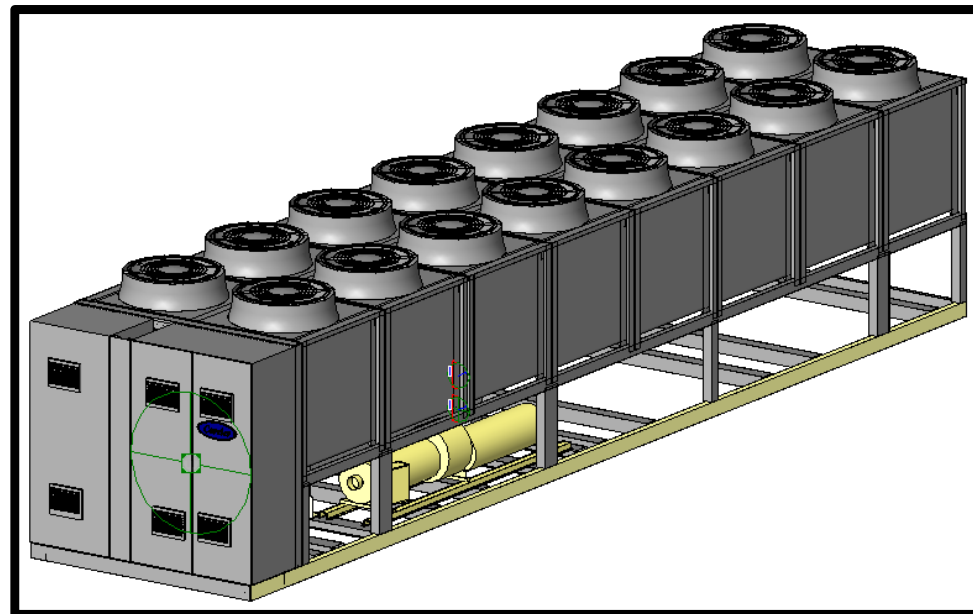

Option 15/15LS

Low Noise Enclosure
Standard unit + Enclosure

Family Types



Type name: OPT15/15LS

Search parameters

Parameter	Value	
Construction		
OPT50	☐	=
OPT325 for OPT50	☐	=
OPT49	☐	=
OPT325 for OPT49	☐	=
Service Area	☐	=
Option23a	☐	=
Option 23	☐	=
15LS/15L	☒	=
Identity Data		

How do I manage family types?

OK

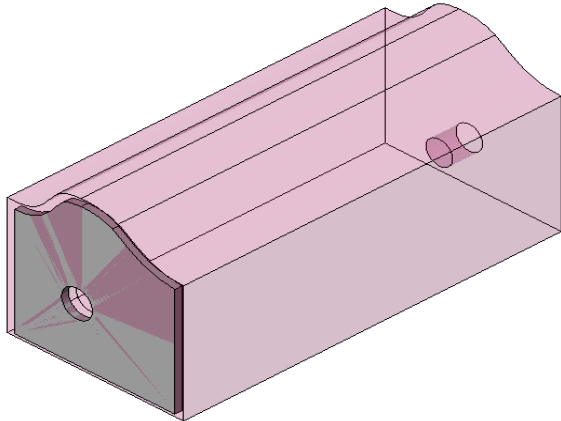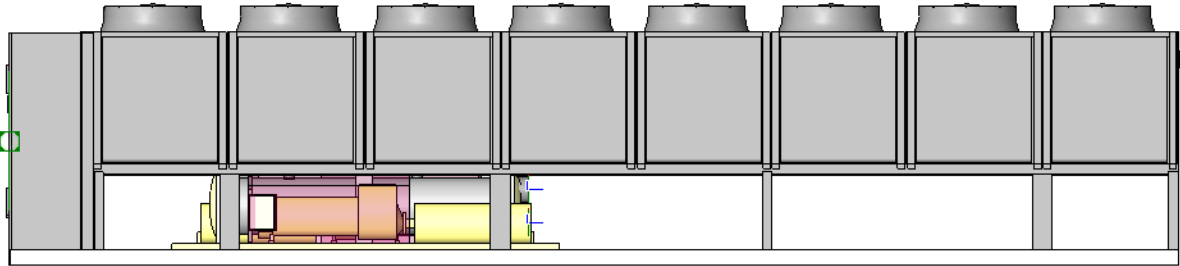

Option 23

Coil panel protection
Standard unit + panel+ Grill

Coil panel protection
Standard unit + panel+ Grill

Family Types

Type name:

[Search parameters](#)

Parameter	Value
Construction	
OPT50	☐ =
OPT325 for OPT50	☐ =
OPT49	☐ =
OPT325 for OPT49	☐ =
Service Area	☐ =
Option23a	☐ =
Option 23	☒ =
15LS/15L	☐ =
Identity Data	










[How do I manage family types?](#)


OK

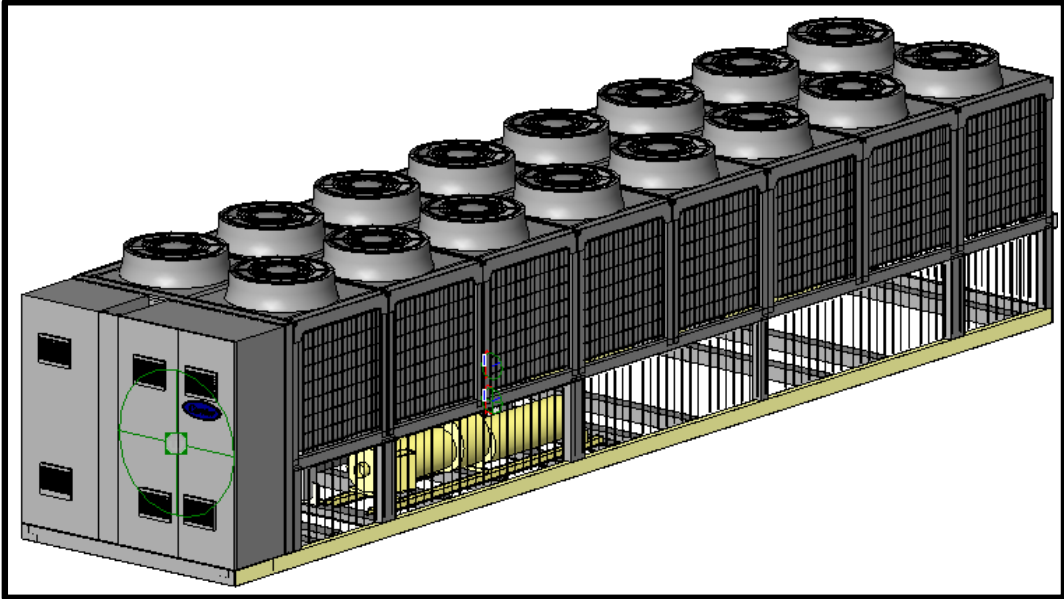

Option 23a

<u>Coil panel protection</u> Standard unit + Panel

<u>Coil panel protection</u> Standard unit + Panel

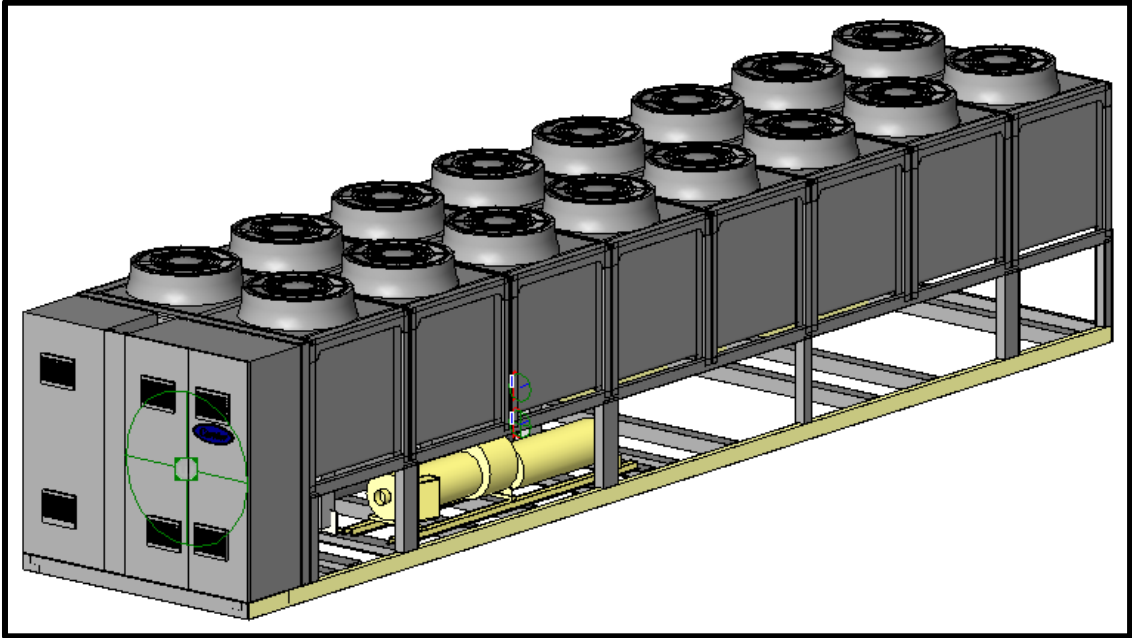[illegible]

Option 266

Cooler hydraulic connection

Family Types



Type name: OPT266

Search parameters

Parameter	Value
Construction	
ATEX Zone	
OPT266	☒
OPT49+ OPT325_OPT266	
OPT49+ OPT325_OPT267	
OPT49_OPT267	
OPT50+ OPT325_OPT266	
OPT50+ OPT325_OPT267	
OPT50_OPT267	
OPT50	
OPT325 for OPT50	
OPT49	
OPT325 for OPT49	
Service Area	
Option23a	
Option 23	
15LS/15L	
Identity Data	

[How do I manage family types?](#) OK

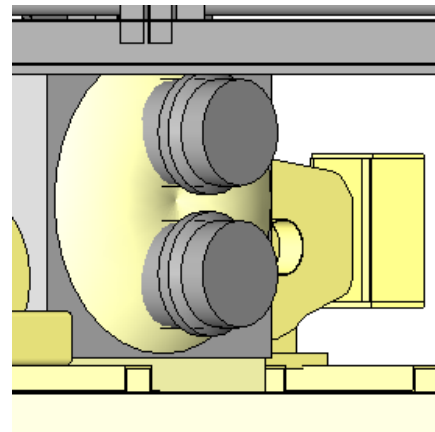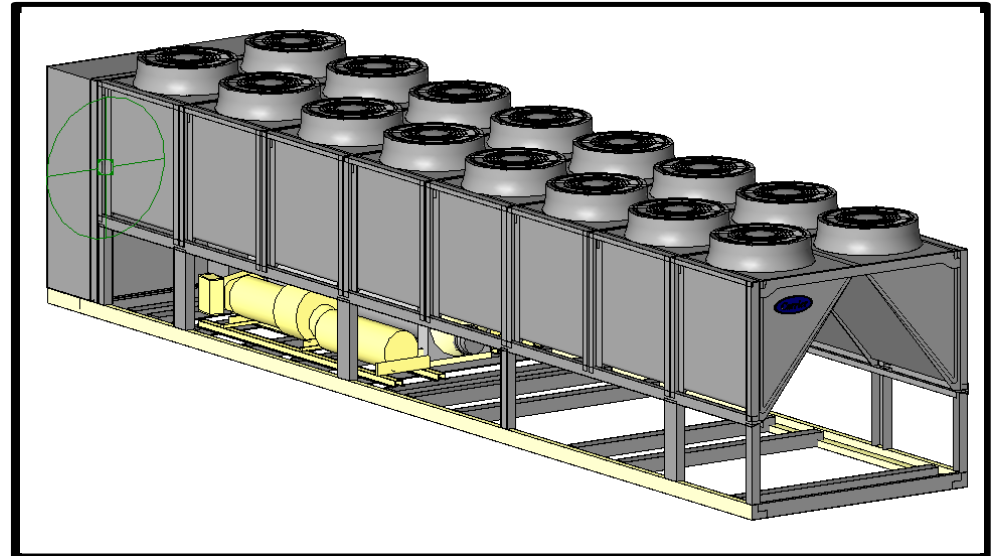

Service Area Option

Service Area - Standard Unit / Heat Recovery.


Family Types

Type name: Service Area

Search parameters

Parameter	Value	
Construction		
ATEX Zone	☐	=
OPT266	☐	=
OPT49+ OPT325_OPT266	☐	=
OPT49+ OPT325_OPT267	☐	=
OPT49_OPT267	☐	=
OPT50+ OPT325_OPT266	☐	=
OPT50+ OPT325_OPT267	☐	=
OPT50_OPT267	☐	=
OPT50	☐	=
OPT325 for OPT50	☐	=
OPT49	☐	=
OPT325 for OPT49	☐	=
Service Area	☒	=
Option23a	☐	=
Option 23	☐	=
15LS/15L	☐	=
Identity Data		

How do I manage family types?

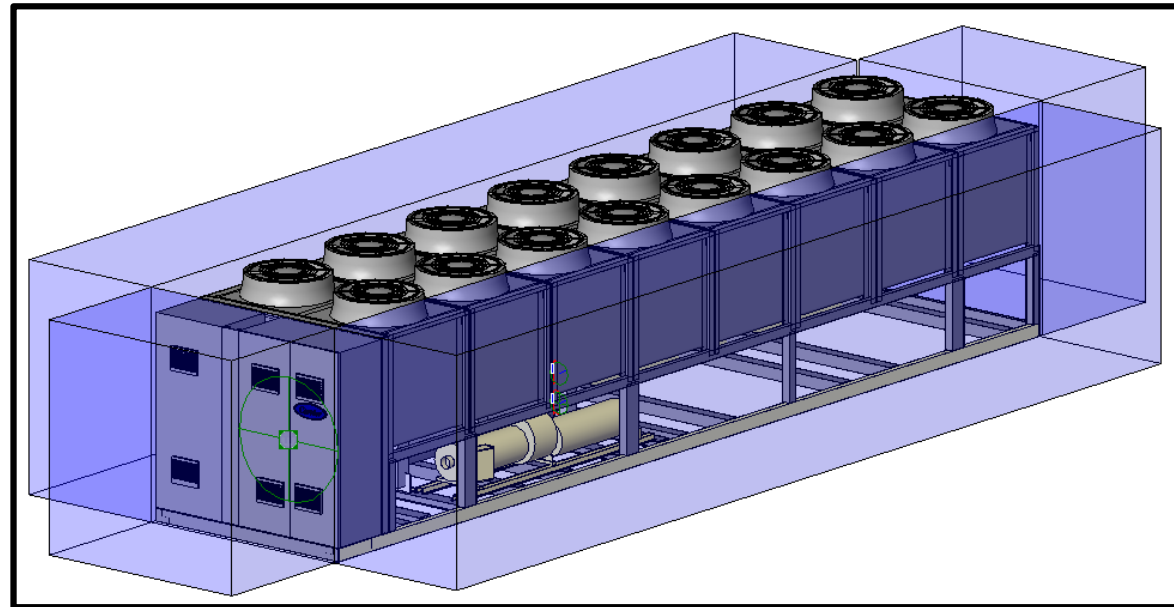

Service Area & ATEX Zone - ZE Units

Service Area & ATEX Zone - Standard Unit / Heat Recovery

Family Types



Type name: Service Area + ATEX Zone - Only ZE Units

Search parameters


Parameter	Value
Construction	
ATEX Zone	☒
OPT266	☐
OPT49+OPT325_OPT266	☐
OPT49+OPT325_OPT267	☐
OPT49_OPT267	☐
OPT50+OPT325_OPT266	☐
OPT50+OPT325_OPT267	☐
OPT50_OPT267	☐
OPT50	☐
OPT325 for OPT50	☐
OPT49	☐
OPT325 for OPT49	☐
Service Area	☒
Option23a	☐
Option 23	☐
15LS/15L	☐
Identity Data	

[How do I manage family types?](#) OK

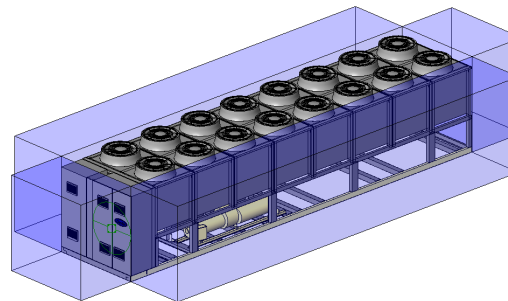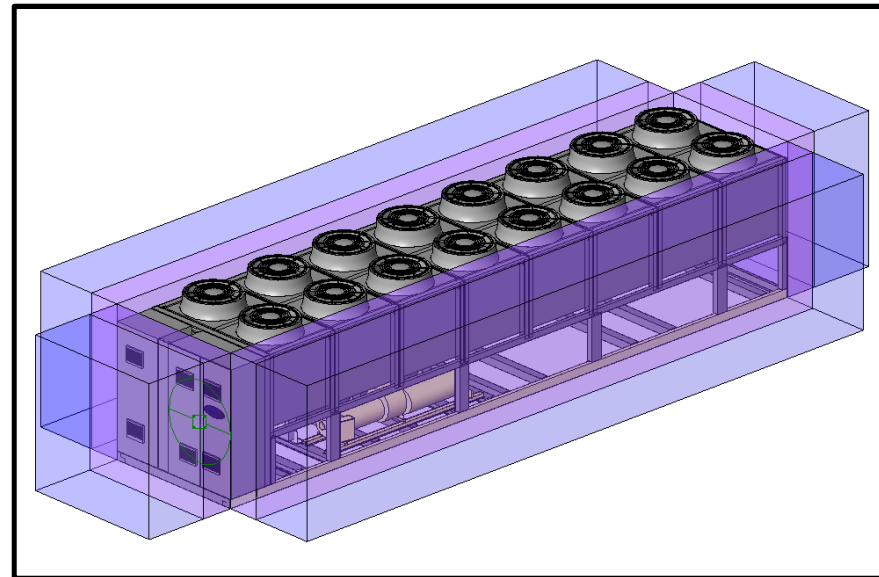


Service Area

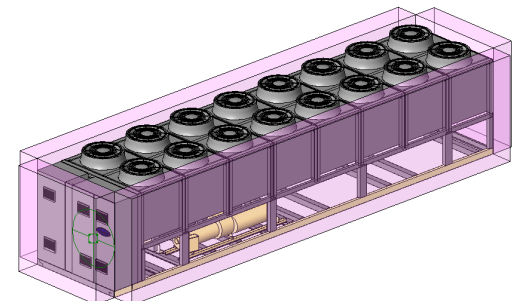

ATEX Zone

Option 15/15LS+Option23

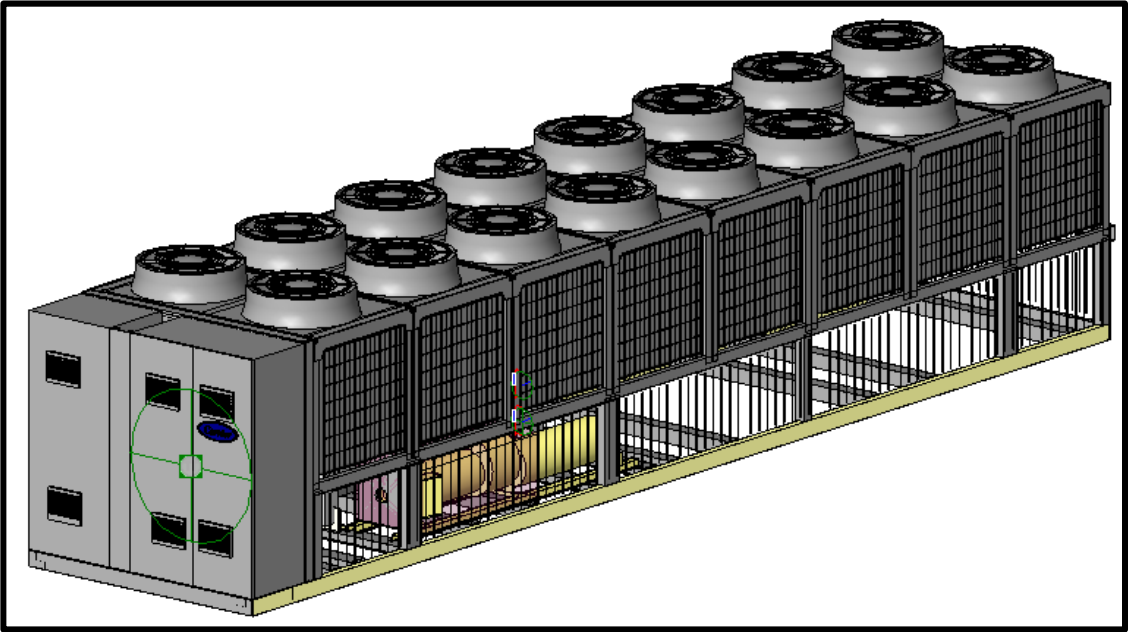[illegible]

Option 15/15LS+Option23a

Family Types


Type name: Opt 15L/LS + OPT 23a

Search parameters

Parameter	Value
Construction	
OPT50	☐
OPT325 for OPT50	☐
OPT49	☐
OPT325 for OPT49	☐
Service Area	☐
Option23a	☒
Option 23	☐
15LS/15L	☒
Identity Data	

[How do I manage family types?](#)

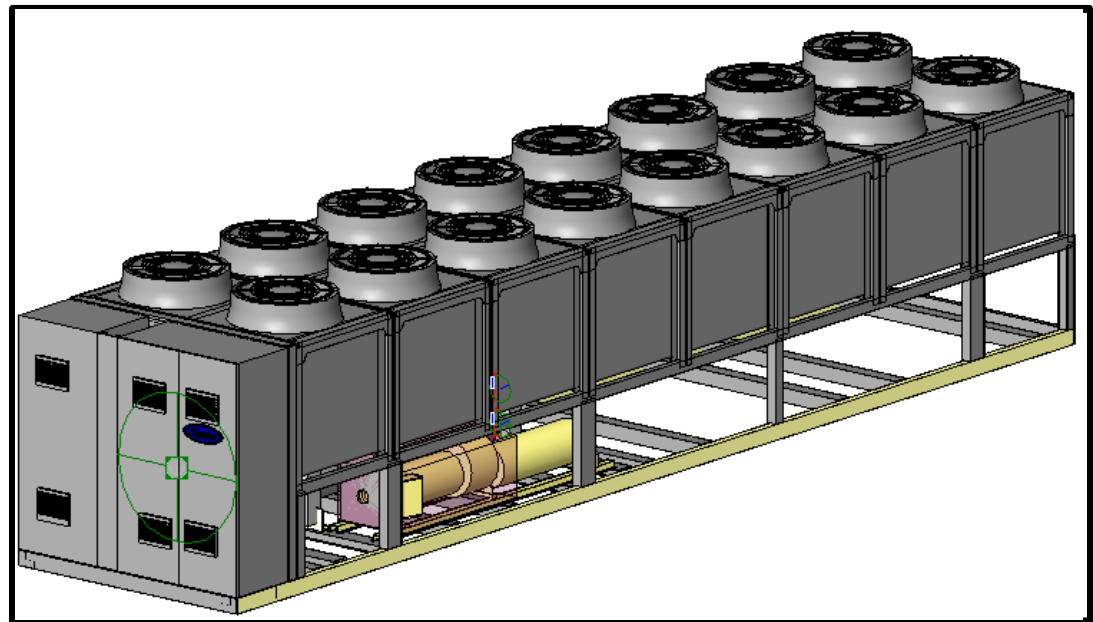

Option50 + Option325

Family Types



Type name: OPT50 + OPT325

Search parameters

Parameter	Value	
Construction		
OPT50	☒	=
OPT325 for OPT50	☒	=
OPT49	☐	=
OPT325 for OPT49	☐	=
Service Area	☐	=
Option23a	☐	=
Option 23	☐	=
15LS/15L	☐	=
Identity Data		

[How do I manage family types?](#)

OK

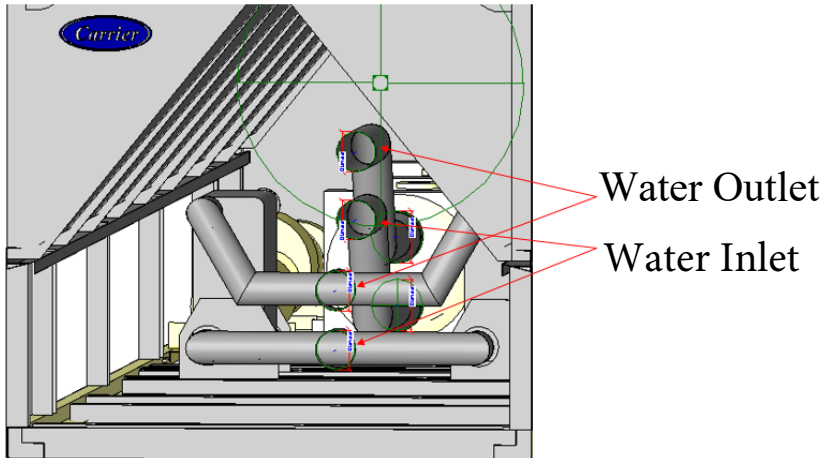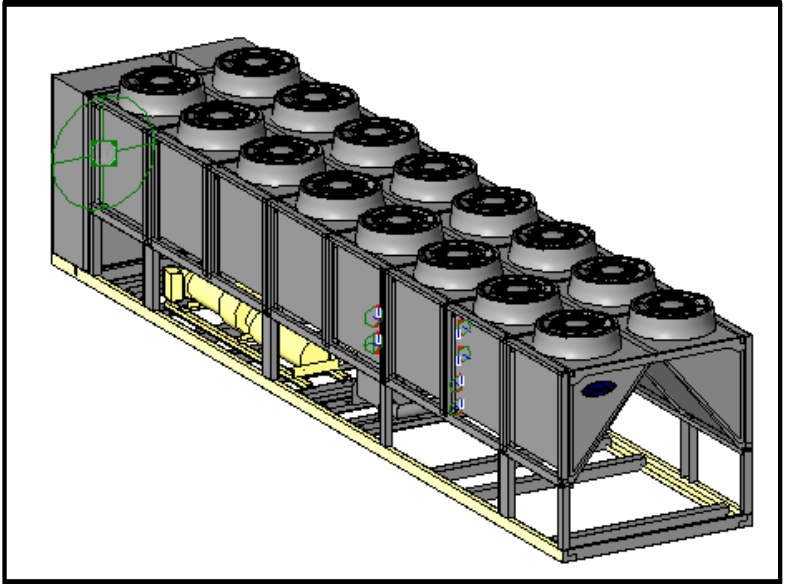

Option49 + Option325



Family Types

Type name: OPT49 + OPT325

Search parameters

Parameter	Value
Construction	
OPT50	☐
OPT325 for OPT50	☐
OPT49	☒
OPT325 for OPT49	☒
Service Area	☐
Option23a	☐
Option 23	☐
15LS/15L	☐
Identity Data	

[How do I manage family types?](#)

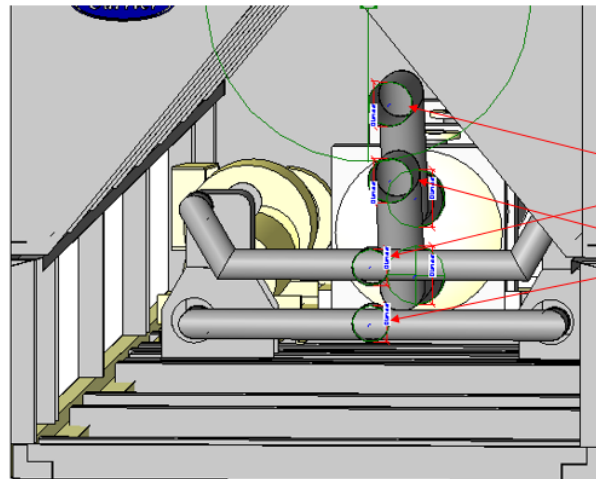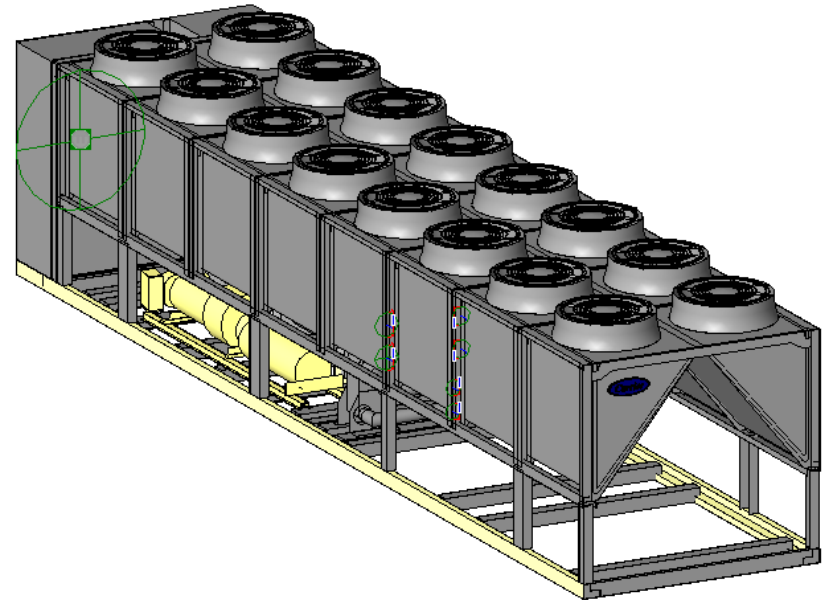

Water Outlet

Water Inlet

OPT 50 + OPT 266 + Opt267

1) In this slide only Opt50 is shown. Same way Opt49 is also configured.

Family Types



Type name: OPT50 + OPT266 + OPT267

Search parameters

Parameter	Value
Construction	
ATEX Zone	☐
OPT266	☒
OPT49+OPT325_OPT266	☐
OPT49+OPT325_OPT267	☐
OPT49_OPT267	☐
OPT50+OPT325_OPT266	☐
OPT50+OPT325_OPT267	☐
OPT50_OPT267	☒
OPT50	☒
OPT325 for OPT50	☐
OPT49	☐
OPT325 for OPT49	☐
Service Area	☐
Option23a	☐
Option 23	☐
15LS/15L	☐
Identity Data	

How do I manage family types?

OK

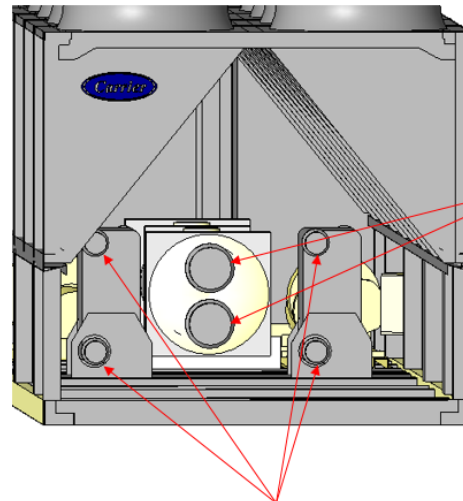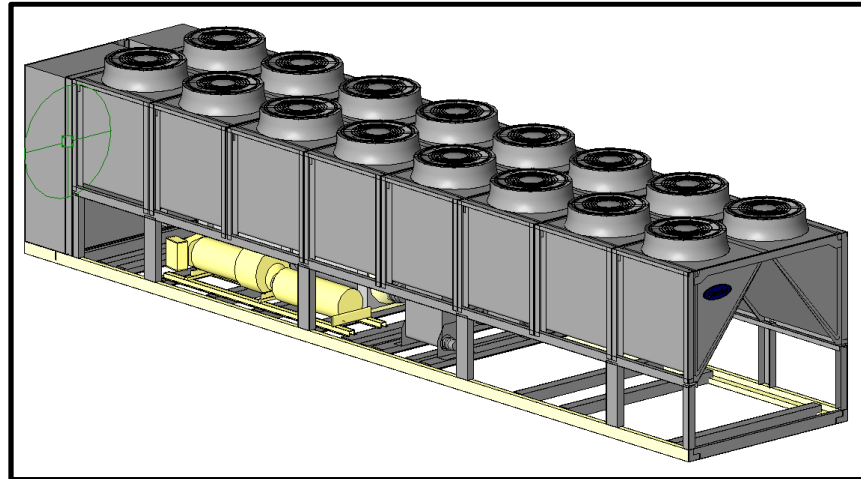

Opt 266

Opt 267

OPT 50 + OPT325 + OPT 266 + Opt267

1) In this slide only Opt50 is shown. Same way Opt49 is also configured.

Family Types



Type name: OPT50 + OPT325 + OPT266 + OPT267

Search parameters

Parameter	Value
Construction	
ATEX Zone	☐
OPT266	☐
OPT49+OPT325_OPT266	☐
OPT49+OPT325_OPT267	☐
OPT49_OPT267	☐
OPT50+OPT325_OPT266	☒
OPT50+OPT325_OPT267	☒
OPT50_OPT267	☐
OPT50	☒
OPT325 for OPT50	☒
OPT49	☐
OPT325 for OPT49	☐
Service Area	☐
Option23a	☐
Option 23	☐
15LS/15L	☐
Identity Data	

How do I manage family types?

OK

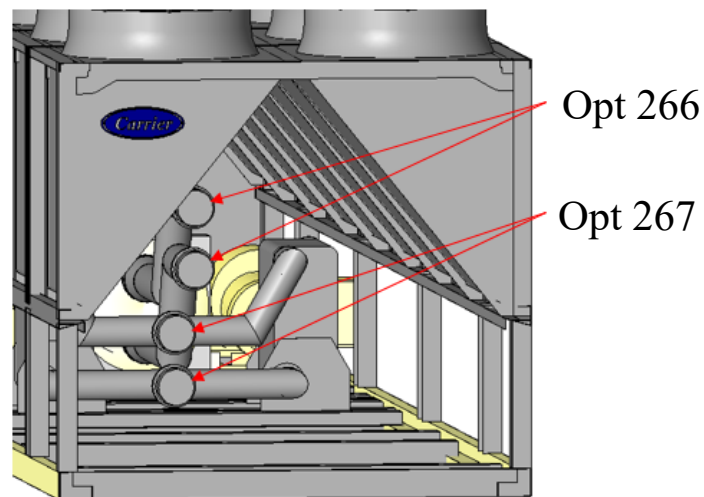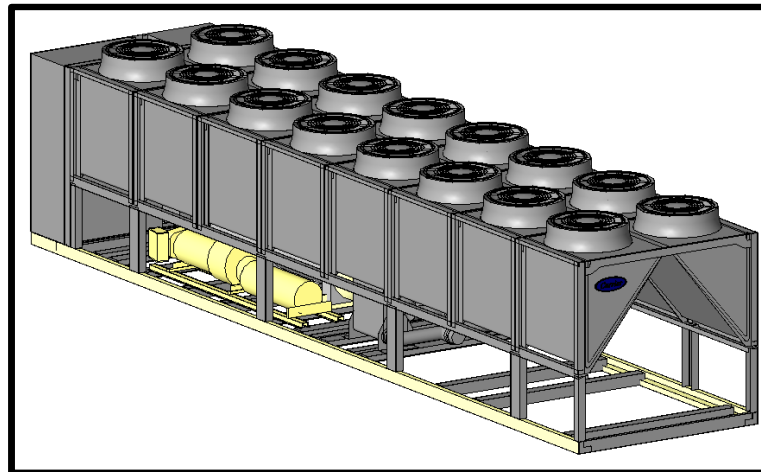

IMPORTANT:-



Connectors Used-

- 1) Cooler Inlet /Outlet
- 2) Total Heat Recovery (Opt50) Inlet / Outlet
- 3) Partial Heat Recovery (Opt49) Inlet / Outlet
- 4) Total Heat Recovery (Opt50) + Opt325 Inlet / Outlet
- 5) Partial Heat Recovery (Opt49) + Opt325 Inlet / Outlet
- 6) Electrical Box

Connector Information are read by clicking on the arrow Provided as shown.

NOTE: 1) Connector are associated with the geometry profile of the unit.

Cooler Inlet / Outlet

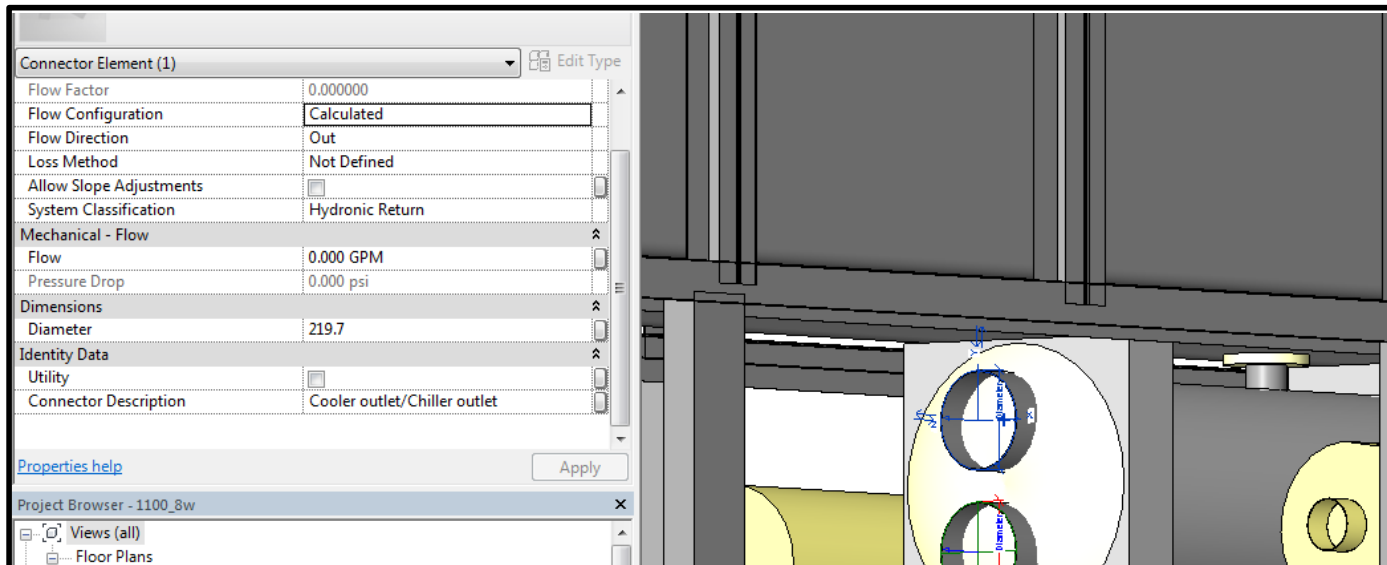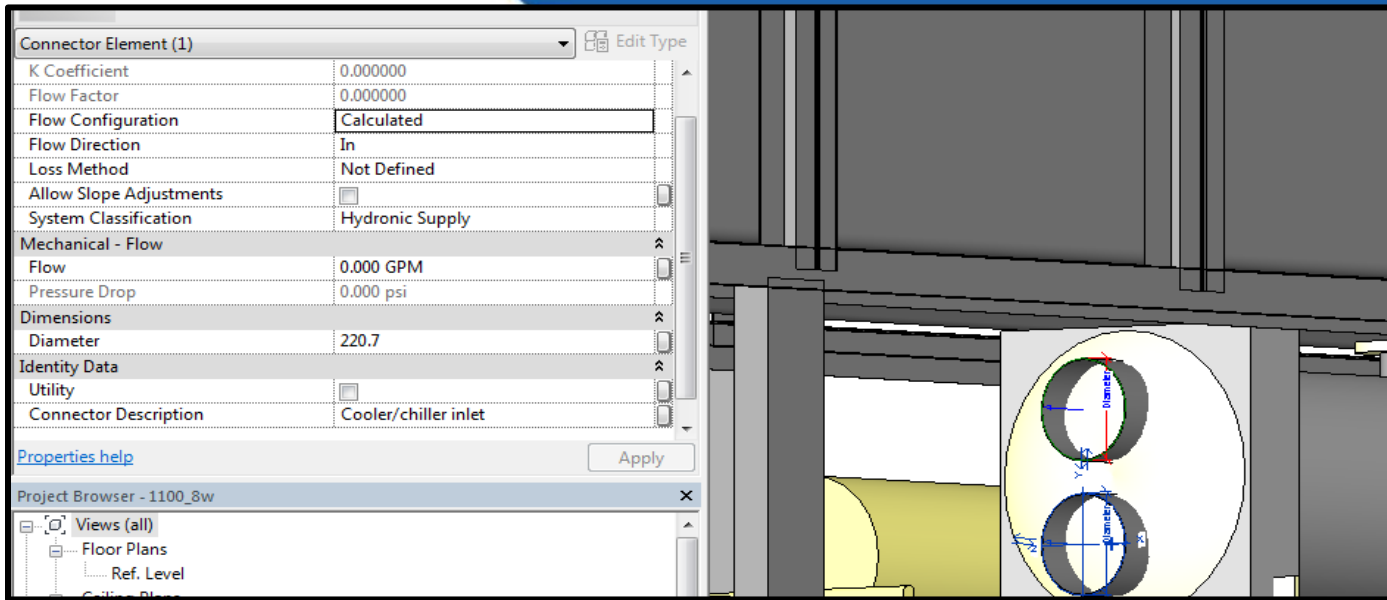

Total Heat Recovery (Opt50) Inlet / Outlet

Multiple Families Selected

Connector Element (2)  Edit Type

Dimensions

Diameter 114.3

Mechanical

K Coefficient 0.000000

Flow Factor 0.000000

Flow Configuration Calculated

Flow Direction In

Loss Method Not Defined

Allow Slope Adjustments ☐

System Classification Hydronic Supply

Mechanical - Flow


Flow 0.000 GPM

Pressure Drop 0.000 psi

Identity Data

Utility ☐

Connector Description Water_Inlet

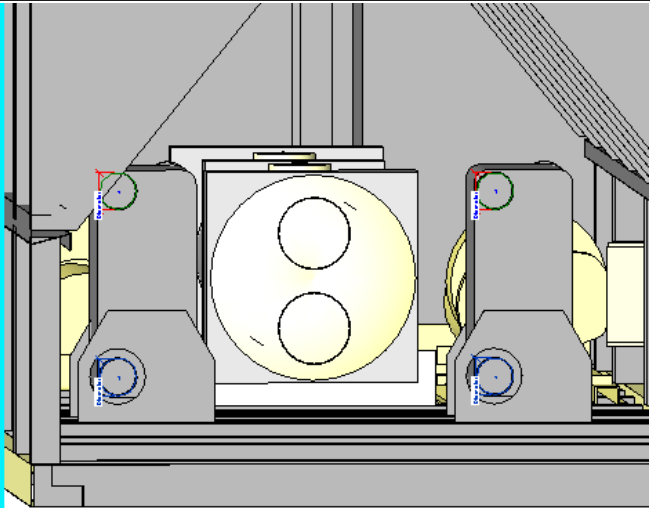

Multiple Families Selected

Connector Element (2)  Edit Type

Dimensions

Diameter 114.3

Mechanical

K Coefficient 0.000000

Flow Factor 0.000000

Flow Configuration Calculated

Flow Direction Out

Loss Method Not Defined

Allow Slope Adjustments ☐

System Classification Hydronic Return

Mechanical - Flow


Flow 0.000 GPM

Pressure Drop 0.000 psi

Identity Data

Utility ☐

Connector Description Water_Outlet

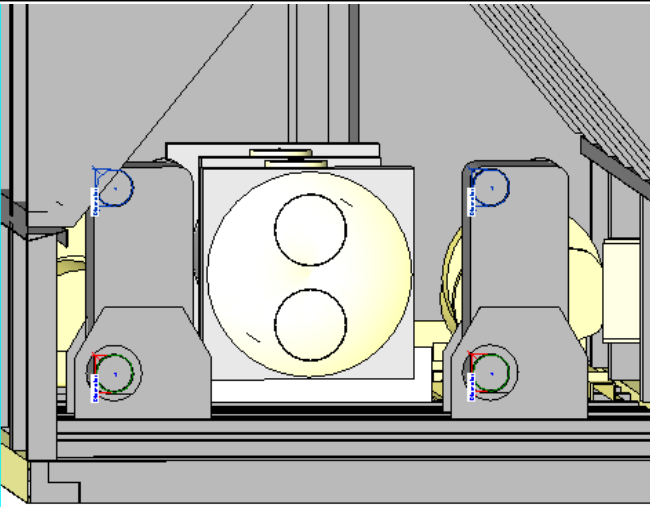


Partial Heat Recovery (Opt49) Inlet / Outlet

Multiple Families Selected

Connector Element (2) Edit Type


Dimensions	
Diameter	114.3
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configuration	Calculated
Flow Direction	In
Loss Method	Not Defined
Allow Slope Adjustments	☐
System Classification	Hydronic Supply
Mechanical - Flow	
Flow	0.000 GPM
Pressure Drop	0.000 psi
Identity Data	
Utility	☐
Connector Description	Water_Inlet

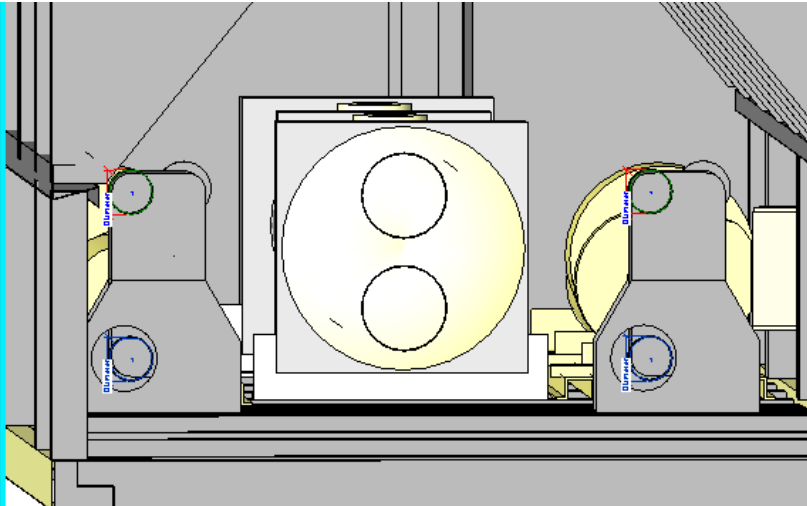

Multiple Families Selected

Connector Element (2) Edit Type

Dimensions	
Diameter	114.3
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configuration	Calculated
Flow Direction	Out
Loss Method	Not Defined
Allow Slope Adjustments	☐
System Classification	Hydronic Return
Mechanical - Flow	
Flow	0.000 GPM
Pressure Drop	0.000 psi
Identity Data	
Utility	☐
Connector Description	Water_Outlet

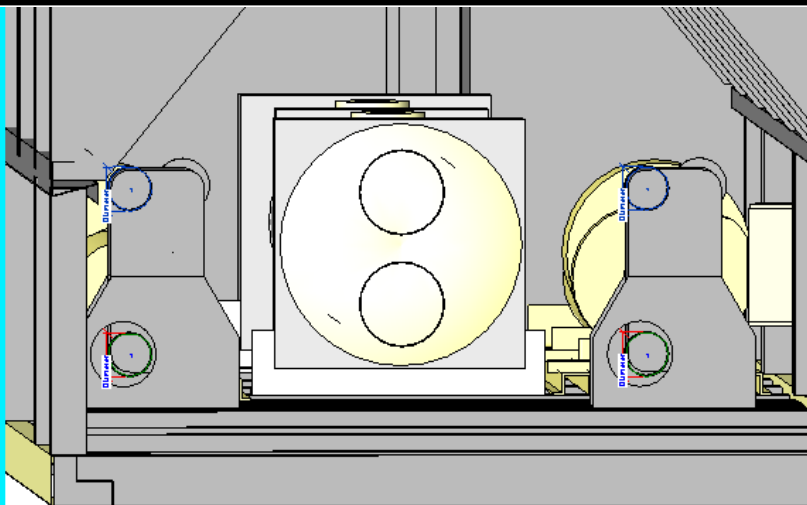

Total Heat Recovery (Opt50) + Opt325 Inlet / Outlet

R

Connector Element (1)  Edit Type

Diameter 168.3

Mechanical

K Coefficient 0.000000

Flow Factor 0.000000

Flow Configuration Calculated

Flow Direction In

Loss Method Not Defined

Allow Slope Adjustments ☐

System Classification Hydronic Supply

Mechanical - Flow


Flow 0.000 GPM

Pressure Drop 0.000 psi

Identity Data

Utility ☐

Connector Description Water_Inlet

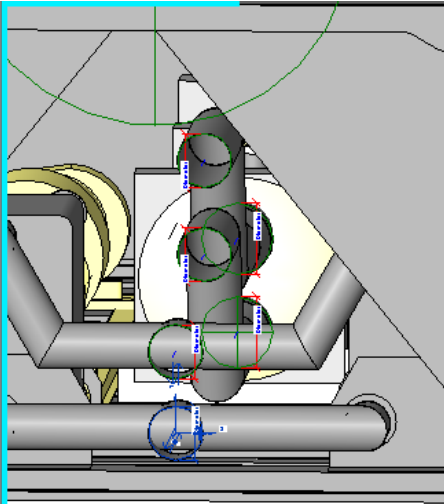

R

Connector Element (1)  Edit Type

Diameter 168.3

Mechanical

K Coefficient 0.000000

Flow Factor 0.000000

Flow Configuration Calculated

Flow Direction In

Loss Method Not Defined

Allow Slope Adjustments ☐

System Classification Hydronic Supply

Mechanical - Flow

Flow 0.000 GPM


Pressure Drop 0.000 psi

Identity Data

Utility ☐

Connector Description Water_Inlet

955.2

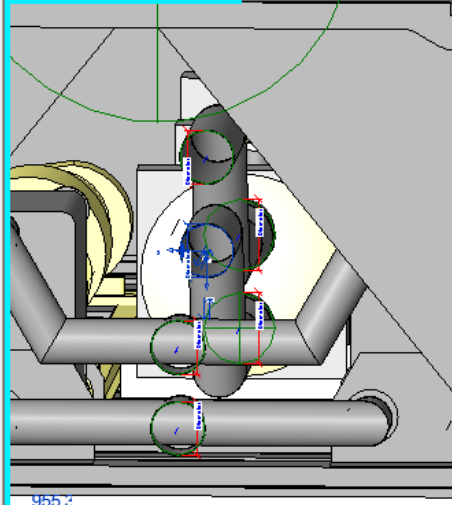

R

Connector Element (1)  Edit Type

Diameter 168.3

Mechanical

K Coefficient 0.000000

Flow Factor 0.000000

Flow Configuration Calculated

Flow Direction Out

Loss Method Not Defined

Allow Slope Adjustments ☐

System Classification Hydronic Return

Mechanical - Flow


Flow 0.000 GPM

Pressure Drop 0.000 psi

Identity Data

Utility ☐

Connector Description Water_Outlet

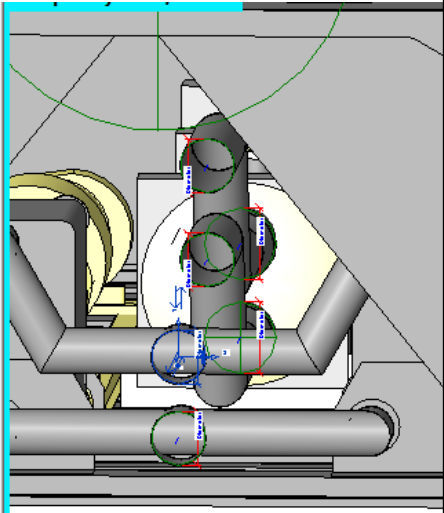

R

Connector Element (1)  Edit Type

Diameter 168.3

Mechanical

K Coefficient 0.000000

Flow Factor 0.000000

Flow Configuration Calculated

Flow Direction Bidirectional

Loss Method Not Defined

Allow Slope Adjustments ☐

System Classification Hydronic Return

Mechanical - Flow

Flow 0.000 GPM


Pressure Drop 0.000 psi

Identity Data

Utility ☐

Connector Description Water_Outlet

955.2

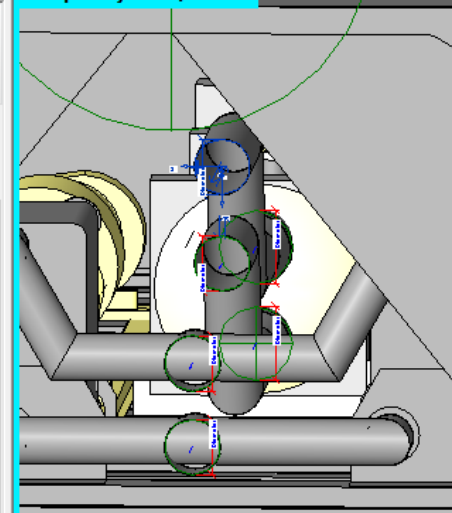

Partial Heat Recovery (Opt49) + Opt325 Inlet / Outlet

R

Connector Element (1) Edit Type

Dimensions
Diameter 139.7

Mechanical
K Coefficient 0.000000
Flow Factor 0.000000
Flow Configuration Calculated
Flow Direction In
Loss Method Not Defined
Allow Slope Adjustments ☐
System Classification Hydronic Supply

Mechanical - Flow
Flow 0.000 GPM
Pressure Drop 0.000 psi

Identity Data
Utility ☐
Connector Description Water_Inlet

R

Connector Element (1) Edit Type

Dimensions
Diameter 168.3

Mechanical
K Coefficient 0.000000
Flow Factor 0.000000
Flow Configuration Calculated
Flow Direction In
Loss Method Not Defined
Allow Slope Adjustments ☐
System Classification Hydronic Supply

Mechanical - Flow
Flow 0.000 GPM
Pressure Drop 0.000 psi

Identity Data
Utility ☐
Connector Description Water_Inlet

R

Connector Element (1) Edit Type

Dimensions
Diameter 139.7

Mechanical
K Coefficient 0.000000
Flow Factor 0.000000
Flow Configuration Calculated
Flow Direction Out
Loss Method Not Defined
Allow Slope Adjustments ☐
System Classification Hydronic Return

Mechanical - Flow
Flow 0.000 GPM
Pressure Drop 0.000 psi

Identity Data
Utility ☐
Connector Description Water_Outlet

R

Connector Element (1) Edit Type

Dimensions
Diameter 168.3

Mechanical
K Coefficient 0.000000
Flow Factor 0.000000
Flow Configuration Calculated
Flow Direction Out
Loss Method Not Defined
Allow Slope Adjustments ☐
System Classification Hydronic Return

Mechanical - Flow
Flow 0.000 GPM
Pressure Drop 0.000 psi

Identity Data
Utility ☐
Connector Description Water_Outlet

Electrical Box Connection




Connector Element (1)  Edit Type

Electrical - Loads 



System Type	Power - Unbalanced	
Number of Poles	1	
Power Factor State	Lagging	
Load Classification	Other	
Load Sub-Classification Motor	☐	
Voltage	0.00 V	
Apparent Load Phase 1	0.00 VA	
Apparent Load Phase 2	0.00 VA	
Apparent Load Phase 3	0.00 VA	
Power Factor	1.000000	

Identity Data 

Utility	☐	
Connector Description	Electrical_Box 30KAV 1100 O...	

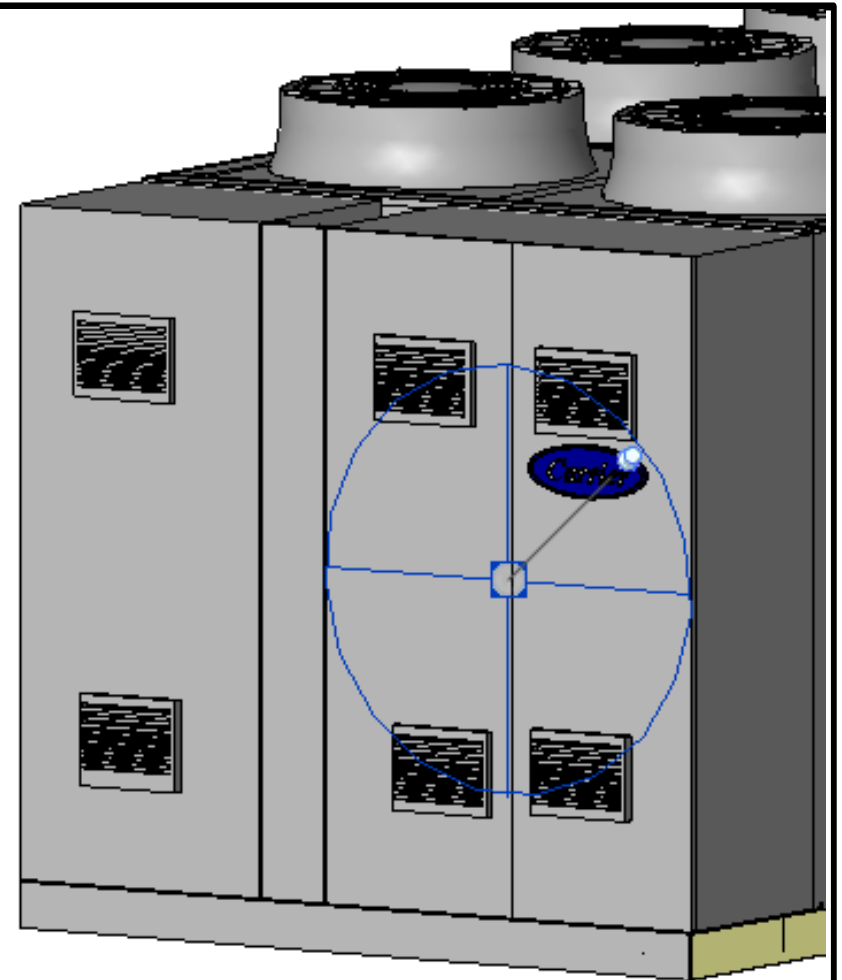

Carrier Logo

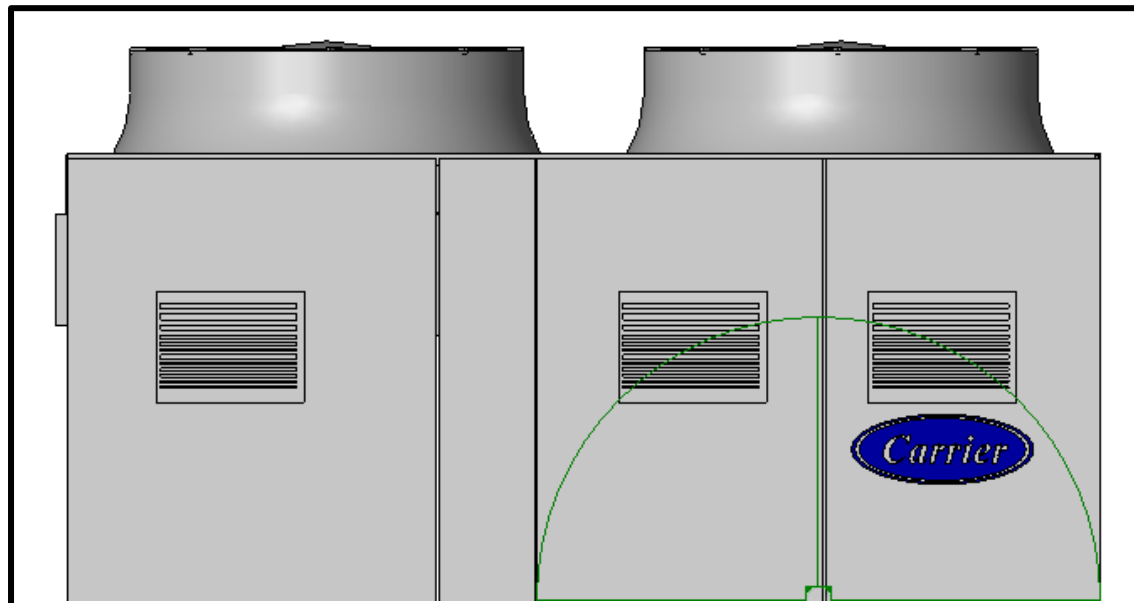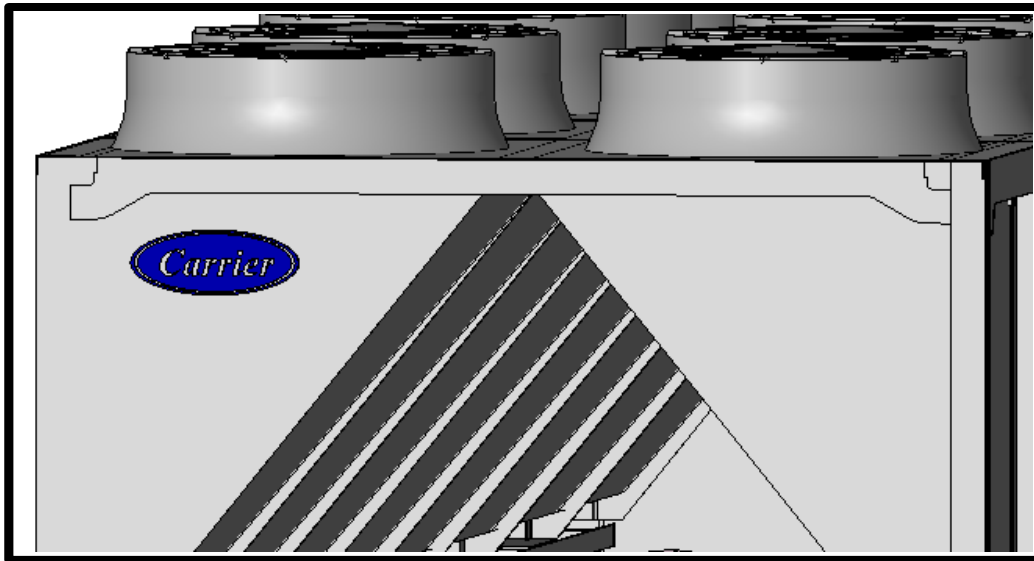

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузки в транспортную компанию

Технические данные файла

Документ: Схема Carrier 30KAV/30KAVP, чиллеры с воздушным охлаждением: BIM-модель Revit 30KAV1100-OPT119 / 30KAVZE0800-OPT119 / 30KAVP1100 / 30KAVPZE0800, 01.2024

Идентификатор библиотеки: LIB-004024

Исходный файл: carrier-30kav1100-opt119-30kavze0800-opt119-revit-opt119-shema.pdf

SHA-256 оригинала: 17ebc3ae6e27f47545fc1ef361eb263b910c3bb12da88081cdc6cc9141530e8e

Постоянная ссылка:

<https://iclim.ru/library/carrier-30kav1100-opt119-30kavze0800-opt119-revit-opt119-shema.pdf>

Копия сформирована: 03.10.2026 19:57 UTC