
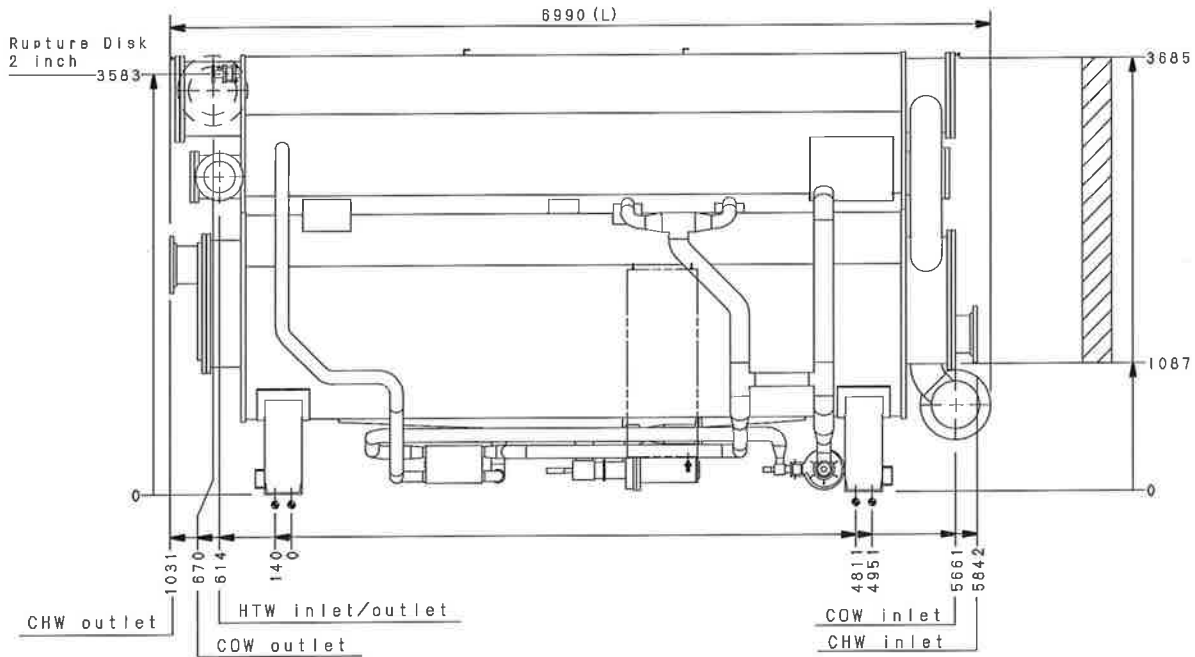
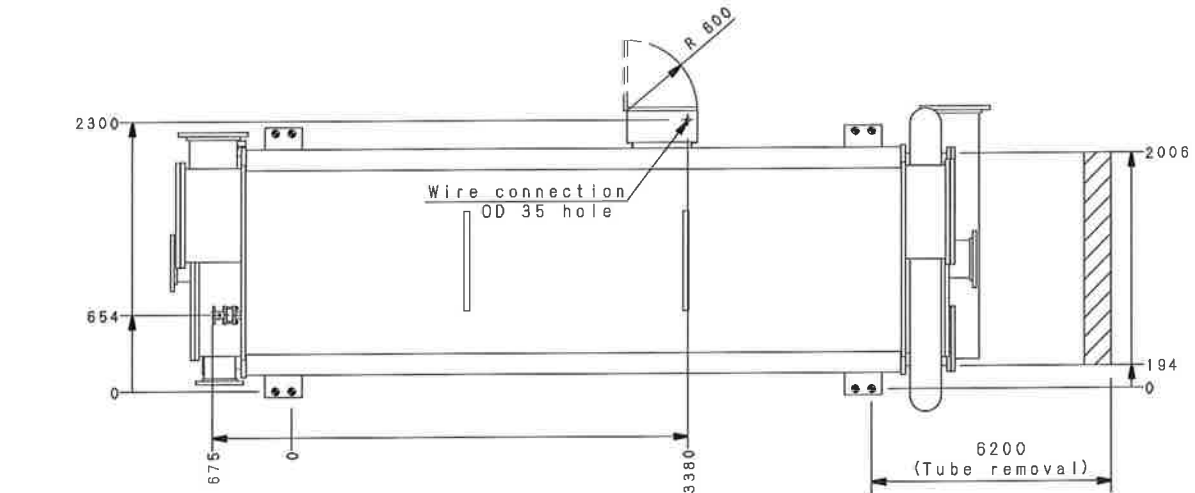


NOTE

- (1) DIMENSIONS (L), (W), (H), ARE FOR STANDARD MACHINE.
THE DIMENSIONS ARE CHANGED BY PARTS ADDED.
- (2) ⊕ INDICATES THE POSITION OF ANCHOR BOLTS.
- (3) CLEARANCE SPACE MUST BE SAVED EITHER SIDE OF THE CHILLER.
- (4) MATING FLANGES OF ALL EXTERNAL WATER PIPING ARE PROVIDED WELDED DIN 10 FLANGES WITH CHILLER.
- (5) ↑ INDICATES THE POSITION OF THE POWER SUPPLY CONNECTION ON CONTROL PANEL. (DIA. 35MM)
- (6) INSTALLATION CLEARANCE
 - LONGITUDINAL DISTANCE: 1000mm
 - TOP : 200mm
 - OTHERS : 500mm

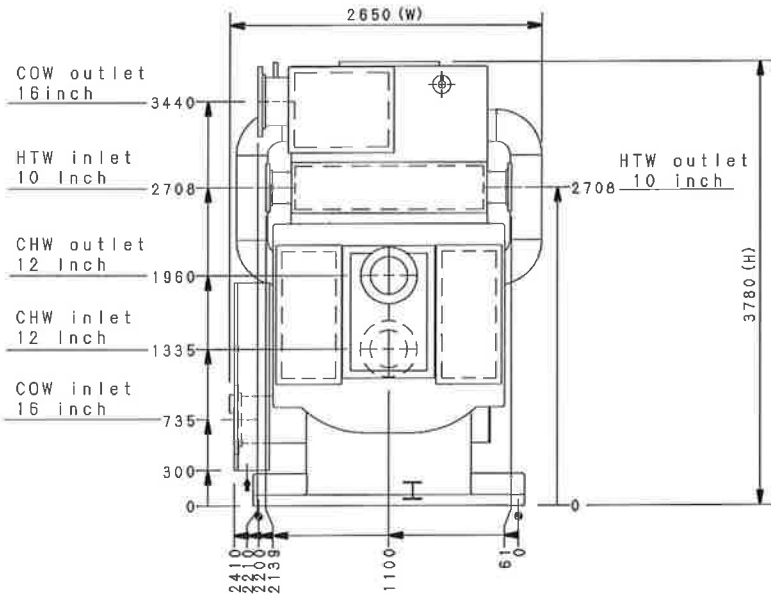

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузка в транспортную компанию

Технические данные файла

Документ: Схема Carrier 16LJ/16LJ-F, абсорбционные чиллеры: габаритный чертёж LJ-006-118-00-1, 07.2014

Идентификатор библиотеки: LIB-003985

Исходный файл: carrier-lj-006-118-00-1-07-2014-shema.pdf

SHA-256 оригинала: 2bf5ada8e1ba59164e0a30de15a2f61155413a90bde1c2d056eadb8e90711f0

Постоянная ссылка: <https://iclim.ru/library/carrier-lj-006-118-00-1-07-2014-shema.pdf>

Копия сформирована: 03.10.2026 13:39 UTC