

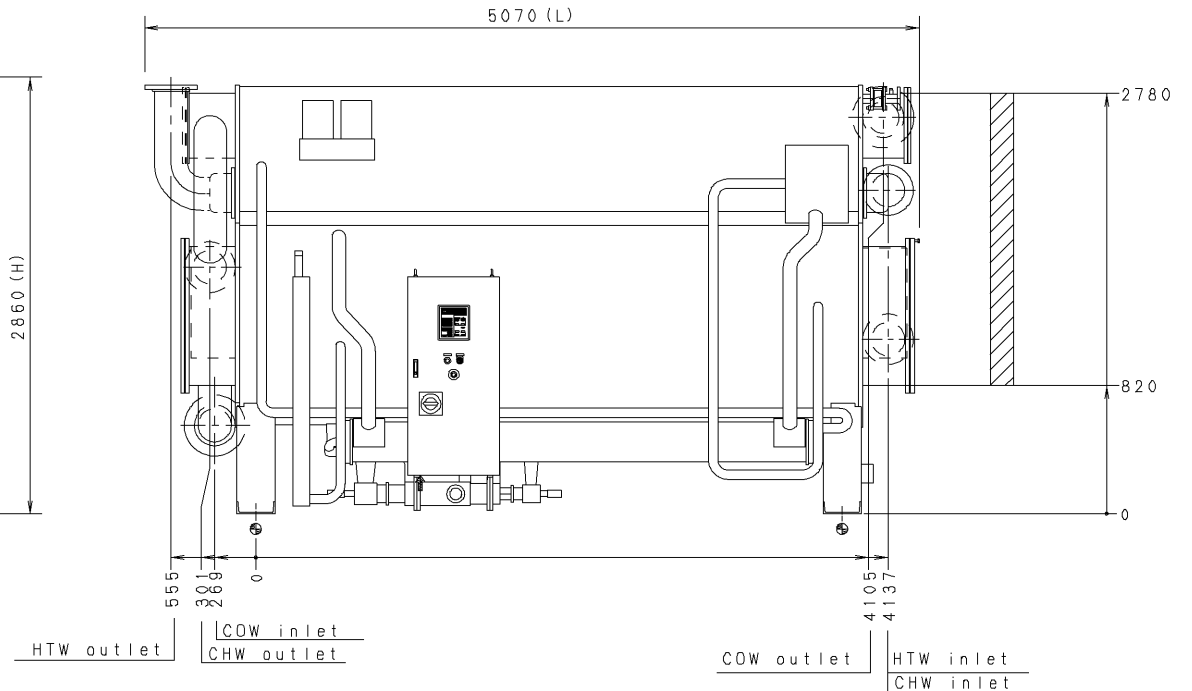


NOTE

- (1) DIMENSIONS (L), (W), (H), ARE FOR STANDARD MACHINE.
THE DIMENSIONS ARE CHANGED BY PARTS ADDED.
- (2)  INDICATES THE POSITION OF ANCHOR BOLTS.
- (3) CLEARANCE SPACE MUST BE SAVED EITHER SIDE OF THE CHILLER
- (4) MATING FLANGES OF ALL EXTERNAL WATER PIPING ARE PROVIDED WELDED ANSI 150LB FLANGES WITH CHILLER.
- (5)  INDICATES THE POSITION OF THE POWER SUPPLY CONNECTION ON CONTROL PANEL. (DIA. 35 MM)
- (6) INSTALLATION CLEARANCE
 - LONGITUDINAL DISTANCE: 1000 MM
 - TOP : 200 MM
 - OTHERS: 500 MM

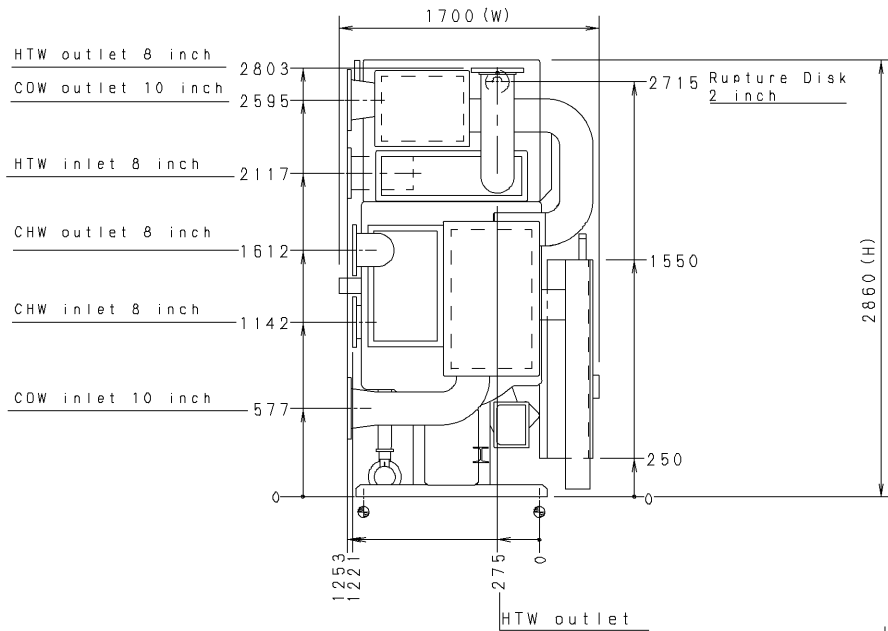

E3 A2 C1 G3
Compact panel

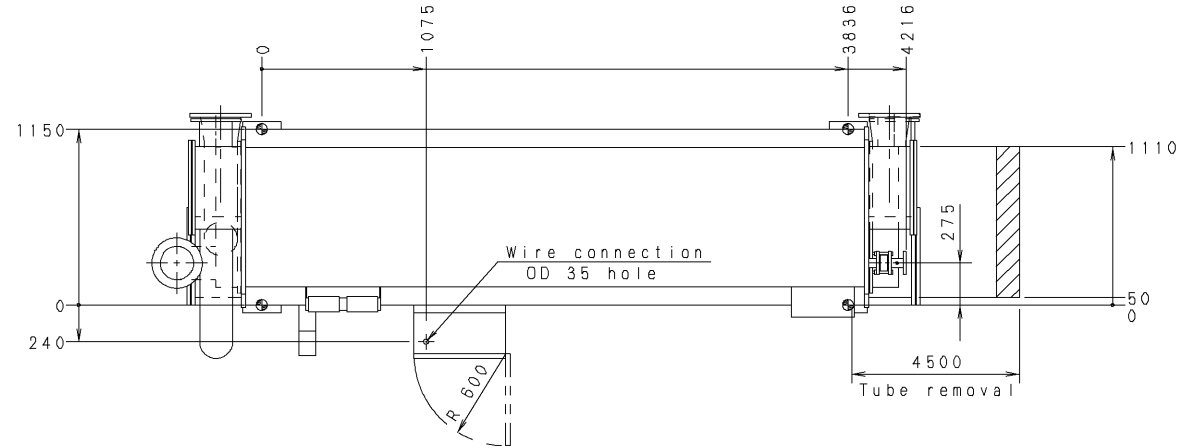

DIMENSIONS

16LJ-41

LJ-006-411-00-8

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузки в транспортную компанию

Технические данные файла

Документ: Схема Carrier 16LJ/16LJ-F, абсорбционные чиллеры: габаритный чертёж LJ-006-411-00-8, 07.2014

Идентификатор библиотеки: LIB-003971

Исходный файл: carrier-lj-006-411-00-8-07-2014-shema.pdf

SHA-256 оригинала: 1a6ddc7de92bb2c9d1727afbe7c17efe056f306ef93d2ecef8091e121043454a

Постоянная ссылка: <https://iclim.ru/library/carrier-lj-006-411-00-8-07-2014-shema.pdf>

Копия сформирована: 03.10.2026 12:47 UTC