

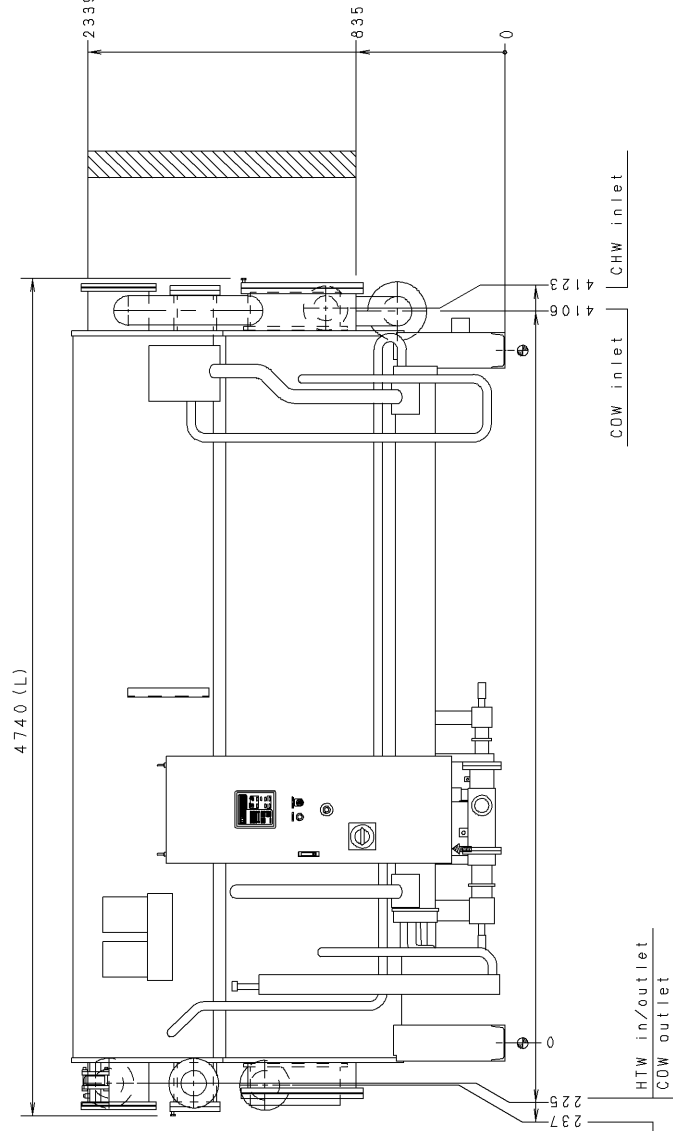


NOTE

- (1) DIMENSIONS (L). (W). (H). ARE FOR STANDARD MACHINE.
THE DIMENSIONS ARE CHANGED BY PARTS ADDED.
- (2)  INDICATES THE POSITION OF ANCHOR BOLTS.
- (3) CLEARANCE SPACE MUST BE SAVED EITHER SIDE OF THE CHILLER
- (4) MATING FLANGES OF ALL EXTERNAL WATER PIPING ARE PROVIDED WELDED ANSI FLANGES WITH CHILLER.
CHW:ANSI 150LB HTW:ANSI 300LB
- (5)  INDICATES THE POSITION OF THE POWER SUPPLY CONNECTION ON CONTROL PANEL. (DIA. 35 MM)
- (6) INSTALLATION CLEARANCE
-LONGITUDINAL DISTANCE:1000 MM
-TOP :200 MM
-OTHERS:500 MM

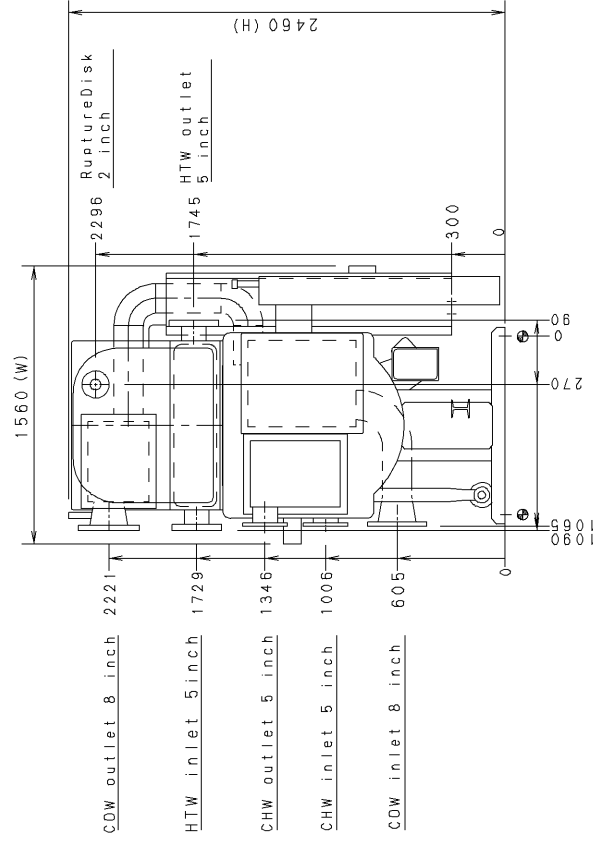

E3 A2 C1 G2

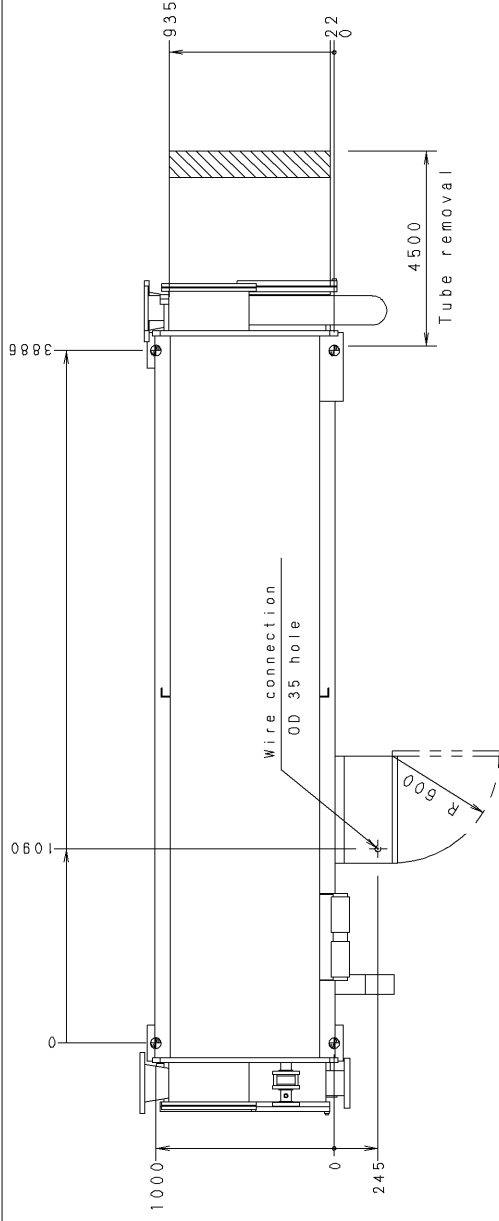

DIMENSIONS

TSA-16LJ-24P

LJ-006-458-00-1

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузка в транспортную компанию

Технические данные файла

Документ: Схема Carrier 16LJ/16LJ-F, абсорбционные чиллеры: габаритный чертёж LJ-006-458-00-1, 07.2014

Идентификатор библиотеки: LIB-003952

Исходный файл: carrier-lj-006-458-00-1-07-2014-shema.pdf

SHA-256 оригинала: e956905f509490c5978bc8f4ca47b5dbd563707d0a95777fc4a8235db6e7c1f3

Постоянная ссылка: <https://iclim.ru/library/carrier-lj-006-458-00-1-07-2014-shema.pdf>

Копия сформирована: 03.10.2026 19:36 UTC