

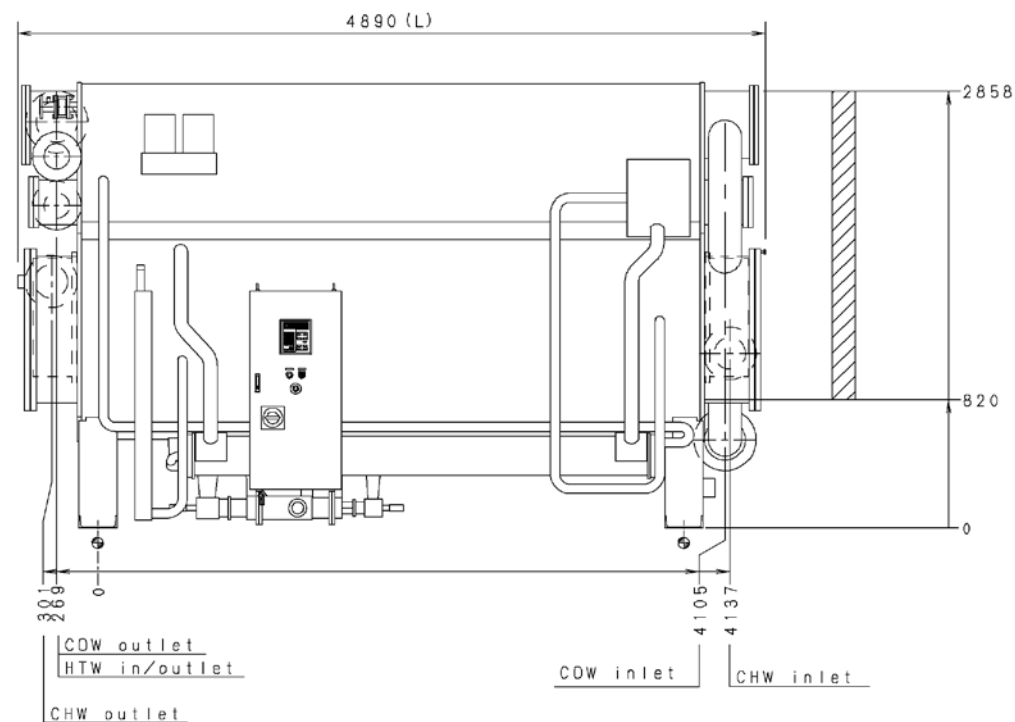


NOTE

- (1) DIMENSIONS (L), (W), (H), ARE FOR STANDARD MACHINE.
THE DIMENSIONS ARE CHANGED BY PARTS ADDED.
- (2)  INDICATES THE POSITION OF ANCHOR BOLTS.
- (3) CLEARANCE SPACE MUST BE SAVED EITHER SIDE OF THE CHILLER.
- (4) MATING FLANGES OF ALL EXTERNAL WATER PIPING ARE
PROVIDED WELDED ANSI FLANGES WITH CHILLER.
CHW, COW: ANSI 150LB HTW: ANSI 300LB
- (5)  INDICATES THE POSITION OF THE POWER SUPPLY
CONNECTION ON CONTROL PANEL. (DIA. 35 MM)
- (6) INSTALLATION CLEARANCE
· LONGITUDINAL DISTANCE: 1000 MM
· TOP : 200 MM
· OTHERS: 500 MM

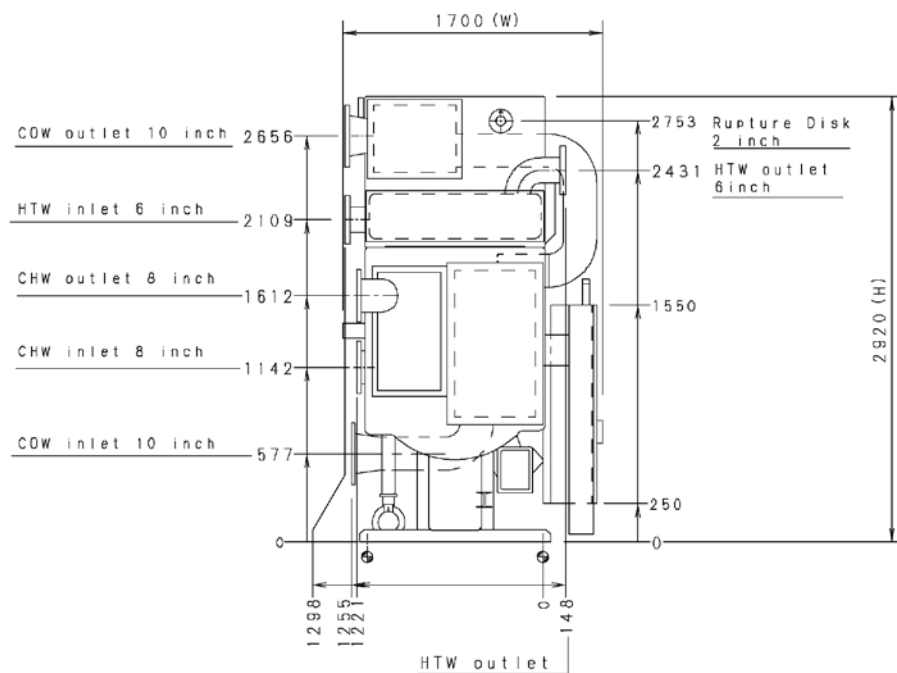

E3 A2 C1
Compact panel

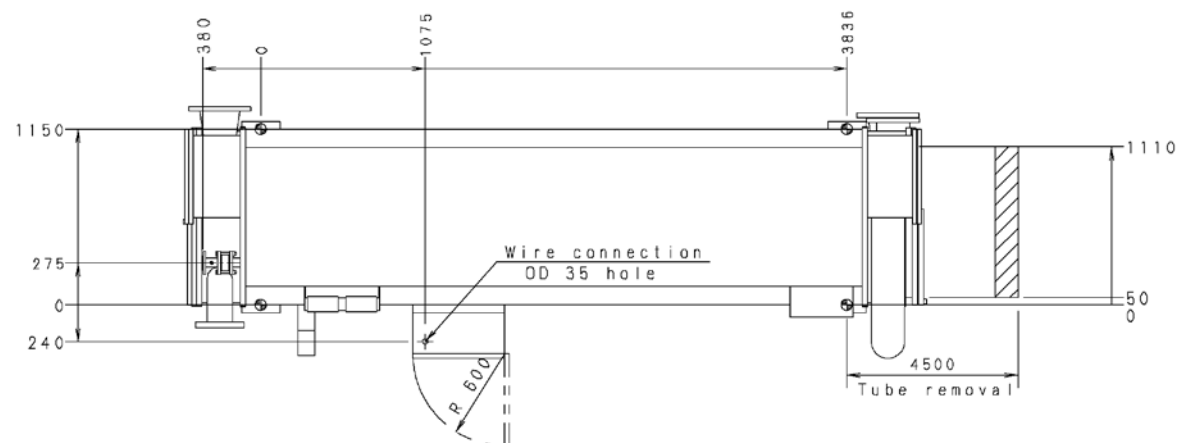

DIMENSIONS

16LJ-41P

LJ-006-461-00-4

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузка в транспортную компанию

Технические данные файла

Документ: Схема Carrier 16LJ/16LJ-F, абсорбционные чиллеры: габаритный чертёж LJ-006-461-00-4, 07.2014

Идентификатор библиотеки: LIB-003965

Исходный файл: carrier-lj-006-461-00-4-07-2014-shema.pdf

SHA-256 оригинала: 2ef63baa83f800844fb1b2e8e9807bb219c0340da140b4e34fe5f8c12a5230c7

Постоянная ссылка: <https://iclim.ru/library/carrier-lj-006-461-00-4-07-2014-shema.pdf>

Копия сформирована: 03.10.2026 21:06 UTC