

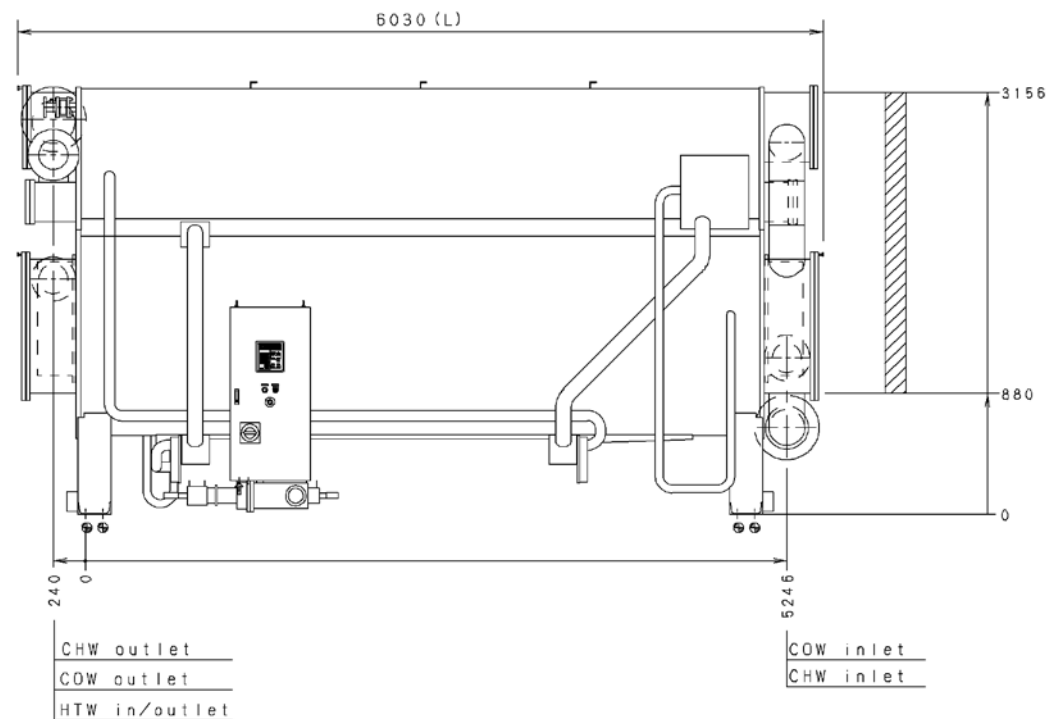


NOTE

- (1) DIMENSIONS (L), (W), (H), ARE FOR STANDARD MACHINE.
THE DIMENSIONS ARE CHANGED BY PARTS ADDED.
- (2)  INDICATES THE POSITION OF ANCHOR BOLTS.
- (3) CLEARANCE SPACE MUST BE SAVED EITHER SIDE OF THE CHILLER.
- (4) MATING FLANGES OF ALL EXTERNAL WATER PIPING ARE PROVIDED WELDED ANSI FLANGES WITH CHILLER.
CHW, COW: ANSI 150LB HTW: ANSI 300LB
- (5)  INDICATES THE POSITION OF THE POWER SUPPLY CONNECTION ON CONTROL PANEL. (DIA. 35MM)
- (6) INSTALLATION CLEARANCE
· LONGITUDINAL DISTANCE: 1000mm
· TOP : 200mm
· OTHERS: 500mm

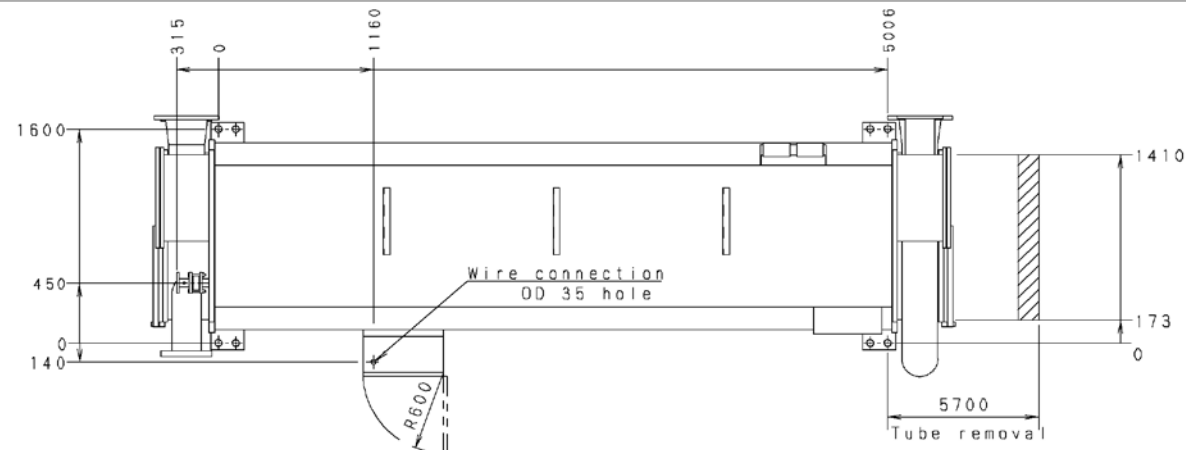

E3, A2, C1
Compact panel

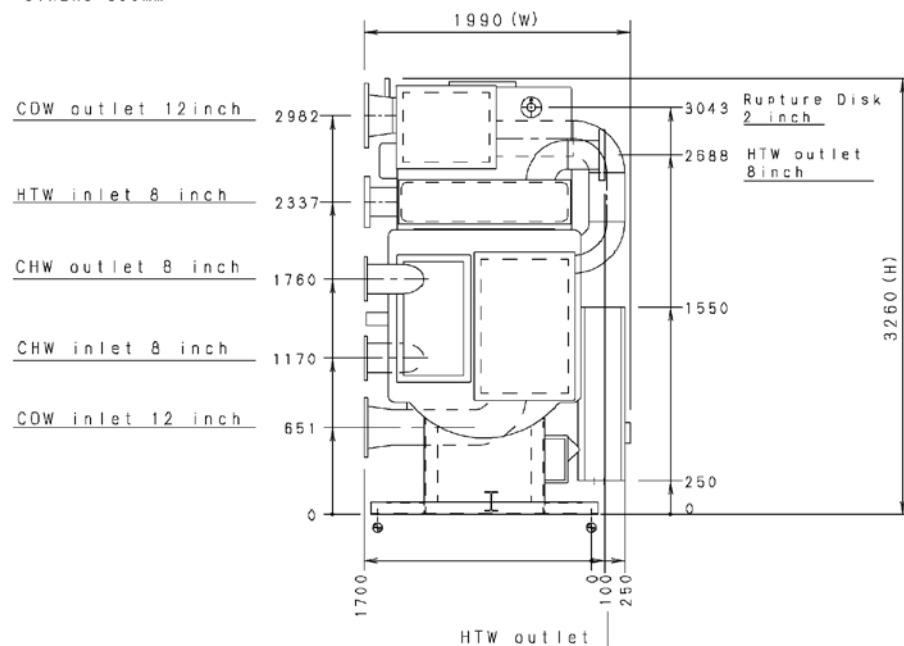

DIMENSIONS

16LJ-53P

LJ-006-465-00-4

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузка в транспортную компанию

Технические данные файла

Документ: Схема Carrier 16LJ/16LJ-F, абсорбционные чиллеры: габаритный чертёж LJ-006-465-00-4, 07.2014

Идентификатор библиотеки: LIB-003961

Исходный файл: carrier-lj-006-465-00-4-07-2014-shema.pdf

SHA-256 оригинала: 170e8eff2f75ced56f659426fd7ddbe6a3f0afbc691c57aafaeff68ebb85a575

Постоянная ссылка: <https://iclim.ru/library/carrier-lj-006-465-00-4-07-2014-shema.pdf>

Копия сформирована: 03.10.2026 10:36 UTC