

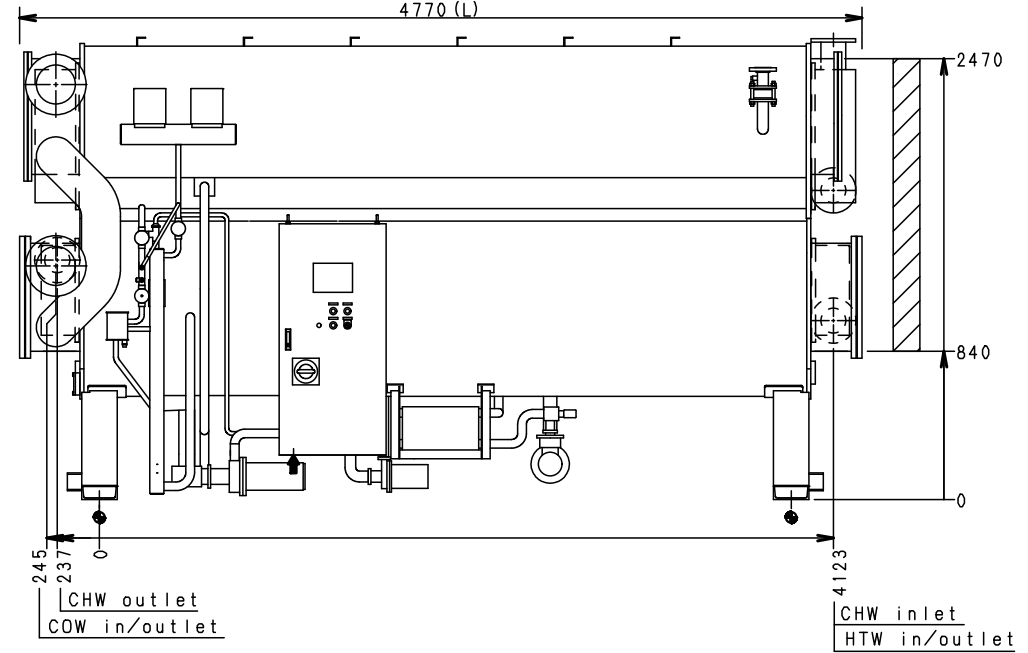


# NOTE

- (1) DIMENSIONS (L), (W), (H), ARE FOR STANDARD MACHINE.  
THE DIMENSIONS ARE CHANGED BY PARTS ADDED.
- (2) ● INDICATES THE POSITION OF ANCHOR BOLTS.
- (3) CLEARANCE SPACE MUST BE SAVED EITHER SIDE OF THE CHILLER
- (4) CONNECTING FLANGE OF ALL EXTERNAL WATER PIPING ARE  
DIN 10 FLANGE.
- (5) ⬆ INDICATES THE POSITION OF THE POWER SUPPLY  
CONNECTION ON CONTROL PANEL. (DIA. 35 MM)
- (6) INSTALLATION CLEARANCE  
·LONGITUDINAL DISTANCE:1000 MM  
·TOP :200 MM  
·OTHERS:500 MM

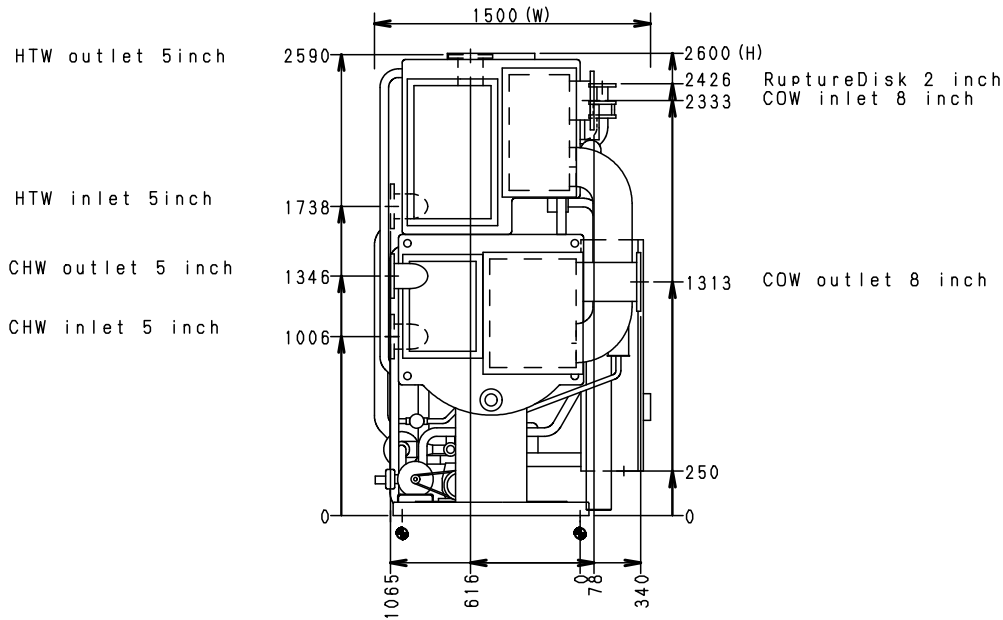

E3 A2 C2 G6

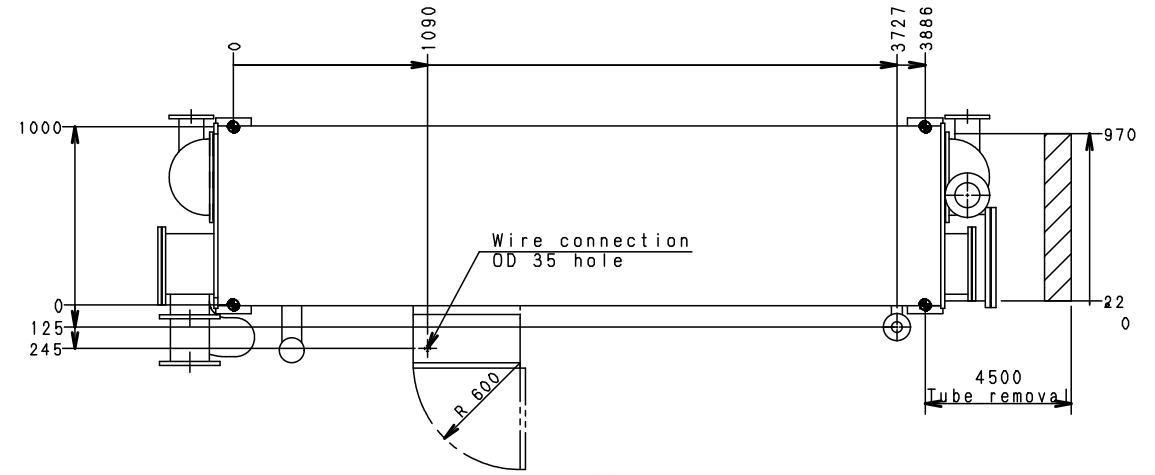

## DIMENSIONS

16LJ-A23/24

LJF-006-104-00-0

## Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

**9600+**

объектов и поставок

**от 1 дня**

отгрузка в транспортную компанию

### Технические данные файла

Документ: Схема Carrier 16LJ/16LJ-F, абсорбционные чиллеры: габаритный чертёж LJF-006-104-00-0, 05.2020

Идентификатор библиотеки: LIB-003998

Исходный файл: carrier-ljf-006-104-00-0-05-2020-shema.pdf

SHA-256 оригинала: accc79f3a30d4ef0f650e41e16c0a3d5758b2d111ea75ad149d5e49bda1e0eee

Постоянная ссылка: <https://iclim.ru/library/carrier-ljf-006-104-00-0-05-2020-shema.pdf>

Копия сформирована: 03.10.2026 10:36 UTC