





Revit Family file

30RB-040R-TO-080R





30RB-040R-TO-080R FAMILY TABLE OPTIONS

Construction	
Opt 116S/116U/116W/116Y	☒
Opt 12	☒
Opt 23	☒
Opt 264	☒
Opt 266	☒
Opt 293	☒
Opt 49	☒
Service Area	☒
Service Area with Buffer Tank	☒
Opt 116R/116T/116V/116X	☒
Opt 307	☒
Standard	☒

30RB-040R-TO-080R (Standard)

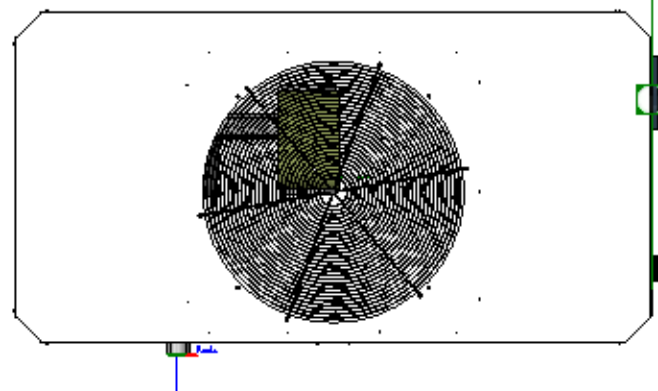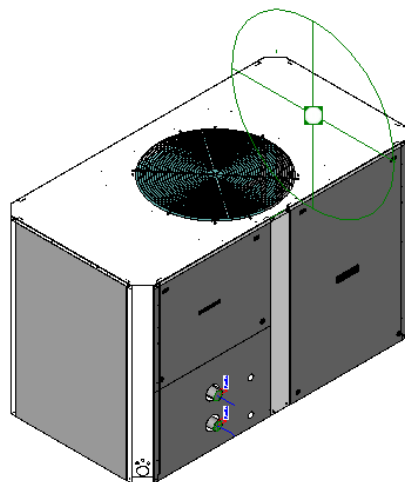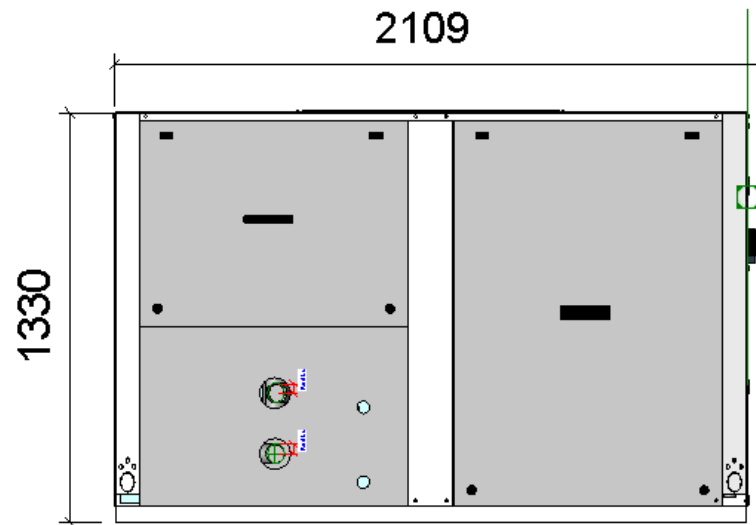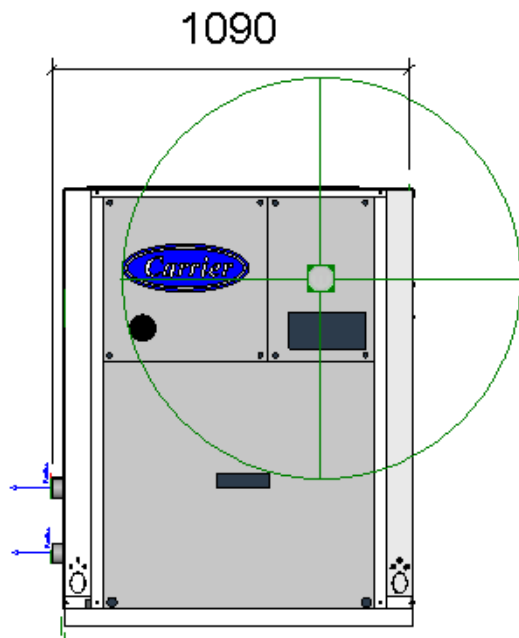


30RB-040R-TO-080R (Standard with Buffer Tank)

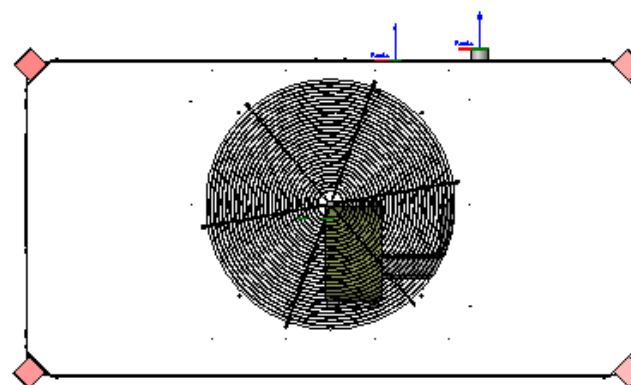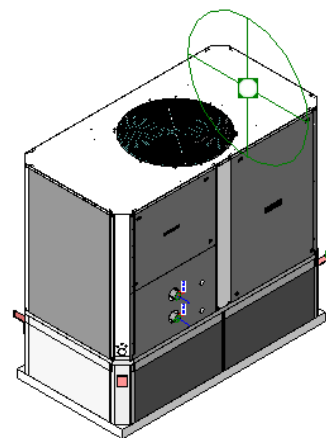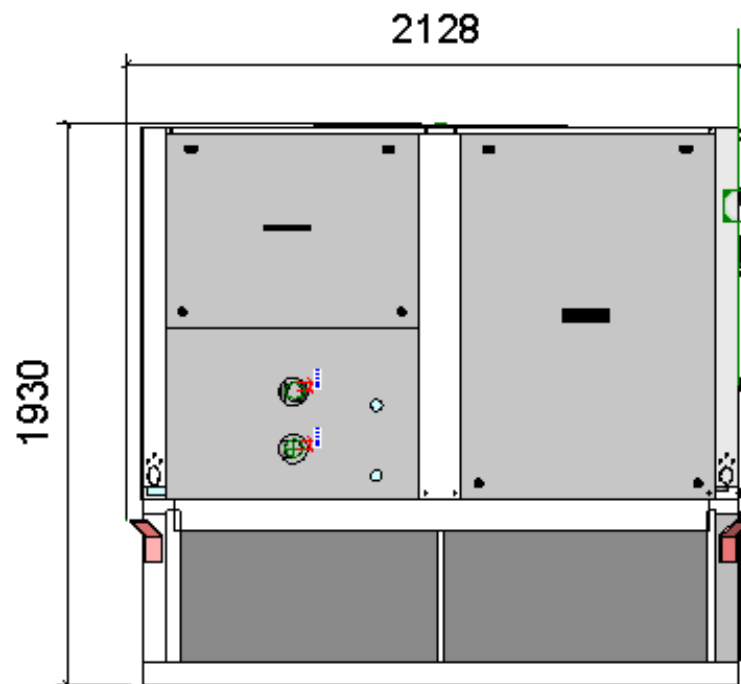
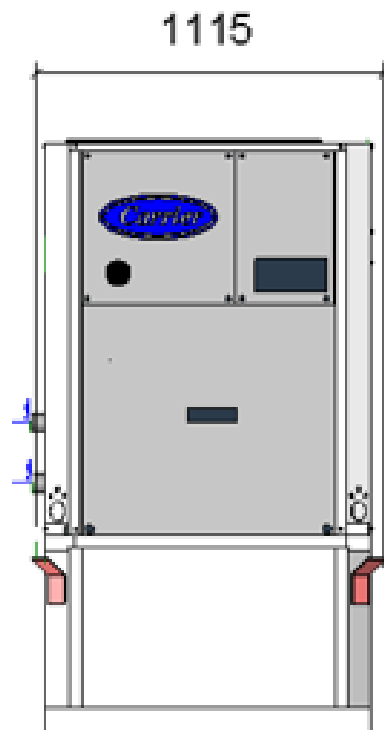


30RB-040R-TO-080R (Buffer Tank)

Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☐
Opt 264	☐
Opt 266	☐
Opt 293	☐
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☒
Standard	☐

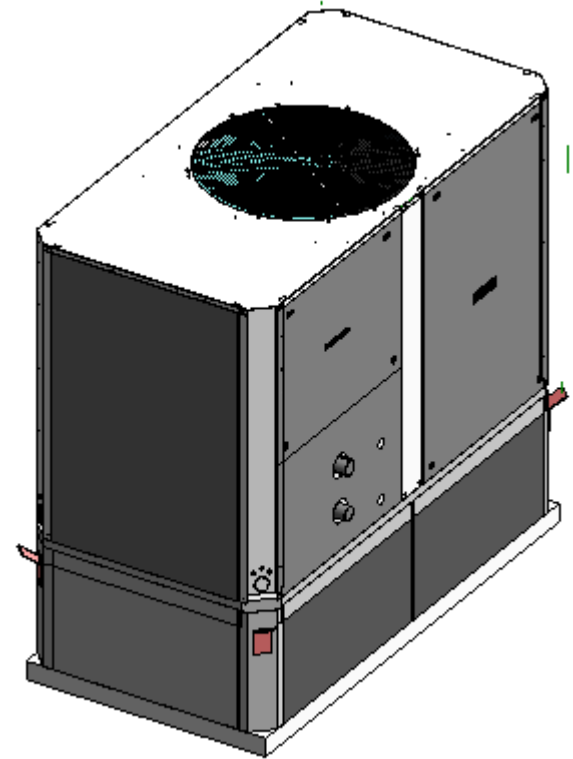

30RB-040R-TO-080R (Unit water connection details)

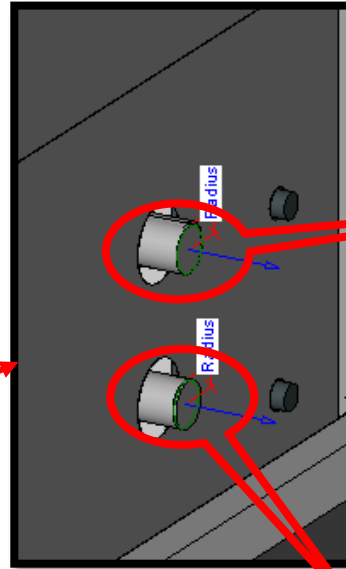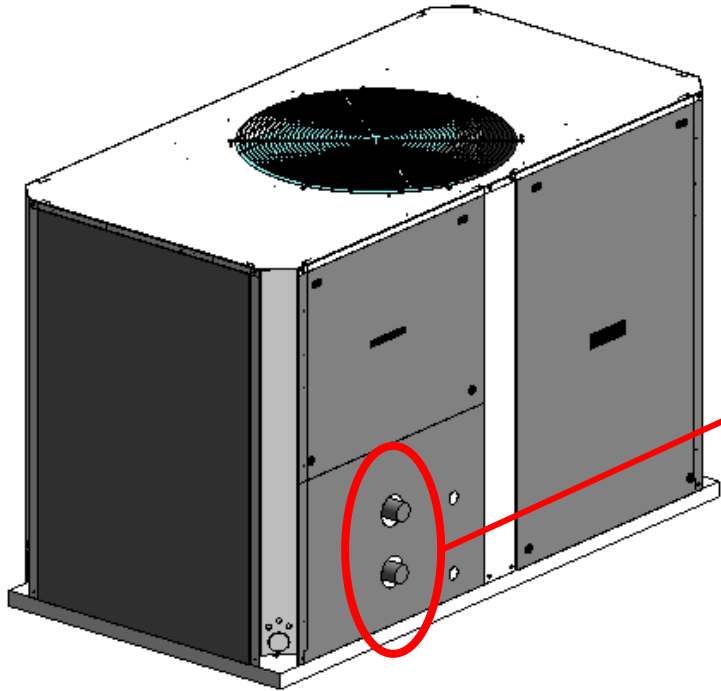

Connector Element (1) Edit Type



Dimensions	
Diameter	60.3
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configur...	Calculated
Flow Direction	Out
Loss Method	Not Defined
Allow Slope Adj...	☐
System Classific...	Domestic Cold ...
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Desc...	OUTLET

Connector Element (1) Edit Type

Dimensions	
Diameter	60.3
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configur...	Calculated
Flow Direction	In
Loss Method	Not Defined
Allow Slope Adj...	☐
System Classific...	Domestic Hot W...
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Desc...	INLET

Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☐
Opt 264	☐
Opt 266	☐
Opt 293	☐
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☐
Standard	☒

30RB-040R-TO-080R (Desuperheater water connection details)

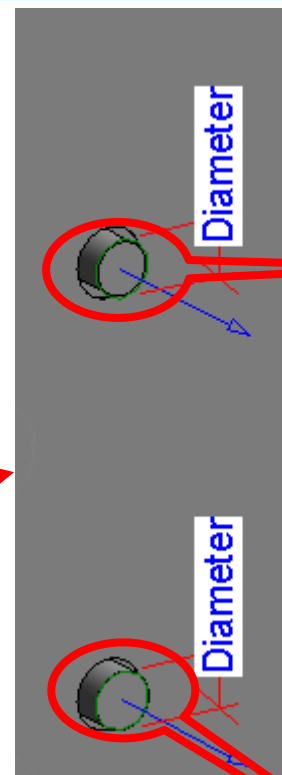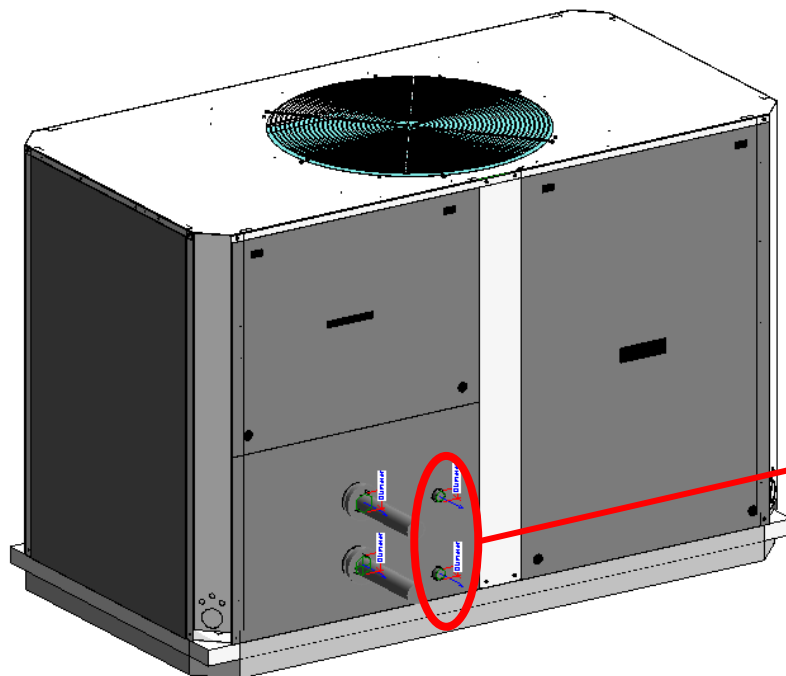


Connector Element (1) Edit Type	
Dimensions	
Diameter	33.2
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configuration	Calculated
Flow Direction	Out
Loss Method	Not Defined
Allow Slope Adjustments	☐
System Classification	Domestic Hot Water
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Description	OUTLET

Connector Element (1) Edit Type	
Dimensions	
Diameter	33.2
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configuration	Calculated
Flow Direction	In
Loss Method	Not Defined
Allow Slope Adjustments	☐
System Classification	Domestic Cold Water
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Description	INLET


Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☐
Opt 264	☐
Opt 266	☐
Opt 293	☐
Opt 49	☒
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☐
Standard	☐

30RB-040R-TO-080R (Grilles)

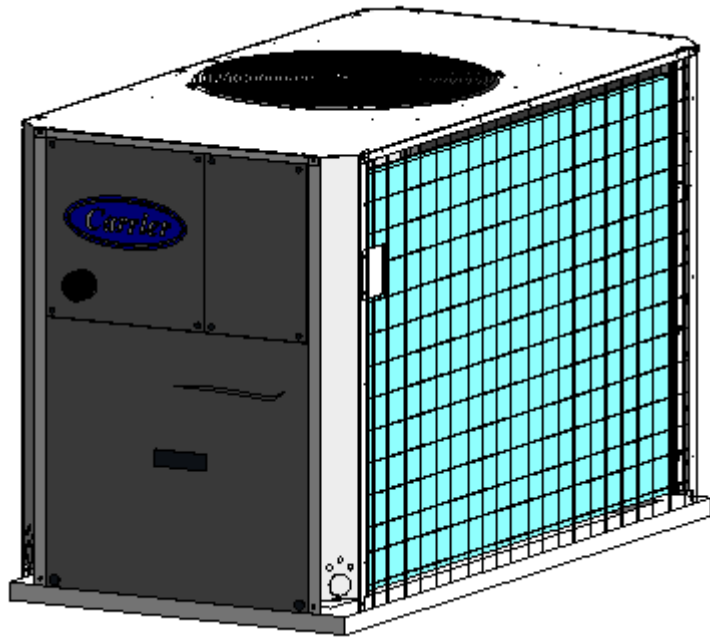


Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☒
Opt 264	☐
Opt 266	☐
Opt 293	☐
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☐
Standard	☒

30RB-040R-TO-080R (Single Pump Hydronic)

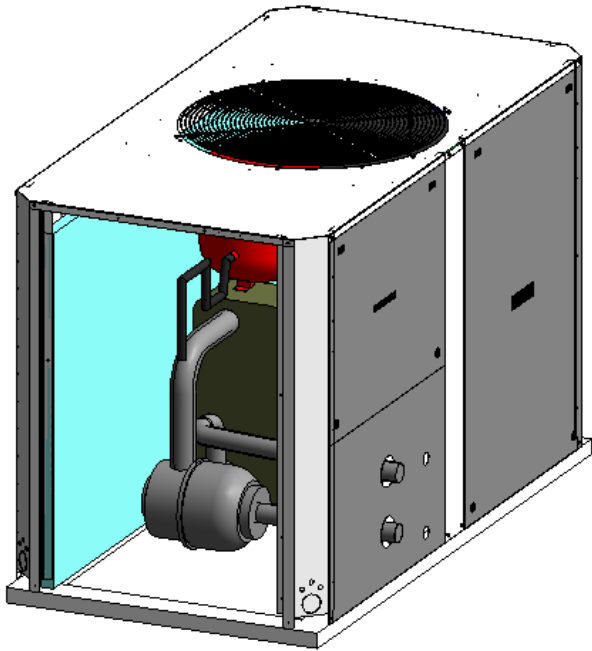

Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☐
Opt 264	☐
Opt 266	☐
Opt 293	☒
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☒
Opt 307	☐
Standard	☒


30RB-040R-TO-080R (Dual Pump Hydraulic)

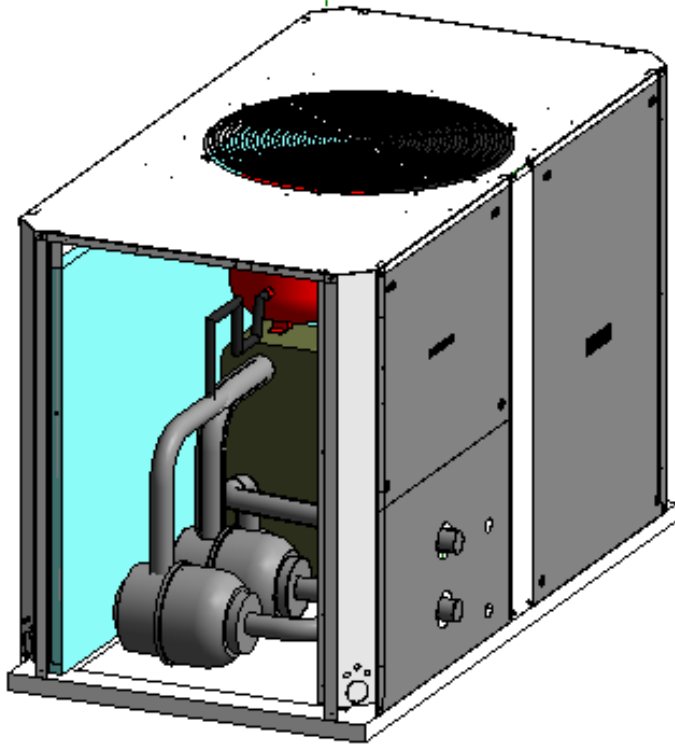


Construction

Opt 116S/116U/116W/116Y	☒
Opt 12	☐
Opt 23	☐
Opt 264	☐
Opt 266	☐
Opt 293	☒
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☐
Standard	☒

30RB-040R-TO-080R (Desuperheater)

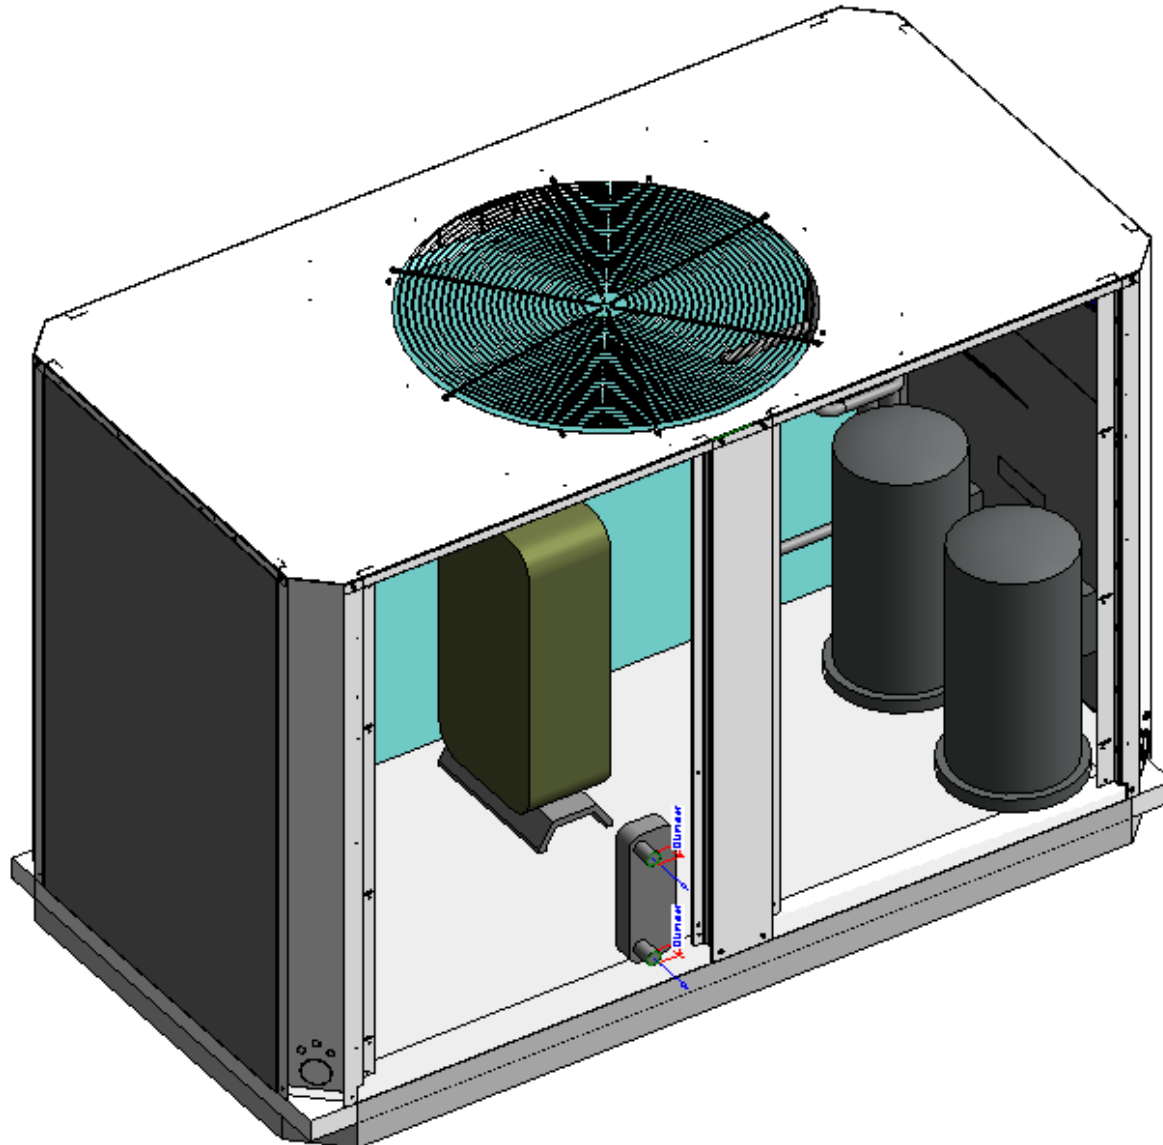


30RB-040R-TO-080R (Option 264)

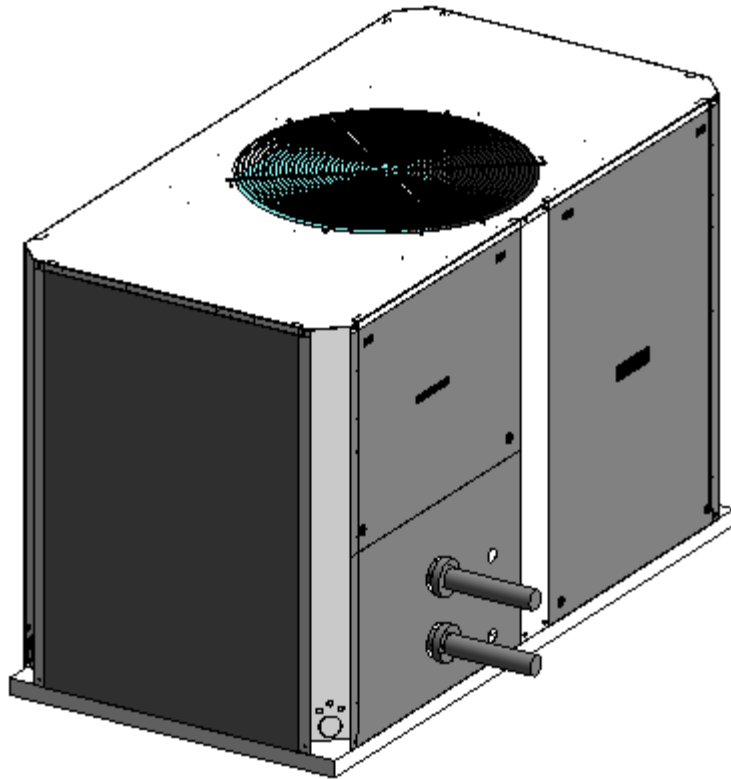


Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☐
Opt 264	☒
Opt 266	☐
Opt 293	☐
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☐
Standard	☒

30RB-040R-TO-080R (Option 266)

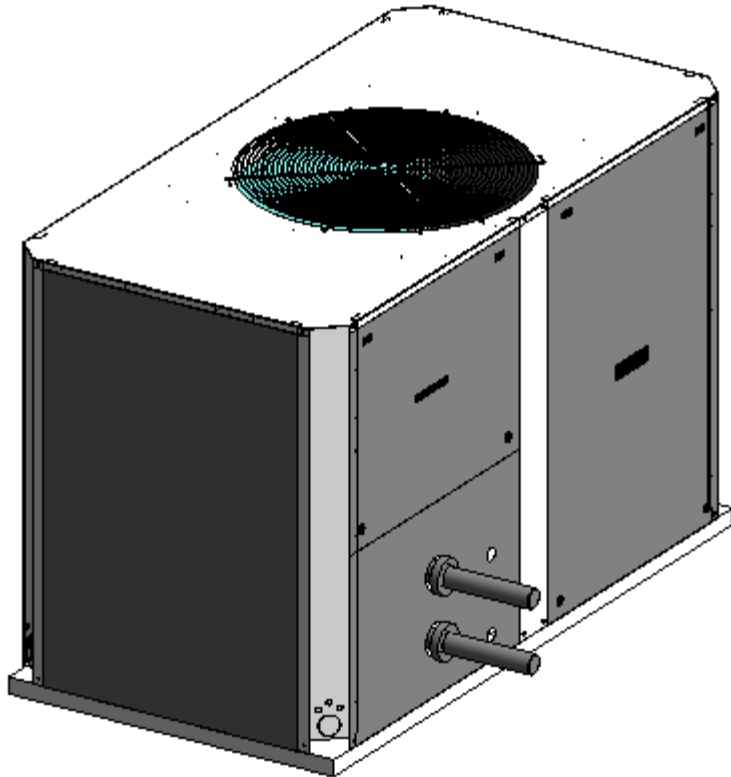

Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☐
Opt 264	☐
Opt 266	☒
Opt 293	☐
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☐
Standard	☒

30RB-040R-TO-080R (Option 12)


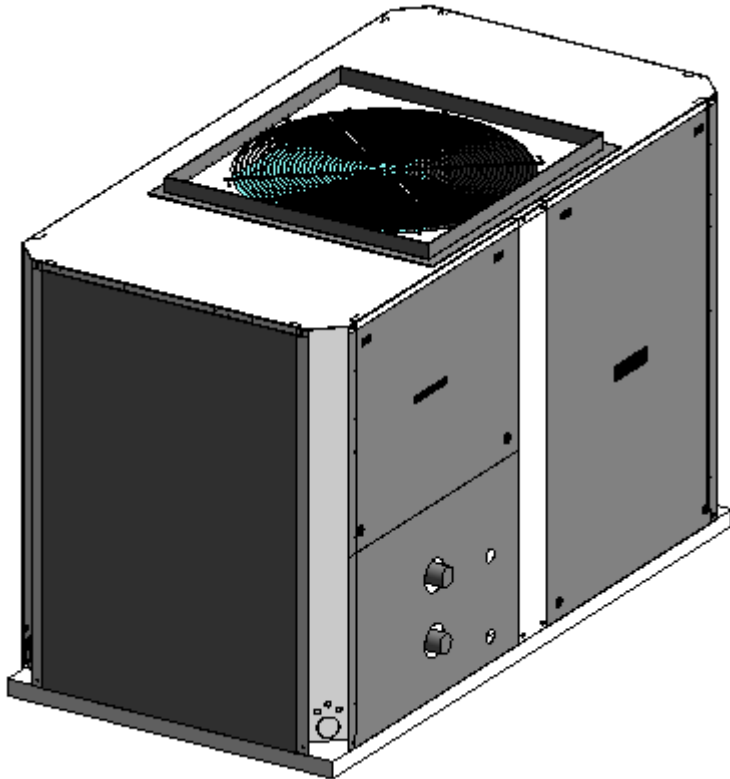


Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☒
Opt 23	☐
Opt 264	☐
Opt 266	☐
Opt 293	☐
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☐
Standard	☒

30RB-040R-TO-080R (Service Area)

Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☐
Opt 264	☐
Opt 266	☐
Opt 293	☐
Opt 49	☐
Service Area	☒
Service Area with Buffer Tank	☐
Opt 116R/116T/116V/116X	☐
Opt 307	☐
Standard	☒

Construction	
Opt 116S/116U/116W/116Y	☐
Opt 12	☐
Opt 23	☐
Opt 264	☐
Opt 266	☐
Opt 293	☐
Opt 49	☐
Service Area	☐
Service Area with Buffer Tank	☒
Opt 116R/116T/116V/116X	☐
Opt 307	☒
Standard	☐

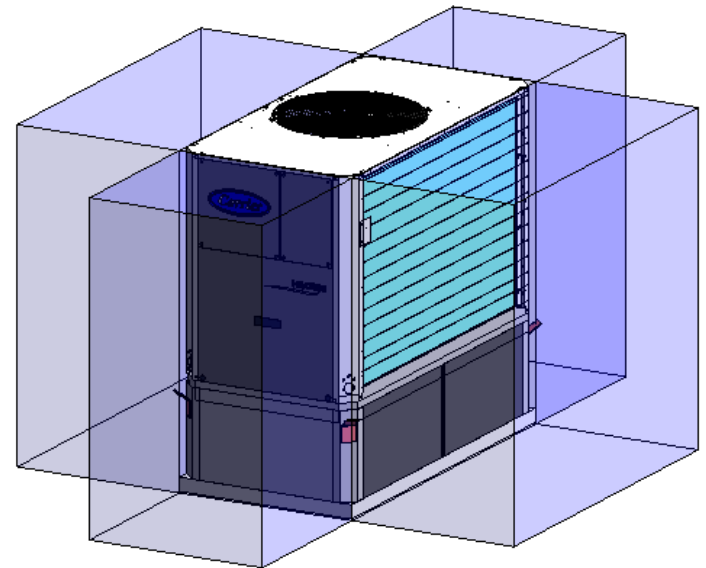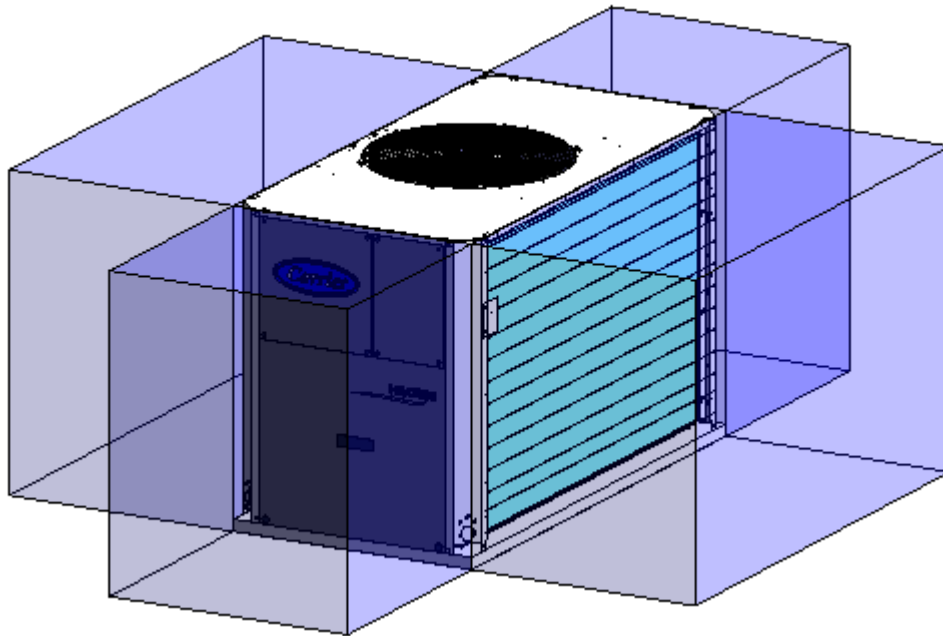

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузка в транспортную компанию

Технические данные файла

Документ: Схема Carrier 30RB 040R-160R, чиллеры с воздушным охлаждением: BIM-модель Revit 30RB 040R-080R, 06.2021

Идентификатор библиотеки: LIB-004065

Исходный файл: carrier-revit-06-2021-30rb-040r-to-080r-06-21-shema.pdf

SHA-256 оригинала: 9bebf55ec12a0e58dd68b6eb1bad524ffd24c1da6edc3cea4a6bdc1b79ca1166

Постоянная ссылка: <https://iclim.ru/library/carrier-revit-06-2021-30rb-040r-to-080r-06-21-shema.pdf>

Копия сформирована: 03.10.2026 18:02 UTC