

Revit Family file

30RB-090R-TO-120R





30RB-090R-TO-120R FAMILY TABLE OPTIONS

Family Types





Type name:	30RB-090R
	30RB-090R
Search param	30RB-100R
	30RB-120R

Parameter	Value
Construction	
Opt 12	☒
Opt 264	☒
Opt 266	☒
Opt 49	☒
Service Area	☒
Opt 307	☒
Standard	☒
Opt 23	☒
Opt 293	☒
Opt 116S/116U/116W/116Y	☒
Opt 116R/116T/116V/116X	☒
Service Area with Buffer tank	☒

30RB-090R-TO-120R (Standard)

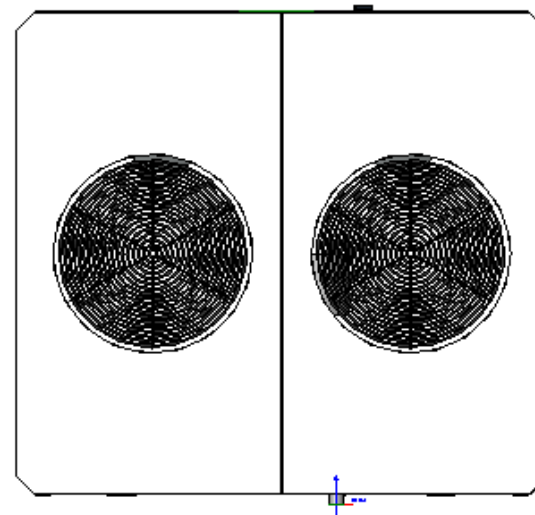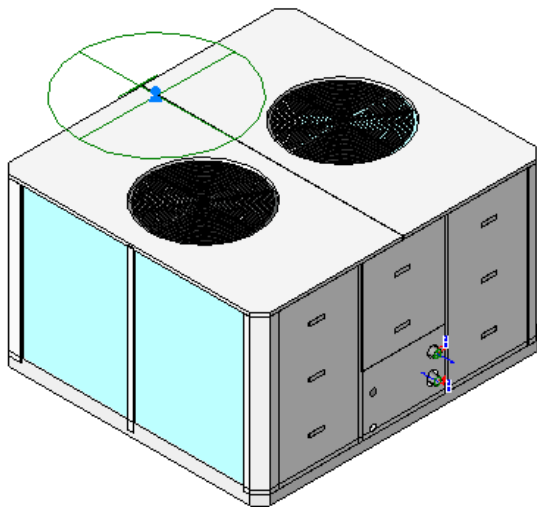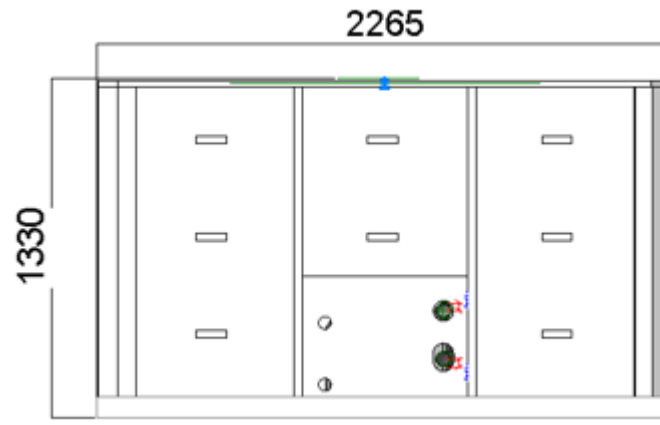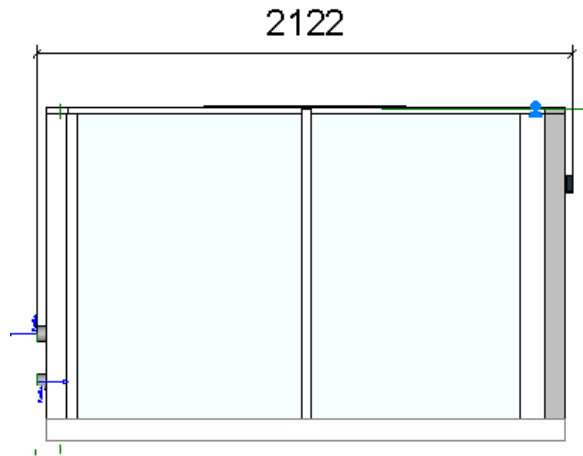


30RB-090R-TO-120R (Standard with Buffer tank)

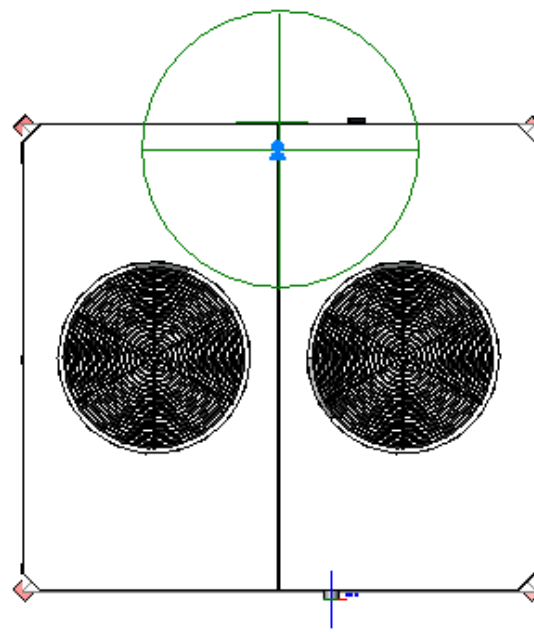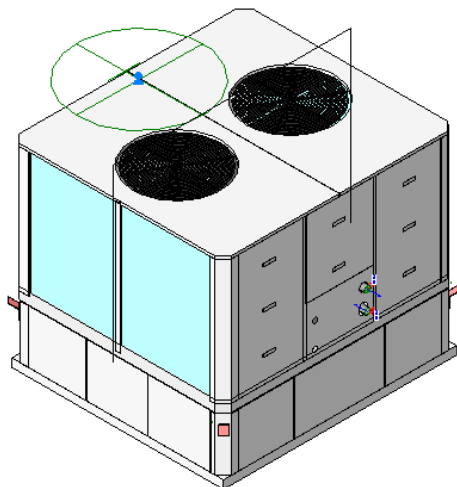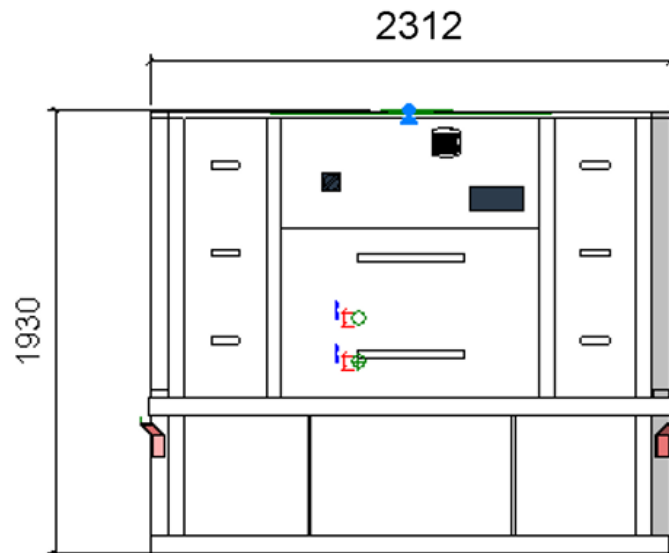
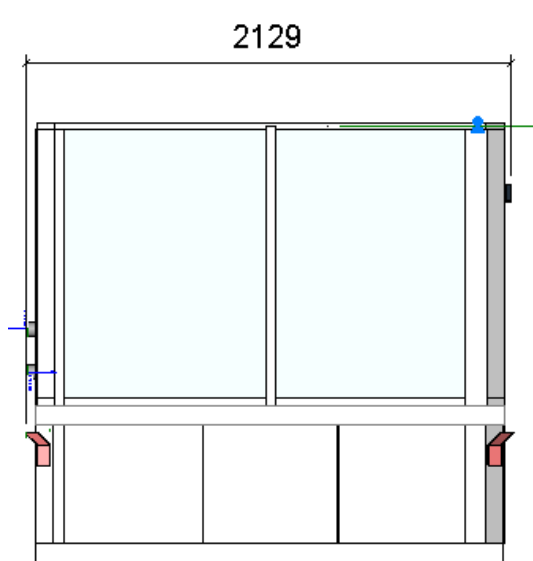


30RB-090R-TO-120R (Buffer tank)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt 49	☐
Service Area	☐
Opt 307	☒
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

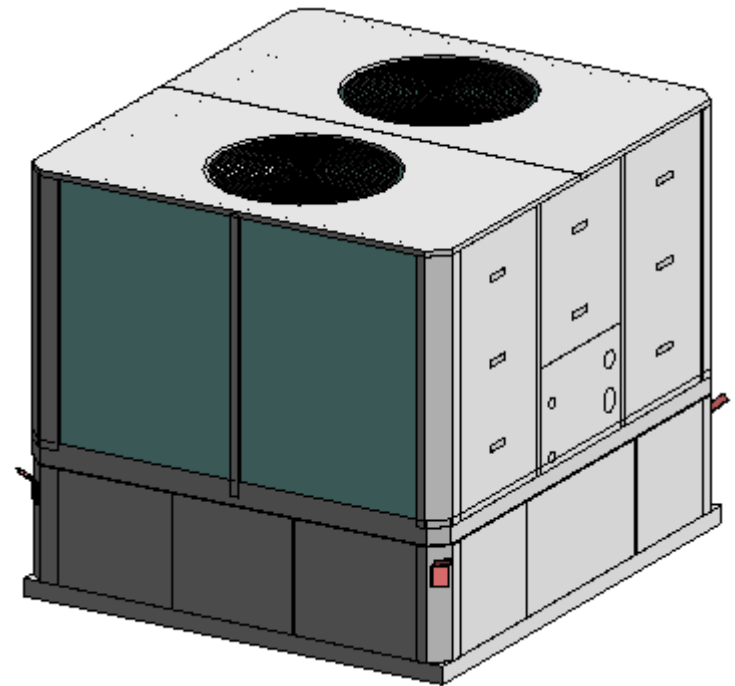

30RB-090R-TO-120R (Unit water connection details)

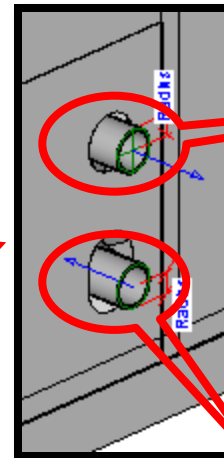
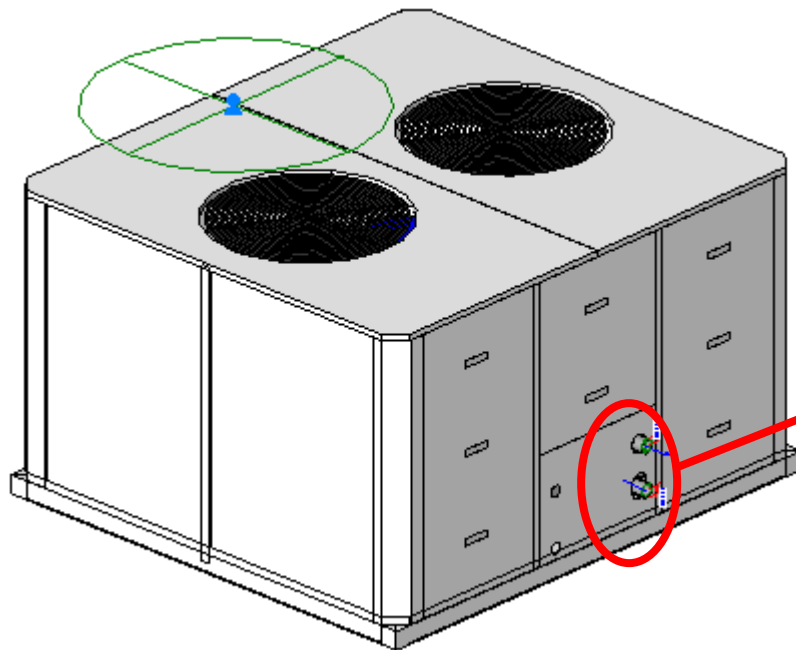


Connector Element (1)	
Dimensions	
Diameter	60.3
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configurat...	Calculated
Flow Direction	Out
Loss Method	Not Defined
Allow Slope Adj...	☐
System Classific...	Domestic Cold ...
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Desc...	OUTLET

Connector Element (1)	
Dimensions	
Diameter	60.3
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configurat...	Calculated
Flow Direction	In
Loss Method	Not Defined
Allow Slope Adj...	☐
System Classific...	Domestic Hot W...
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Desc...	INLET

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt 49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

30RB-090R-TO-120R (Desuperheater water connection details)

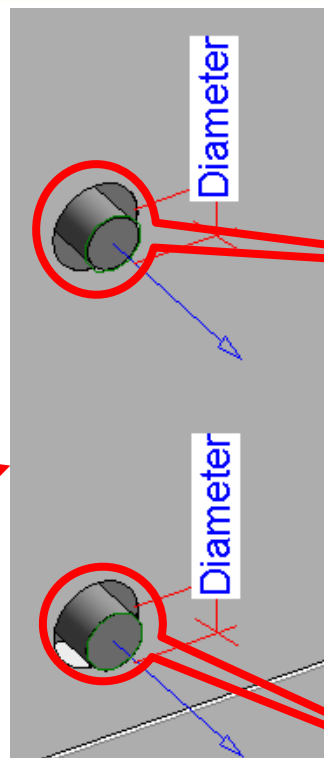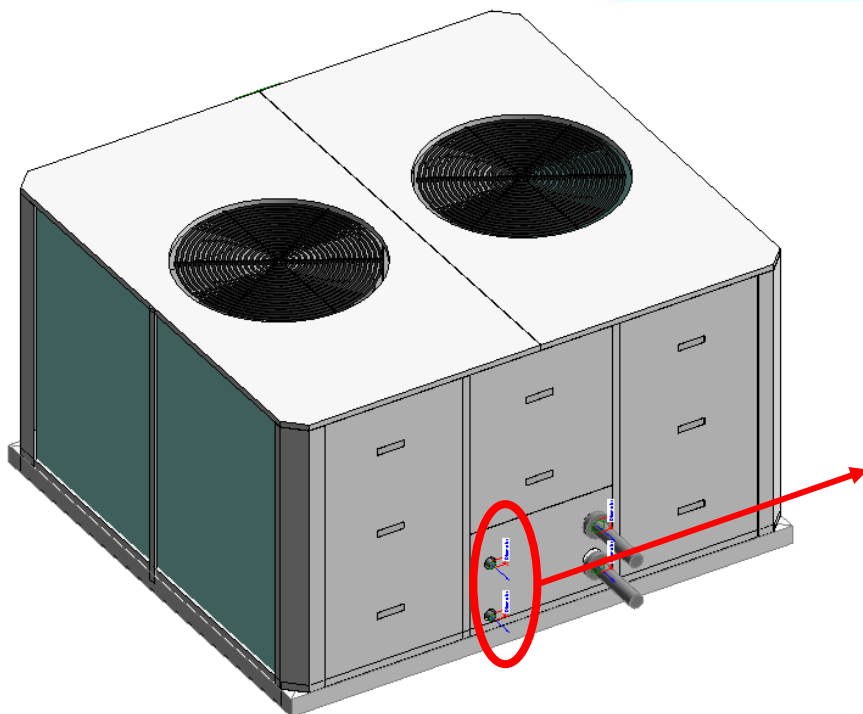


Connector Element (1) Edit Type	
Dimensions	
Diameter	33.2
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configuration	Calculated
Flow Direction	Out
Loss Method	Not Defined
Allow Slope Adjustments	☐
System Classification	Domestic Hot Water
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Description	OUTLET

Connector Element (1) Edit Type	
Dimensions	
Diameter	33.2
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configuration	Calculated
Flow Direction	In
Loss Method	Not Defined
Allow Slope Adjustments	☐
System Classification	Domestic Cold Water
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Description	INLET

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt 49	☒
Service Area	☐
Opt 307	☐
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116V	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐


30RB-090R-TO-120R (Grilles)

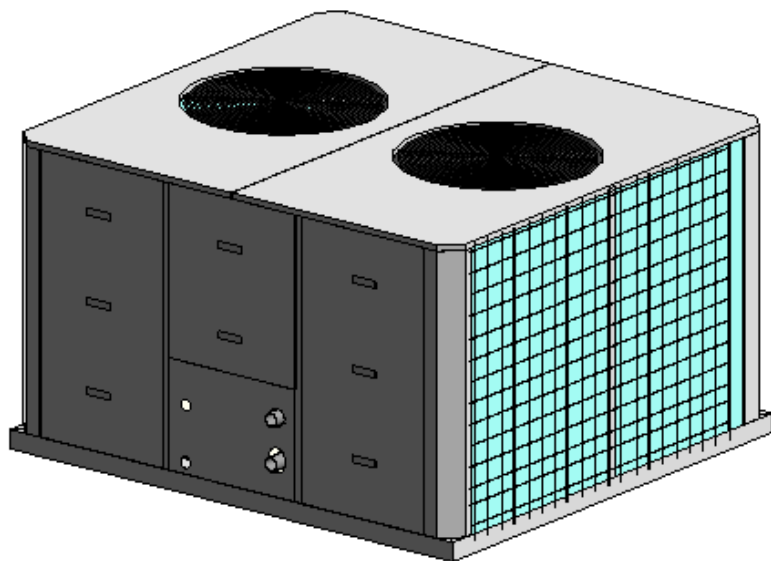

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt 49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☒
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐


30RB-090R-TO-120R (Single Pump Hydronic with Expansion tank)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt 49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☒
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☒
Service Area with Buffer tank	☐

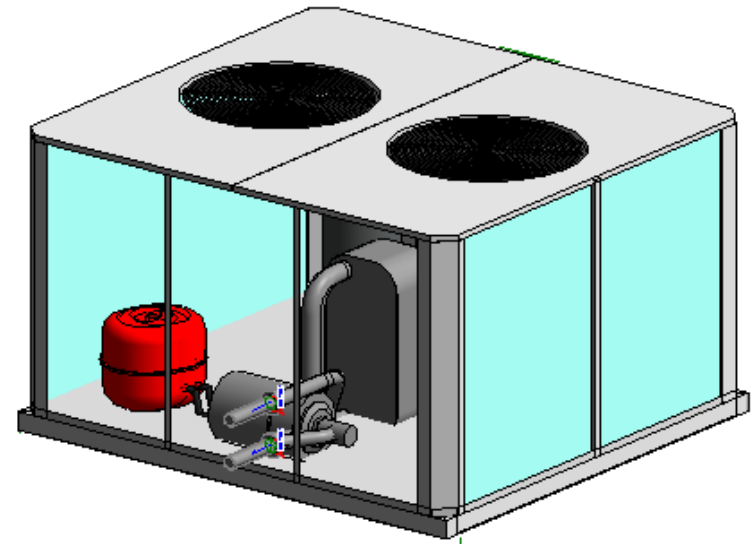


30RB-090R-TO-120R (Double Pump Hydronic with Expansion tank)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt 49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☒
Opt 116S/116U/116W/116V	☒
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

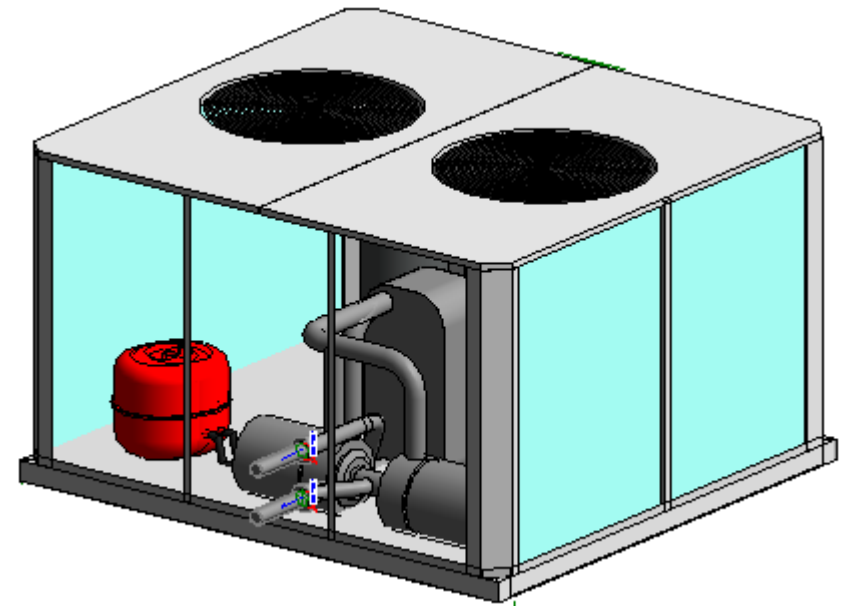


30RB-090R-TO-120R (Desuperheater)

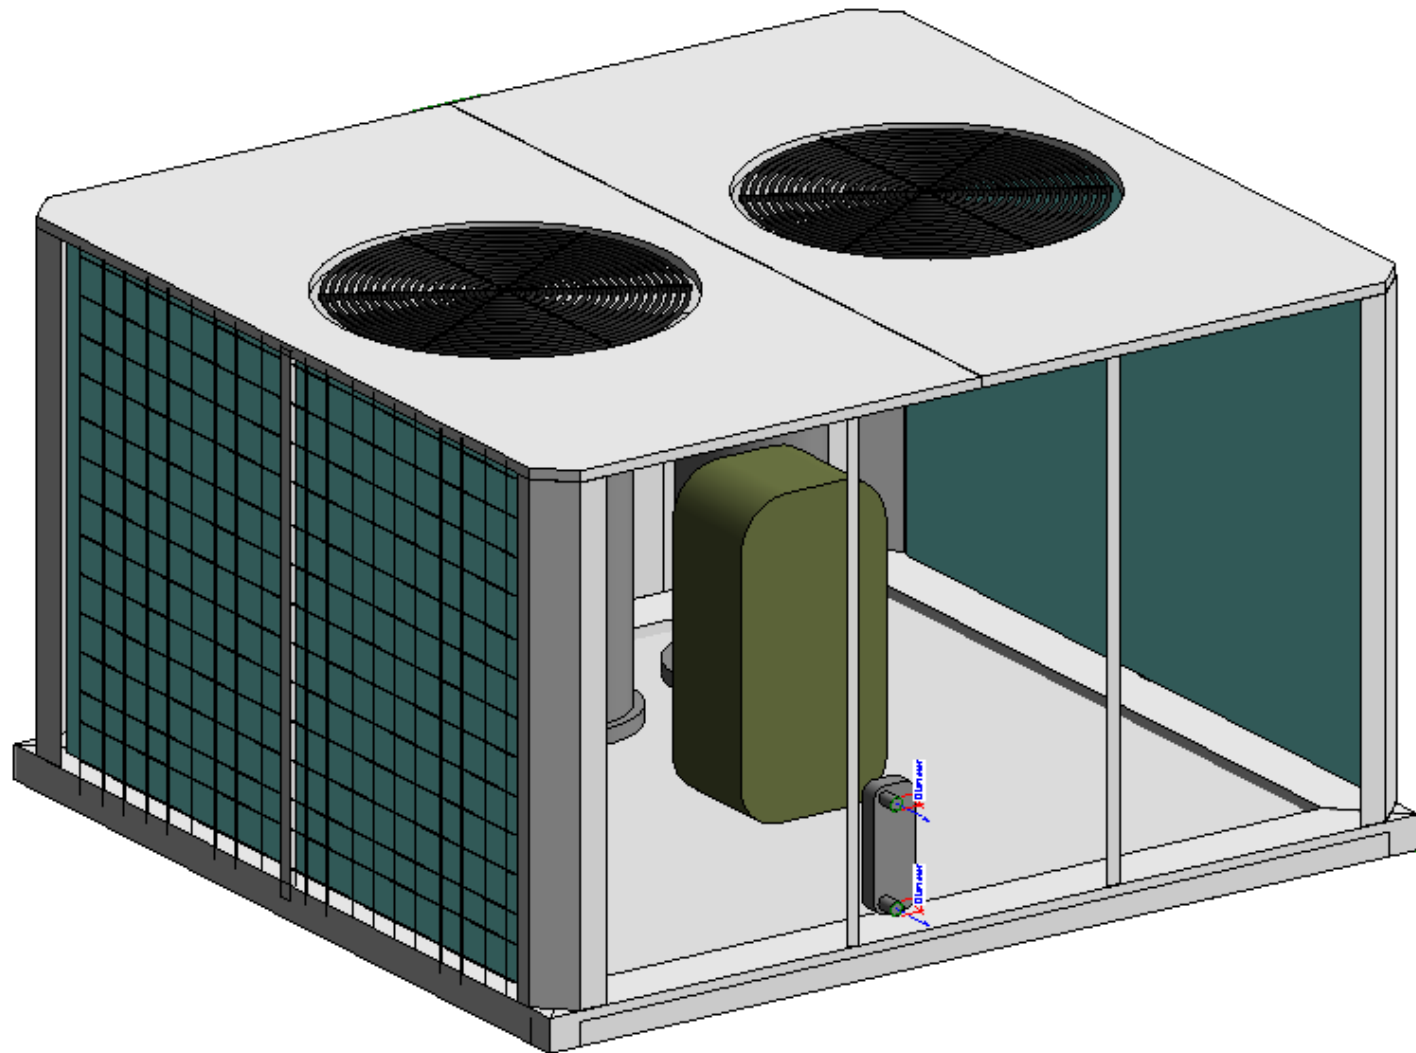


30RB-090R-TO-120R (Option 264)

Construction	
Opt 12	☐
Opt 264	☒
Opt 266	☐
Opt 49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

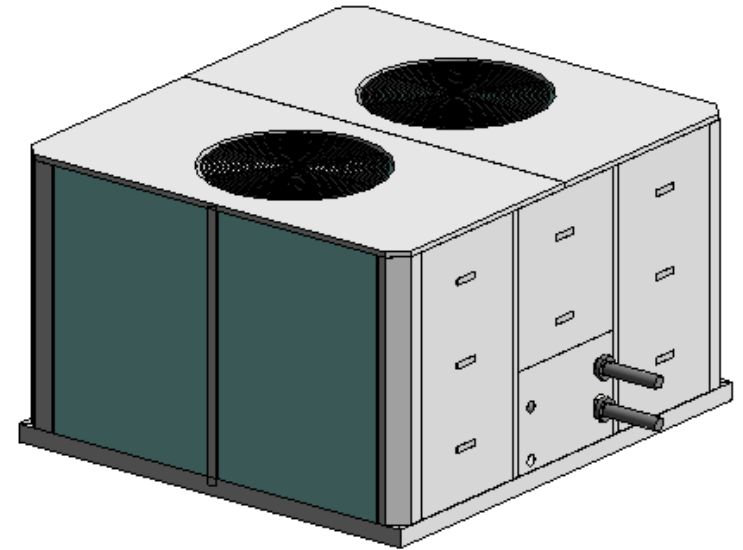


30RB-090R-TO-120R (Option 266)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☒
Opt 49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

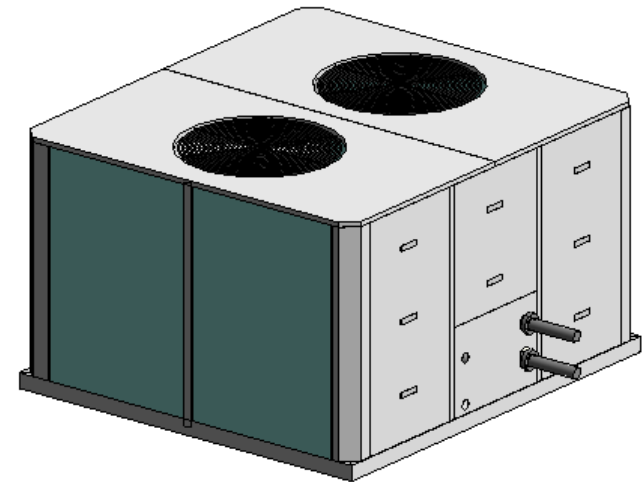


30RB-090R-TO-120R (Option 12)

Construction	
Opt 12	☒
Opt 264	☐
Opt 266	☐
Opt 49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116V	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

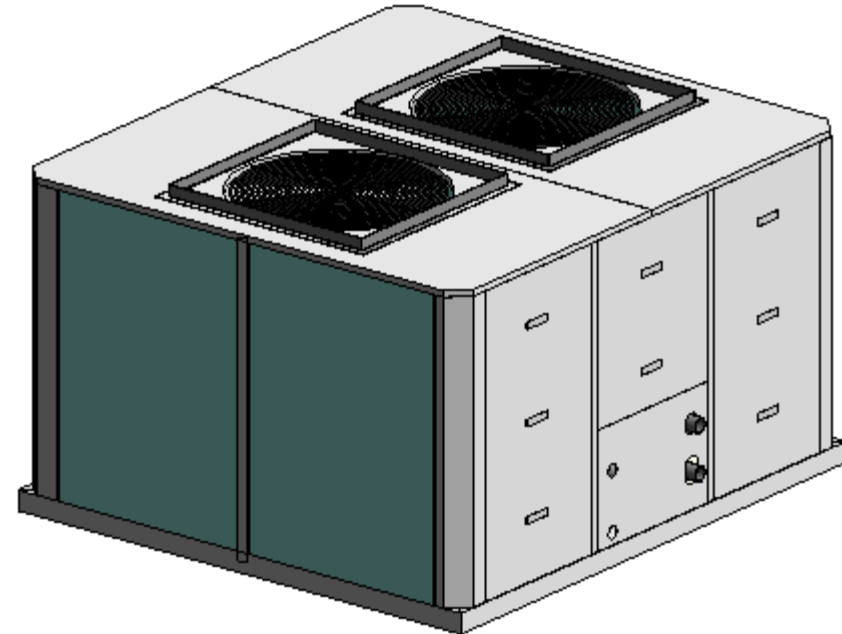


30RB-090R-TO-120R (Service Area)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt 49	☐
Service Area	☒
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

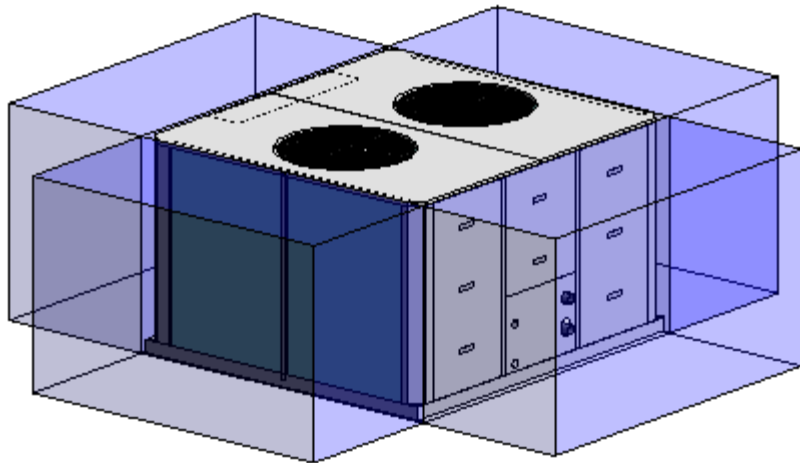

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt 49	☐
Service Area	☐
Opt 307	☒
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☒

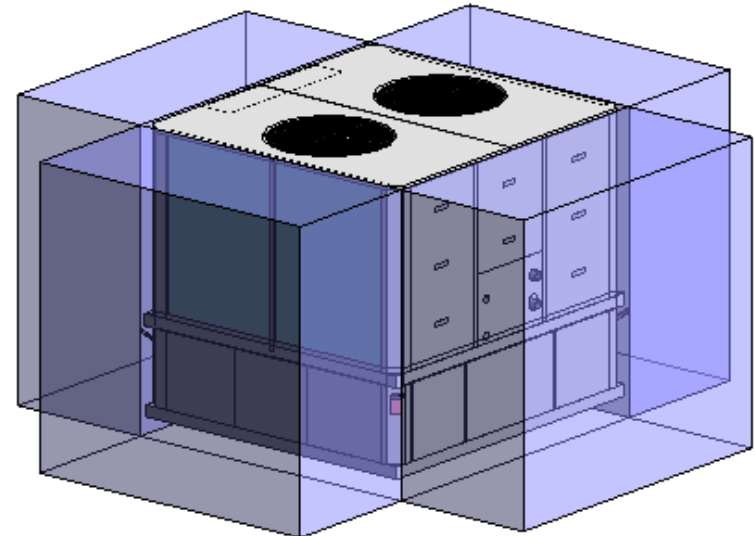

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузки в транспортную компанию

Технические данные файла

Документ: Схема Carrier 30RB 040R-160R, чиллеры с воздушным охлаждением: BIM-модель Revit 30RB 090R-120R, 06.2021

Идентификатор библиотеки: LIB-004067

Исходный файл: carrier-revit-06-2021-30rb-090r-to-120r-06-21-shema.pdf

SHA-256 оригинала: 269bafb9d3f4ffaf20a3d046097809f2a83ff760ec3683d24b778ca4e361c7ac

Постоянная ссылка: <https://iclim.ru/library/carrier-revit-06-2021-30rb-090r-to-120r-06-21-shema.pdf>

Копия сформирована: 03.10.2026 11:25 UTC