

Revit Family file

30RQ-090R-TO-120R

30RQ-090R-TO-120R FAMILY TABLE OPTIONS

Family Types

Type name: 30RQ-090R





30RQ-090R

Search param 30RQ-100R





30RQ-120R

Parameter	Value
Construction	
Opt 12	☒
Opt 264	☒
Opt 266	☒
Opt-49	☒
Service Area	☒
Opt 307	☒
Standard	☒
Opt 23	☒
Opt 293	☒
Opt 116S/116U/116W/116Y	☒
Opt 116R/116T/116V/116X	☒
Service Area with Buffer tank	☒

30RQ-090R-TO-120R (Standard)

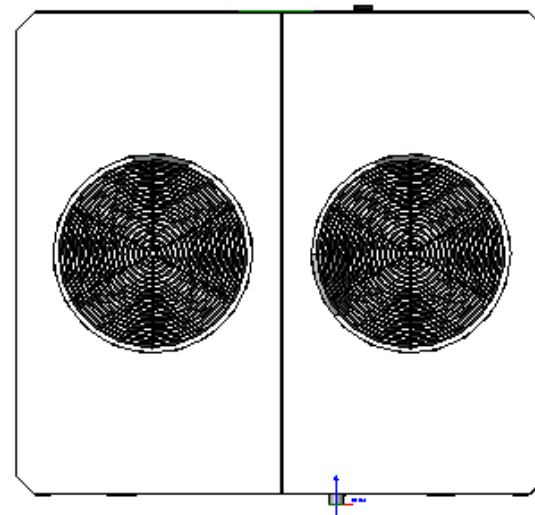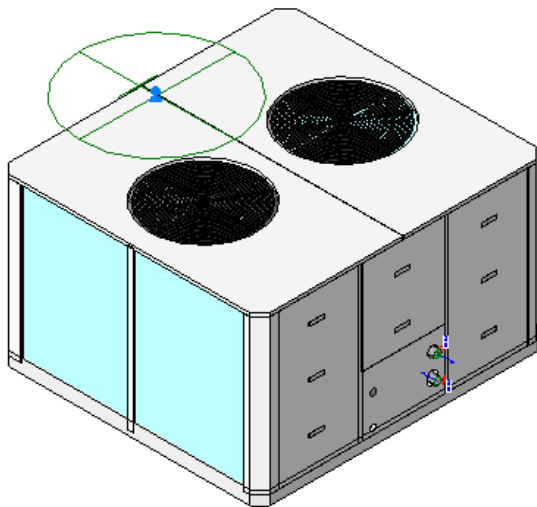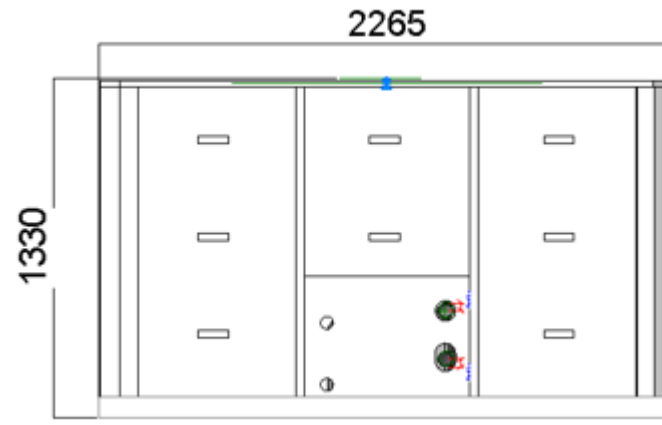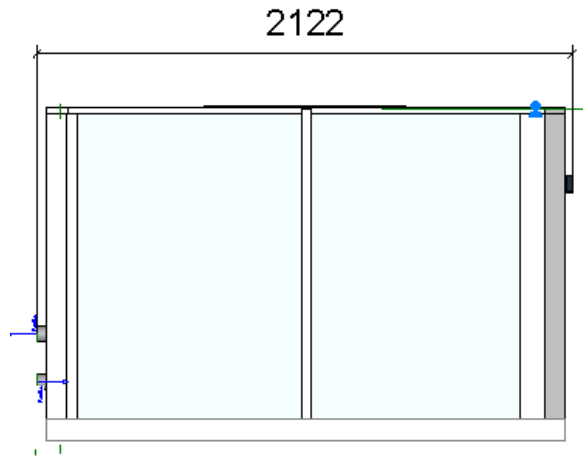


30RQ-090R-TO-120R (Standard with Buffer tank)

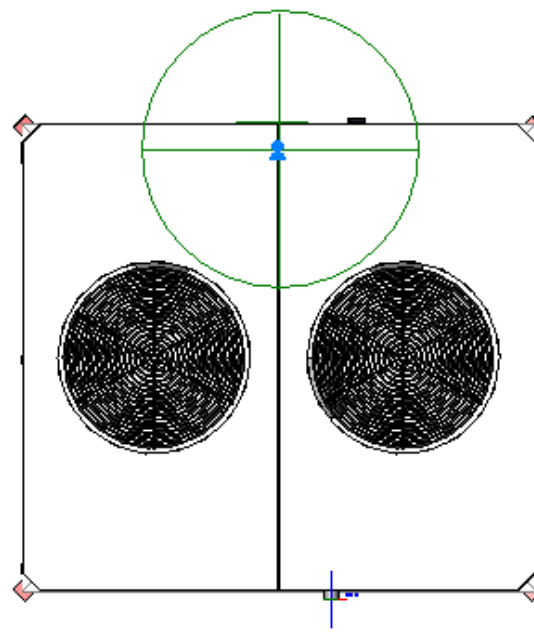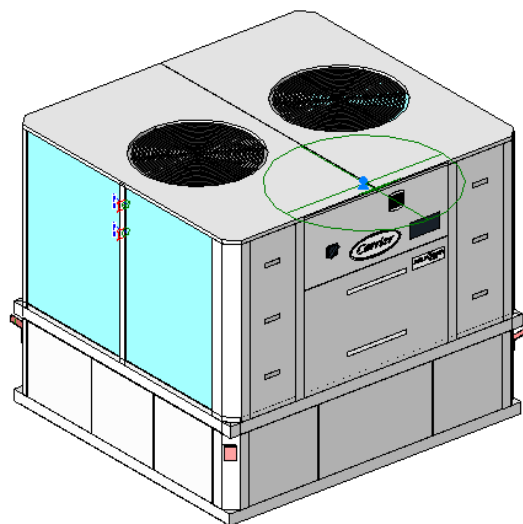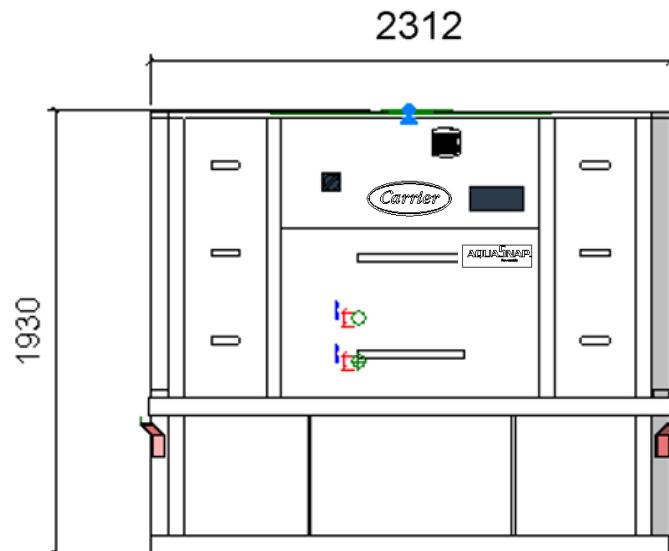
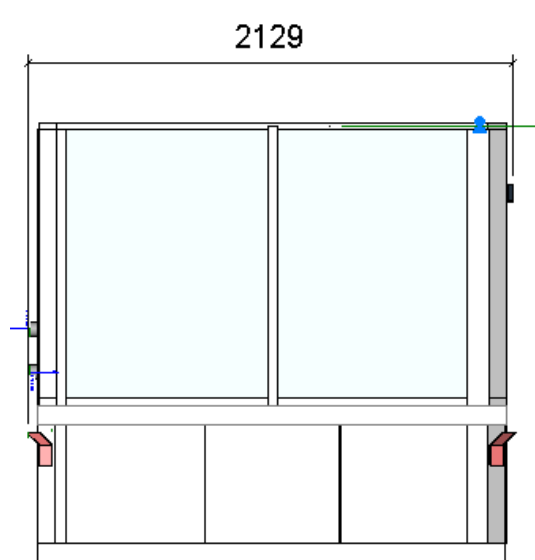


30RQ-090R-TO-120R (Buffer tank)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☒
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

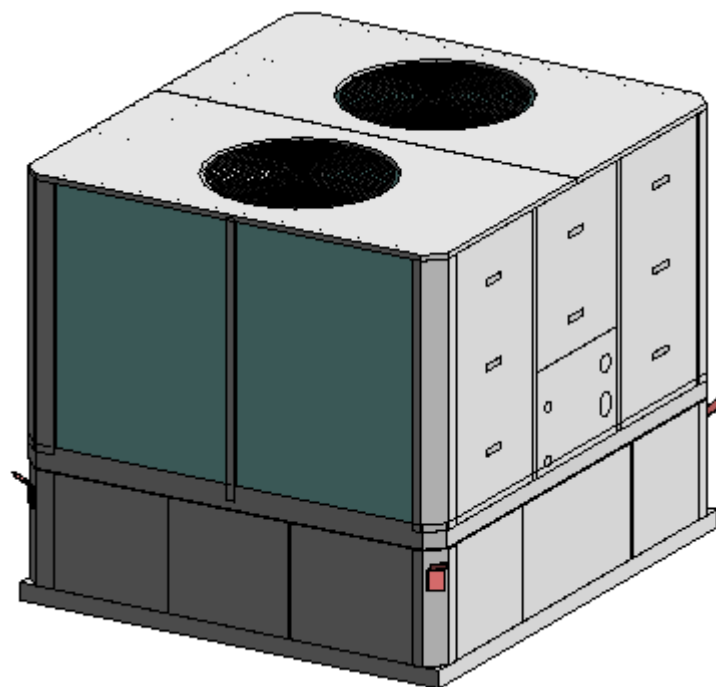

30RQ-090R-TO-120R (Unit Water Connection details)

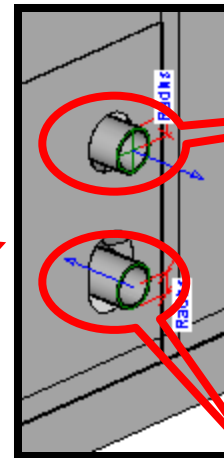
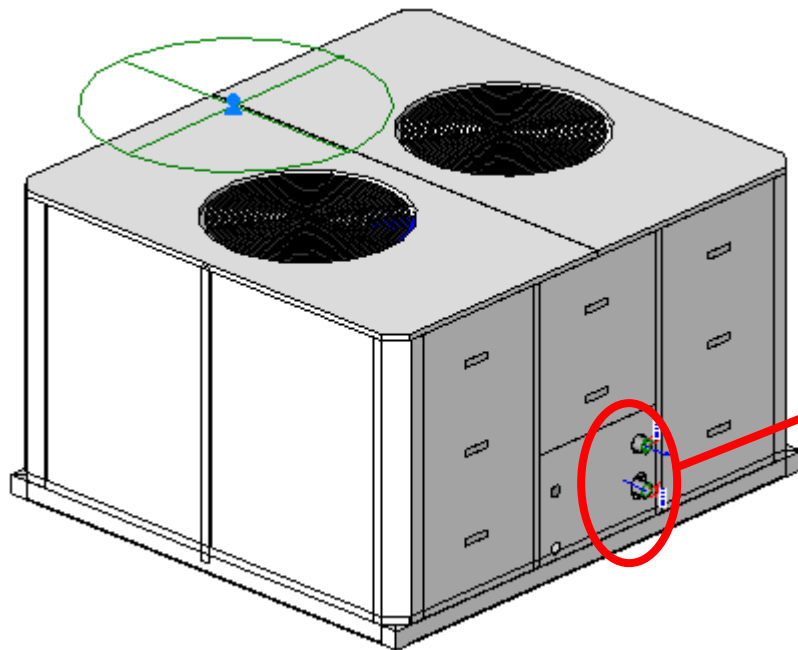


Connector Element (1)	
Dimensions	
Diameter	60.3
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configur...	Calculated
Flow Direction	Out
Loss Method	Not Defined
Allow Slope Adj...	☐
System Classific...	Domestic Cold ...
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Desc...	OUTLET

Connector Element (1)	
Dimensions	
Diameter	60.3
Mechanical	
K Coefficient	0.000000
Flow Factor	0.000000
Flow Configur...	Calculated
Flow Direction	In
Loss Method	Not Defined
Allow Slope Adj...	☐
System Classific...	Domestic Hot W...
Mechanical - Flow	
Fixture Units	0.000000
Flow	0.00 L/s
Pressure Drop	0.00 Pa
Identity Data	
Utility	☐
Connector Desc...	INLET

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116V	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

30RQ-090R-TO-120R (Desuperheater Water Connection details)

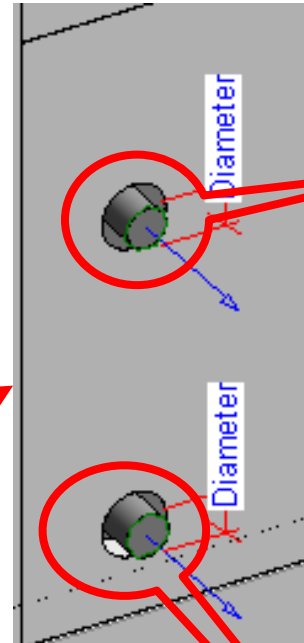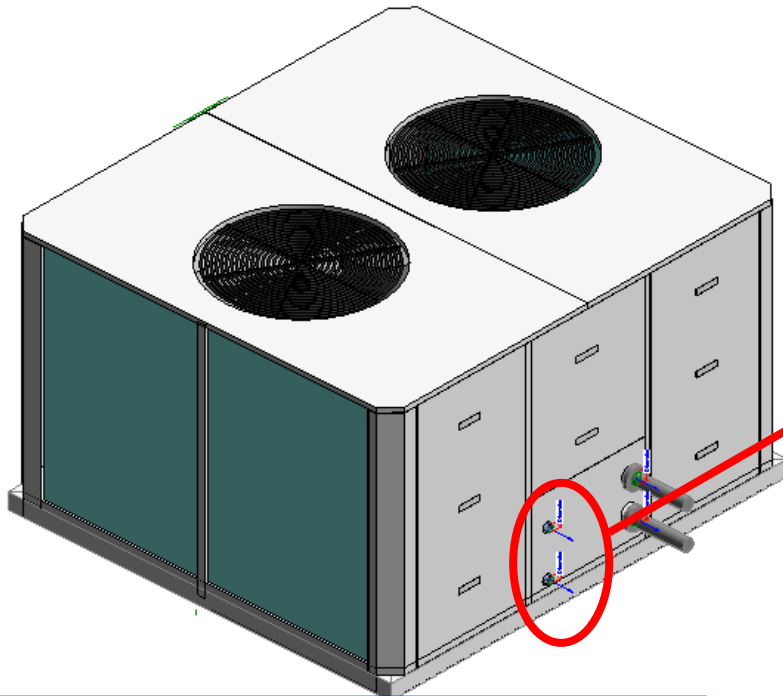


Connector Element (1)		Edit Type
Dimensions		
Diameter	33.2	
Mechanical		
K Coefficient	0.000000	
Flow Factor	0.000000	
Flow Configuration	Calculated	
Flow Direction	Out	
Loss Method	Not Defined	
Allow Slope Adjustments	☐	
System Classification	Domestic Hot Water	
Mechanical - Flow		
Fixture Units	0.000000	
Flow	0.00 L/s	
Pressure Drop	0.00 Pa	
Identity Data		
Utility	☐	
Connector Description	OUTLET	

Connector Element (1)		Edit Type
Dimensions		
Diameter	33.2	
Mechanical		
K Coefficient	0.000000	
Flow Factor	0.000000	
Flow Configuration	Calculated	
Flow Direction	In	
Loss Method	Not Defined	
Allow Slope Adjustments	☐	
System Classification	Domestic Cold Water	
Mechanical - Flow		
Fixture Units	0.000000	
Flow	0.00 L/s	
Pressure Drop	0.00 Pa	
Identity Data		
Utility	☐	
Connector Description	INLET	

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☒
Service Area	☐
Opt 307	☐
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐


30RQ-090R-TO-120R (Grilles)

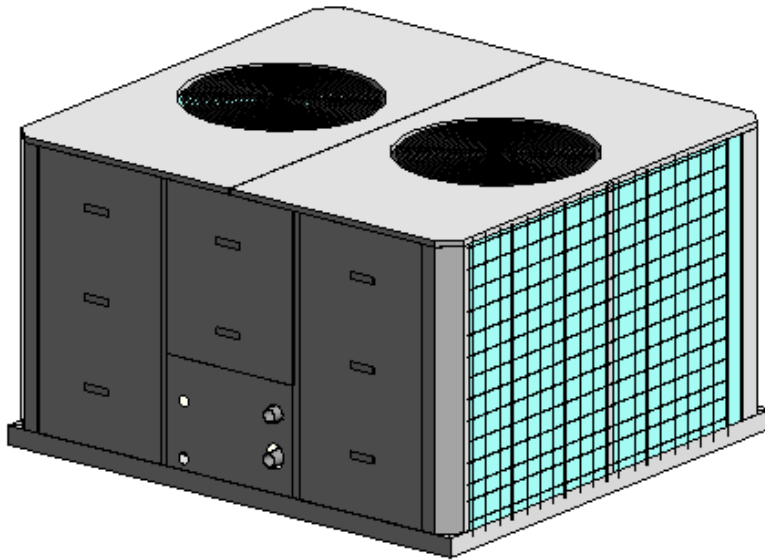

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☒
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

30RQ-090R-TO-120R (Single Pump Hydronic with Expansion tank)


Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☒
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☒
Service Area with Buffer tank	☐

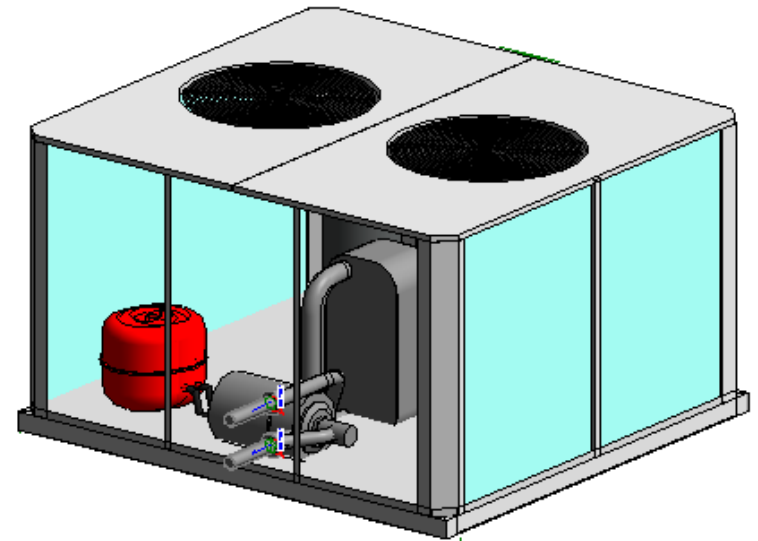


30RQ-090R-TO-120R (Double Pump Hydronic with Expansion tank)

Construction

Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☒
Opt 116S/116U/116W/116Y	☒
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

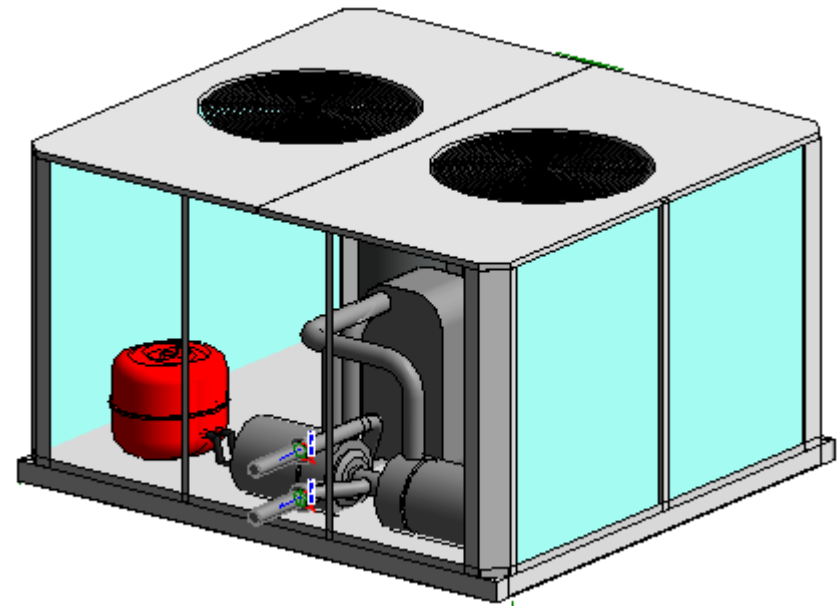


30RQ-090R-TO-120R (Desuperheater)

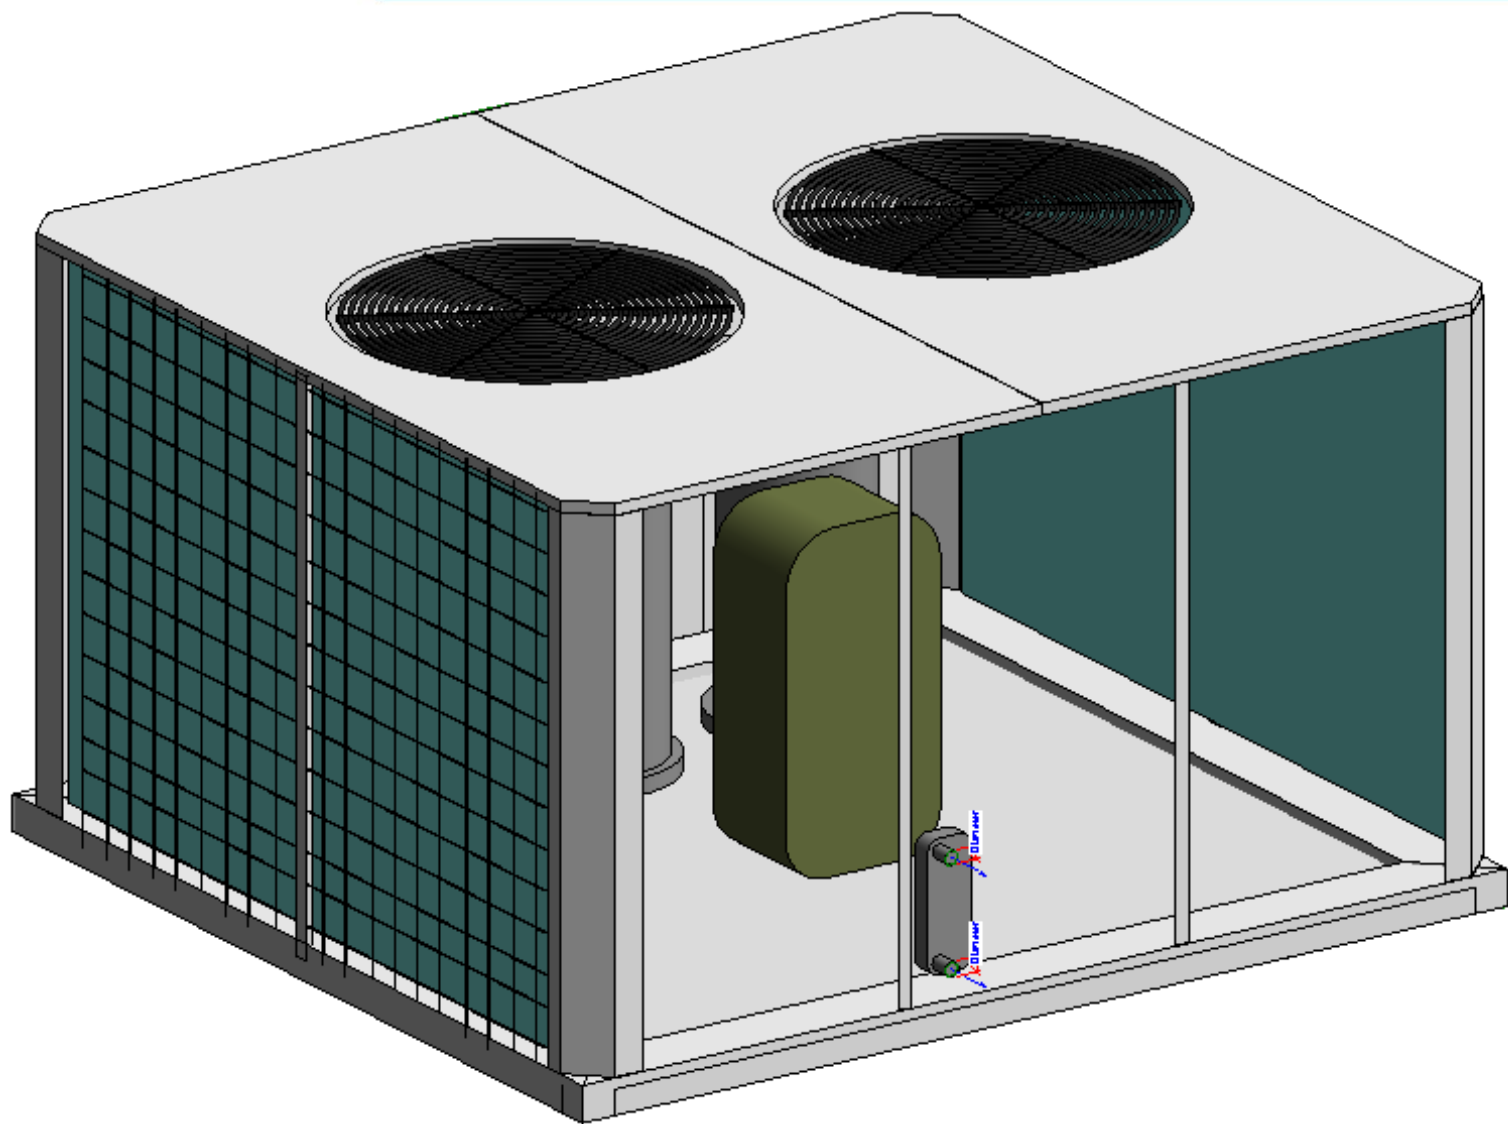


30RQ-090R-TO-120R (Option 264)

Construction	
Opt 12	☐
Opt 264	☒
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

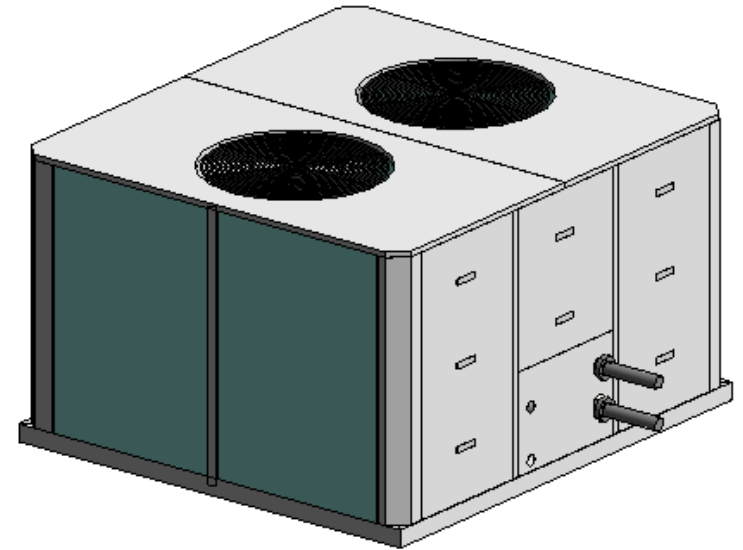


30RQ-090R-TO-120R (Option 266)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☒
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

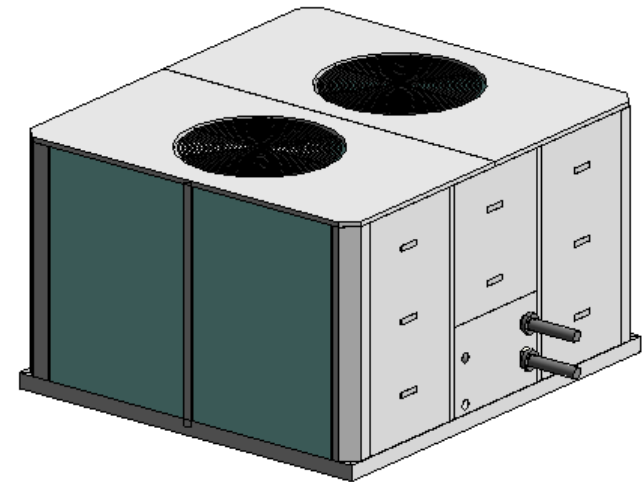

30RQ-090R-TO-120R (Option 12)



Construction	
Opt 12	☒
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

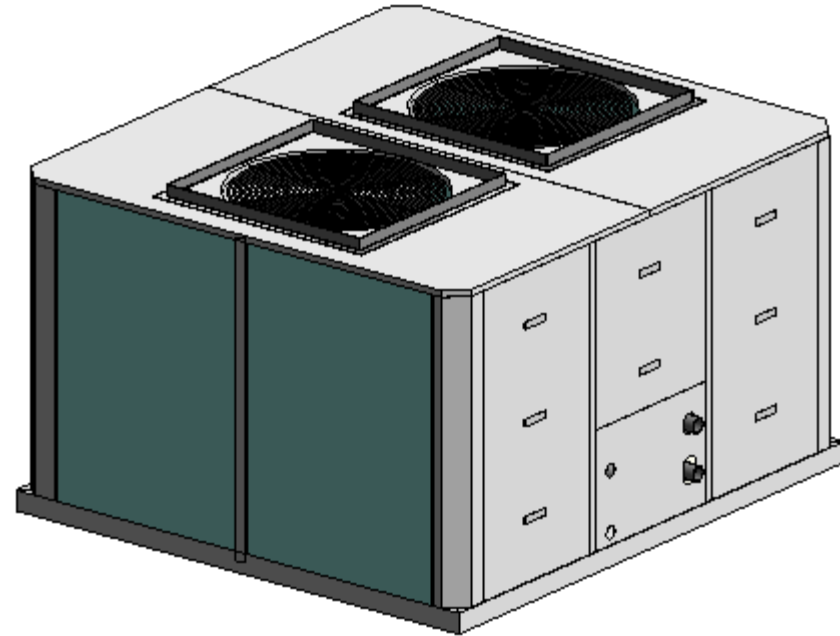

30RQ-090R-TO-120R (Service Area)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☒
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☒
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☒

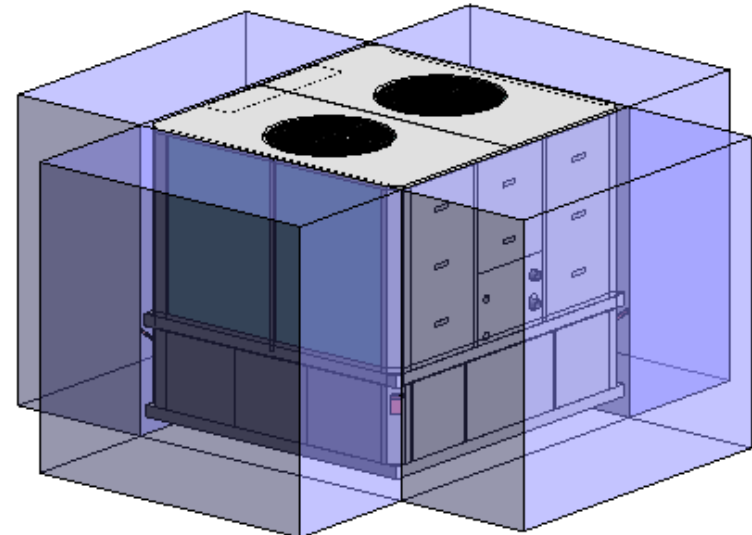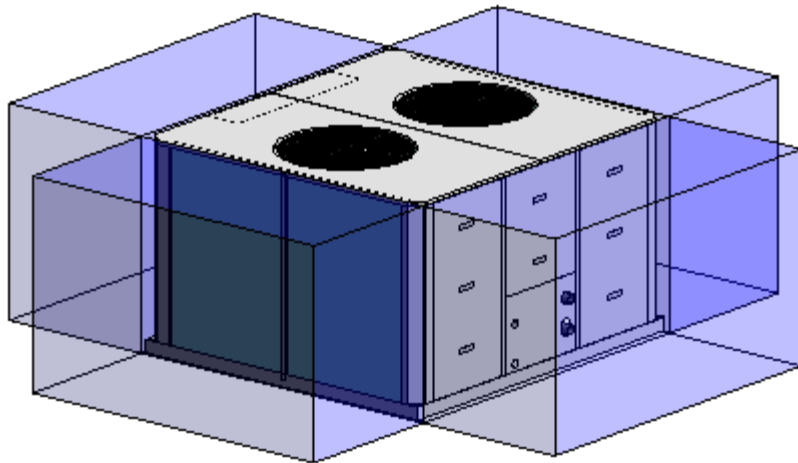

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузка в транспортную компанию

Технические данные файла

Документ: Схема Carrier 30RQ 040R-160R, тепловые насосы воздух-вода: BIM-модель Revit 30RQ 090R-120R, 06.2021

Идентификатор библиотеки: LIB-004161

Исходный файл: carrier-revit-06-2021-30rq-090r-to-120r-shema.pdf

SHA-256 оригинала: 83b5500980d3663b8036f86d2a16b8ad2d46f15113c94518446774cb3a4aa2bc

Постоянная ссылка: <https://iclim.ru/library/carrier-revit-06-2021-30rq-090r-to-120r-shema.pdf>

Копия сформирована: 03.10.2026 14:29 UTC