



DAIKIN ROOM AIR CONDITIONER

INSTALLATION MANUAL

R32 Split Series



Models

FTXTP25K3V1B

FTXTP35K3V1B

ATXTP25K3V1B

ATXTP35K3V1B

English

Deutsch

Français

Русский

Dansk

Svenska

Norsk

Suomi

Polski

CE - DECLARATION OF CONFORMITY
CE - KONFORMITÄTSERKLÄRUNG
CE - DECLARATION DE CONFORMITE
CE - CONFORMITEITSVERKLARING

CE - DECLARACION DE CONFORMIDAD
CE - DICHIARAZIONE DI CONFORMITA
CE - ΔΗΛΩΣΗ ΣΥΜΜΟΡΦΟΣΗΣ

CE - DECLARACÃO-DE-CONFORMIDADE
CE - ЗАЯВЛЕНИЕ О СООТВЕТСТВИИ
CE - ÖVERENSSTÄMMELSEERKLÄRING
CE - FÖRSÄKRAN OM ÖVERENSTÄMMELSE

CE - ERKLÄRUNG OM-SAMSVAR
CE - ILMOITUS-YHDENMUKAISUUSDESTA
CE - DEKLARACJA ZGODNOŚCI
CE - DECLARAȚIE DE CONFORMITATE

CE - IZJAVA-O-USKLADENOSTI
CE - MEGFELELŐSÉG-NYILATKOZAT
CE - ДЕКЛАРАЦІЯ-ЗА-СЬОТВІТСТВІВМЄ
CE - DEKLARACIJA-Z-GODNOSTI

CE - IZJAVA-O-SKLADNOSTI
CE - VASTAVUSEDEKLARACIJA
CE - АТБІЛКІСТЬ-ДЕКЛАРАЦІЯ
CE - VYHLÁSENIE-ZHODY
CE - UYGUNLUK-BEYANI

CE - АТБІЛКІСТЬ-ДЕКЛАРАЦІЯ
CE - АТБІЛКІСТЬ-ДЕКЛАРАЦІЯ
CE - VYHLÁSENIE-ZHODY
CE - UYGUNLUK-BEYANI

Daikin Industries Czech Republic s.r.o.

- 01 (66) declares under its sole responsibility that the air conditioning models to which this declaration relates:
02 (6) erklärt auf seine alleinige Verantwortung das die Modelle der Klimaanlage für die diese Erklärung bestimmt ist:
03 (E) déclare sous sa seule responsabilité que les appareils d'air conditionné visés par la présente déclaration:
04 (6L) verklaart hierbij op eigen exclusieve verantwoordelijkheid dat de airconditioning units waarop deze verklaring betrekking heeft:
05 (E) declara bajo su única responsabilidad que los modelos de aire acondicionado a los cuales hace referencia la declaración:
06 (C) dichiara sotto sua responsabilità che i condizionatori modello a cui è riferita questa dichiarazione:
07 (6B) δηλώνει με αποκλειστική της ευθύνη ότι το προϊόντα των κλιματιστικών συσκευών στο οποίο αναφέρεται η παρούσα δήλωση:
08 (P) declara sob sua exclusiva responsabilidade que os modelos de ar condicionado a que esta declaração se refere:

FTXTP25K3V1B, FTXTP35K3V1B, ATXTP25K3V1B, ATXTP35K3V1B,

01 are in conformity with the following standard(s) or other normative document(s), provided that these are used in accordance with our instructions:

02 (E) der/den folgenden Norm(en) oder einem anderen Normdokument oder -dokumenten entspricht/entsprechen, unter der Voraussetzung, dass sie gemäß unseren Anweisungen eingesetzt werden:

03 sont conformes à la(s) norme(s) ou autre(s) document(s) normatif(s), pour autant qu'ils soient utilisés conformément à nos instructions:
04 conform de volgende norm(en) of één of meer andere bindende documenten zijn, op voorwaarde dat ze worden gebruikt overeenkomstig onze instructies:

05 están en conformidad con la(s) siguiente(s) norma(s) u otro(s) documento(s) normativo(s), siempre que sean utilizados de acuerdo con nuestras instrucciones:

06 sono conformi all(i) seguente(i) standard(s) o altro(i) document(o) i carattere normativo, a patto che vengano usati in conformità alle nostre istruzioni:
07 эти устройства не только соответствуют (и даже превышают) требованиям, но и при этом соответствуют (и даже превышают) требованиям, указанным в этих документах, по:

EN60335-2-40.

- 01 following the provisions of:
02 gemäß den Vorschriften der:
03 conformément aux stipulations des:
04 overeenkomstig de bepalingen van:
05 siguiendo las disposiciones de:
06 secondo le prescrizioni per:
07 je tipično i u skladu s tim:
08 de acordo com o previsto em:
09 в соответствии с положениями:

- 01 Nola * as set out in <A> and judged positively by
02 Hinweis * wie in <A> aufgeführt und von positiv beurteilt
03 Remarque * tel que défini dans <A> et évalué positivement par conformément au Certificat <C>
04 Bemerk * zoals vermeld in <A> en positief beoordeeld door overeenkomstig Certificat <C>
05 Nota * como se establece en <A> y es valorado positivamente por de acuerdo con el Certificado <C>
06 Nota * delinatio nel <A> e giudicato positivamente da secondo il Certificato <C>
07 Izjava * ovaj dokumenti su pozitivno ocijenjeni
08 Nota * tal como estabelecido em <A> e com o parecer positivo de de acordo com o Certificado <C>
09 Препорука * как указано в <A> и в соответствии с рекомендацией согласно Сертификату <C>
10 Bemerk * kako je izloženo u <A> pozitivno ocijenjeno od strane prema Certificatu <C>

- 01 ** D/CZ*** is authorised to compile the Technical Construction File.
02 ** D/CZ*** hat die Berechtigung die Technische Konstruktionsakte zusammenzustellen.
03 ** D/CZ*** es autorisé à compiler le Dossier de Construction Technique.
04 ** D/CZ*** is bevoegd om het Technisch Constructiedossier samen te stellen.
05 ** D/CZ*** está autorizada a compilar el Archivo de Construcción Técnica.
06 ** D/CZ*** è autorizzata a redigere il File Tecnico di Costruzione.

***D/CZ = Daikin Industries Czech Republic s.r.o.



Tetsuya Baba
Managing Director
Pilsen, 1st of August 2017

3P475203-8B

09 (66) заверяет исключительно под свою ответственность, что модели кондиционеров воздуха, к которым относится настоящее заявление:

- 10 (6K) erklærer under ensvar, at klimaanlægsmødelne, som denne deklaration vedrører:
11 (S) deklarerar i eigerskap av husstandsvaer, at luftkonditioneringsmodellerna som berörs av denna deklaration innebär att:
12 (N) erklærer et fulstændigt ansvar for at de luftkonditioneringsmodeller som berøres af denne deklaration, indebærer at:
13 (6H) ilmoittaa yksinomaan omalla vastuullaan, että lään ilmastointilaitteiden laitteiden mallit:
14 (CZ) prohlásí ve své plné odpovědnosti, že modely klimatizace, k nrtě se tato prohlášení vztahuje:
15 (6B) izjavljajo pod izključno lastno odgovornostjo, da su modeli klima uređaja na koje se ova izjava odnosi:
16 (H) teljes felelőssége tudatában kijelenti, hogy a klímaberendezés modellek, melyekre a nyilatkozat vonatkozik:

08 estão em conformidade com a(s) seguinte(s) norma(s) ou outro(s) documento(s) normativo(s), desde que estes sejam utilizados de acordo com as nossas instruções:

09 соответствуют следующим стандартам или другим нормативным документам, при условии их использования согласно нашим инструкциям:
10 overholder følgende standard(er) eller andre/andre retningsgivende dokument(er), forudsat at disse anvendes i henhold til vore instrukser:
11 respektive utslutning är utförd i överensstämmelse med och följer följande standard(er) eller andra normgivande dokument, under förutsättning att användning sker i överensstämmelse med våra instruktioner:
12 respektive ulsyer er i overensstemmelse med følgende standard(er) eller andre normgivende dokument(er), under forudsætning at disse bruges i henhold til våre instruksjoner:
13 vastavaat seuraavien standardien ja muiden ohjeistettujen dokumenttien vaatimuksia edellytäten, että niitä käytetään ohjeiden mukaisesti:

14 za predpoklad, že jsou využívány v souladu s našimi pokyny, odpovídají následujícím normám nebo normativním dokumentům:
15 u skladu sa sledjením standardom(na) ili drugim normativnim dokumentom(na), uz ujet da se oni koriste u skladu s našim uputima:

Low Voltage 2014/35/EU
Electromagnetic Compatibility 2014/30/EU *
Machinery 2006/42/EC **

- 11 Information * enlig <A> og godkendt af enligt Certificat <C>
12 Merk * som det fremkommer i <A> og gennem positiv bekræftelse af itølge Certificat <C>
13 Huom * pitka on esitetty asiakirjassa <A> ja jalka on hyväksynyt Sertifikaatin <C> mukaisesti.
14 Poznámka * jak bylo uvedeno v <A> a pozitivně zjištěno v souladu s osvědčením <C>
15 Napomena * kako je izloženo u <A> pozitivno ocijenjeno od strane prema Certificatu <C>
16 Megjegyzés * alj <A> alapján, alj igazolta a megjelölt, alj <C> tanúsítvány szerint.
17 Uwaga * zgodnie z dokumentacją <A> pozytywną opinią Świadectwem <C>
18 Nota * asa cum este stabilit în <A> și aprobat pozitiv de în conformitate cu Certificatul <C>
19 Opomba * kol je dođeno v <A> in odobreno s strani v skladu s certifikatom <C>
20 Märkus * nagn om rådslut dokumentis <A> ja heakis kiitlud järgi vastavalt sertifikaadile <C>

- 13 ** D/CZ*** om valitettua laimaaan Teknisen asiakirjan.
14 ** Společnost D/CZ*** má oprávnění ke kompilaci souboru technické konstrukce.
15 ** D/CZ*** je ověřen za zřadu Dátověk o lehmickj konstrukci.
16 ** A D/CZ*** jopsult e mlszak konstrukciós dokumentáció összeállítására.
17 ** D/CZ*** ma upozorzenie do zbierania opracowywania dokumentacji konstrukcyjnej.
18 ** D/CZ*** este autorizat sa compileze Dosarul Tehnic de constructie.

- 17 (6L) deklaruje na vlastní výkresnou odpovědnost, že modely klimatizátorů, kterých objevené nínejsza deklaracija:
18 (6D) deklarerar på proprie råspörere da apparate de aer conditionat la care se refera acestor declaratie:
19 (6D) z vero odgovornostjo izjavja, da so modeli klimatskih naprav, na katere se izjava nanaša:
20 (6H) kinnitab oma täieliku vastutuse, et käesoleva deklaratsiooni alla kuuluvad klimateedmede mudelid:
21 (6H) deklarirova na oboo ootspooru, ze modelnye klimatichnae iskratirova, za kormo se otnasat tsay deklarirova:
22 (CZ) všetka savo atsakomybe slebha, vad omo kondicionaivno prelasny modelai, kuriems yra laikoma šis deklaracija:
23 (U) ari priblihtbu apiecinia, za taku uskazatilo modelj gaisva kondicioniraj, uz kurem atiecas šis deklaracija:
24 (6B) vyhlásuje na vlastní zodpovednosť, že tieto klimatizačné modely, na ktoré sa vzťahuje toto vyhlásenie:
25 (6B) lamamen kendi sorumluluğunda olmak üzere bu bildirimi ilgili oludu klima modellerinin aşağıdaki gibi olduğunu beyan eder:

- 16 megjelölnek az alábbi szabvány(ok)nak vagy egyéb irányadó dokumentum(ok)nak, ha azokat előírás szerint használják:
17 spełnia wymogi następujących norm i innych dokumentów normalizacyjnych, pod warunkiem że używane są zgodnie z naszymi instrukcjami:
18 sunt în conformitate cu următorul (următoarele) standard(e) sau altele documente(normative), cu condiția ca acestea să fie utilizate în conformitate cu instrucțiunile noastre:
19 con i naslednjih standardi in drugim normativ, pod pogojem, da se uporabljajo v skladu z našimi navodili:
20 on vastavuses järgmistis standard(ite)ga või teiste normatiivsete dokumentitega, kui need kasutatakse vastavalt meie juhenditele:
21 соответстват на средние стандарт или други нормативные документы, при условии, че се използват съгласно нашите инструкции:
22 allikha žemiau nurodytus standartus ir (arba) kitus norminius dokumentus su sąlyga, kad yra naudojami pagal mūsų nurodymus:
23 tad, je lihtdi atbilstošā rakstāda norādījumiem, atbilst sekojošiem standartiem un citiem normatīviem dokumentiem:
24 su i v zlobo s nasledovno(y)m normo(ma) alebo inými(n) normatívnymi dokumento(ma), za predpokladu, že sa používajú v súlade s našimi návodmi:
25 јиници, тамаглазмазга гре каланлимаз казулуга ашаğıдаки стандарлар ве норм белгилері белгилері умуидлур:

- 10 Direktiver, med senere ændringer.
11 Direktiv, med foretagne ændringer.
12 Direktiver, med foretagne ændringer.
13 Direktive, selas que modifiées.
14 Richtlijnen, zoals geamendeerd.
15 Directivas, según lo emendado.
16 Direktives, segun lo emendado.
17 Obyvuk, omuk tyov potomoprdi.
18 Direktivelor, cu amendamentele respective.
19 Direktive z verzi spremembami.
20 Direktiv kros mudastutega.
21 Директив, с ревизия изменения.
22 Direktivose su papilymais.
23 Direktivas un to papildinajumos.
24 Smeitice, pslatnom zneni.
25 Džstjlmis halerlye Yornemelker.

<A>	DAIKIN.TCF.032C18/07-2017
	DEKRA (NB0344)
<C>	2159619.0551-EMC

- 19 ** D/CZ*** je podložek za sestavo datotek s tehnično mapo.
20 ** D/CZ*** om volitatu koostana tehnilist dokumentatsiooni.
21 ** D/CZ*** e omprizakara za osramy Akta za tehnicka konstrukciya.
22 ** D/CZ*** va jaloda sudaryt šj tehnicis konstrukcijs failā.
23 ** D/CZ*** i autorizēts sastādīt tehniko dokumentāciju.
24 ** Spoločnosť D/CZ*** je oprávnená vytvoriť súbor technickéj konštrukcie.
25 ** D/CZ*** Teknik Yapı Dosyasını derlemeye yetkilidir.

Safety Precautions



Read the precautions in this manual carefully before operating the unit.



This appliance is filled with R32.

- The precautions described herein are classified as WARNING and CAUTION. They both contain important information regarding safety. Be sure to observe all precautions without fail.
- Meaning of WARNING and CAUTION notices



WARNING.....Failure to follow these instructions properly may result in personal injury or loss of life.



CAUTION.....Failure to observe these instructions properly may result in property damage or personal injury, which may be serious depending on the circumstances.

- The safety marks shown in this manual have the following meanings:



Be sure to follow the instructions.



Be sure to establish an earth connection.



Never attempt.

- After completing installation, conduct a trial operation to check for faults and explain to the customer how to operate the air conditioner and take care of it with the aid of the operation manual.
- The English text is the original instruction. Other languages are translations of the original instructions.



WARNING

- Ask your dealer or qualified personnel to carry out installation work.
Do not attempt to install the air conditioner yourself. Improper installation may result in water leakage, electric shocks or fire.
- Install the air conditioner in accordance with the instructions in this installation manual.
Improper installation may result in water leakage, electric shocks or fire.
- Be sure to use only the specified accessories and parts for installation work.
Failure to use the specified parts may result in the unit falling, water leakage, electric shocks or fire.
- Install the air conditioner on a foundation strong enough to withstand the weight of the unit.
A foundation of insufficient strength may result in the equipment falling and causing injury.
- Electrical work must be performed in accordance with relevant local and national regulations and with instructions in this installation manual. Be sure to use a dedicated power supply circuit only.
Insufficiency of power circuit capacity and improper workmanship may result in electric shocks or fire.
- Use a cable of suitable length.
Do not use tapped wires or an extension lead, as this may cause overheating, electric shocks or fire.
- Make sure that all wiring is secured, the specified wires are used, and that there is no strain on the terminal connections or wires.
Improper connections or securing of wires may result in abnormal heat build-up or fire.
- When wiring the power supply and connecting the wiring between the indoor and outdoor units, position the wires so that the control box lid can be securely fastened.
Improper positioning of the control box lid may result in electric shocks, fire or over heating terminals.
- If the supply cord is damaged, it must be replaced by the manufacturer, a service agent or similarly qualified persons in order to avoid a hazard.
- If refrigerant gas leaks during installation, ventilate the area immediately.
Toxic gas may be produced if the refrigerant comes into contact with fire. 
- After completing installation, check for refrigerant gas leakage.
Toxic gas may be produced if the refrigerant gas leaks into the room and comes into contact with a source of fire, such as a fan heater, stove or cooker. 
- When installing or relocating the air conditioner, be sure to bleed the refrigerant circuit to ensure it is free of air, and use only the specified refrigerant (R32 - based on unit specification. The refrigerant must not be interchanged).
The presence of air or other foreign matter in the refrigerant circuit causes abnormal pressure rise, which may result in equipment damage and even injury.
- During installation, attach the refrigerant piping securely before running the compressor.
If the refrigerant pipes are not attached and the stop valve is open when the compressor is run, air will be sucked in, causing abnormal pressure in the refrigeration cycle, which may result in equipment damage and even injury.
- During pump-down, stop the compressor before removing the refrigerant piping.
If the compressor is still running and the stop valve is open during pump-down, air will be sucked in when the refrigerant piping is removed, causing abnormal pressure in the refrigeration cycle, which may result in equipment damage and even injury.
- Be sure to earth the air conditioner.
Do not earth the unit to a utility pipe, lightning conductor or telephone earth lead. Imperfect earthing may result in electric shocks. 
- Be sure to install an earth leakage breaker.
Failure to install an earth leakage breaker may result in electric shocks or fire.
- Make sure to provide for adequate measures in order to prevent that the outdoor unit be used as a shelter by small animals.
Small animals making contact with electrical parts can cause malfunctions, smoke or fire. Please instruct the customer to keep the area around the unit clean.

Safety Precautions

⚠ CAUTION

- Do not install the air conditioner at any place where there is a danger of flammable gas leakage.
In the event of a gas leakage, build-up of gas near the air conditioner may cause a fire to break out. 
- Only qualified personnel can handle, fill, purge and dispose of the refrigerant.
- While following the instructions in this installation manual, install drain piping to ensure proper drainage and insulate piping to prevent condensation.
Improper drain piping may result in indoor water leakage and property damage.
- Tighten the flare nut according to the specified method such as with a torque wrench.
If the flare nut is too tight, it may crack after prolonged use, causing refrigerant leakage.
- This appliance is intended to be used by expert or trained users in shops, in light industry and on farms, or for commercial and household use by lay persons.
- Sound pressure level is less than 70 dB(A).

Accessories

Indoor unit (A)–(H)

(A) Mounting plate	1	(D) Remote controller holder	1	(G) Operation manual	1
(B) Titanium apatite deodorizing filter	2	(E) Dry battery AAA. LR03 (alkaline) - for (C)	2	(H) Installation manual	1
(C) Wireless remote controller	1	(F) Indoor unit fixing screw (M4 × 12L)	2		

Operation limits

Use the system in the following temperature and humidity ranges for safe and effective operation.

	Cooling	Heating
Outdoor temperature	–10~46°C	–25~24°C
Indoor temperature	18~32°C	10~30°C
Indoor humidity	≤80% ^(a)	

^(a) To avoid condensation and water dripping out of the unit. If the temperature or the humidity is beyond these conditions, safety devices may be put in action and the air conditioner may not operate.

The setting temperature range of the remote controller is:

Cooling operation	Heating operation	AUTO operation
18-32°C	10-30°C	18-30°C

Choosing an Installation Site

Before choosing the installation site, obtain user approval.

1. Indoor unit

- The indoor unit should be sited in a place where:
 - 1) the restrictions on installation specified in the indoor unit installation drawings are met,
 - 2) both air inlet and air outlet have clear paths met,
 - 3) the unit is not in the path of direct sunlight,
 - 4) the unit is away from the source of heat or steam,
 - 5) there is no source of machine oil vapour (this may shorten indoor unit life),
 - 6) cool (warm) air is circulated throughout the room,
 - 7) the unit is away from electronic ignition type fluorescent lamps (inverter or rapid start type) as they may shorten the remote controller range,
 - 8) the unit is at least 1m away from any television or radio set (unit may cause interference with the picture or sound),
 - 9) install at the recommended height (1.8m),
 - 10) no laundry equipment is located.
 - 11) the appliance shall be stored so as to prevent mechanical damage from occurring.

2. Wireless remote controller

- Turn on all the fluorescent lamps in the room, if any, and find the site where remote controller signals are properly received by the indoor unit (within 7m).

Preparation before Installation


1. Removing and installing the front panel

• Removal method

- 1) Place your fingers in the indentations on the main unit (one each on the left and right sides), and open the front panel until it stops.
- 2) Continue to open the front panel further while sliding the panel to the right and pulling it toward you in order to disengage the front panel shaft on the left side. To disengage the front panel shaft on the right side, slide the panel to the left while pulling it toward you.

• Installation method


Align the tabs of the front panel with the grooves, and push all the way in. Then close slowly. Push the centre of the lower surface panel firmly to engage the tabs.

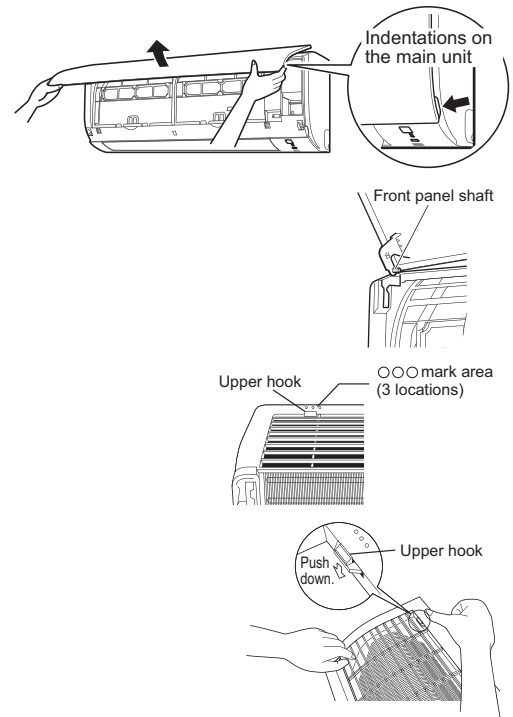

2. Removing and installing the front grille

• Removal method

- 1) Remove the front panel to remove the air filter.
- 2) Remove the 3 screws from the front grille.
- 3) In front of the ○○○ mark of the front grille, there are 3 upper hooks. Lightly pull the front grille toward you with one hand, and push down on the hooks with the fingers of your other hand.

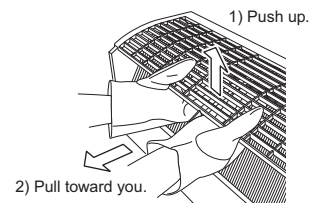

When there is no work space because the unit is close to ceiling

⚠ CAUTION

- Be sure to wear protection gloves.

Place both hands under the centre of the front grille, and while pushing up, pull it toward you.

• Installation method

- 1) Install the front grille and firmly engage the upper hooks (3 locations).
- 2) Install 3 screws of the front grille.
- 3) Install the air filter and then mount the front panel.

3. How to set the different addresses

When 2 indoor units are installed in one room, the 2 wireless remote controllers can be set for different addresses. Change the address setting of one of the two units.


When cutting the jumper be careful not to damage any of the surrounding parts.

- 1) Remove the battery cover on the remote controller and cut the address jumper.
- 2) Press **TEMP** , **TEMP** and **OFF** at the same time.


- 3) Press **TEMP** , select **R** , press **FAN** .

(The indoor unit OPERATION lamp will blink for about 1 minute.)

- 4) Press the indoor unit ON/OFF switch while the OPERATION lamp is blinking.



Jumper	ADDRESS
EXIST	1
CUT	2

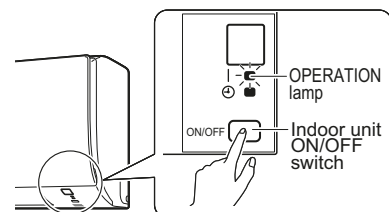


- If setting could not be carried out completely while the OPERATION lamp was blinking, carry out the setting process once again from the beginning.
- After setting is complete, pressing **FAN** for about 5 seconds will cause the remote controller to return to the previous display.

Preparation before Installation

4. When connecting to an HA system


(Wired remote controller, Central remote controller, Wireless adaptor, etc.)

- 1) Remove the metal plate electrical wiring cover.
(Refer to the **Removal/attachment methods of metal plate electrical wiring covers.**)
- 2) Attach the connection cord to the S21 connector and pull the harness as shown in the figure.
- 3) Replace the electrical wiring cover as it was, and pull the harness around, as shown in the figure.

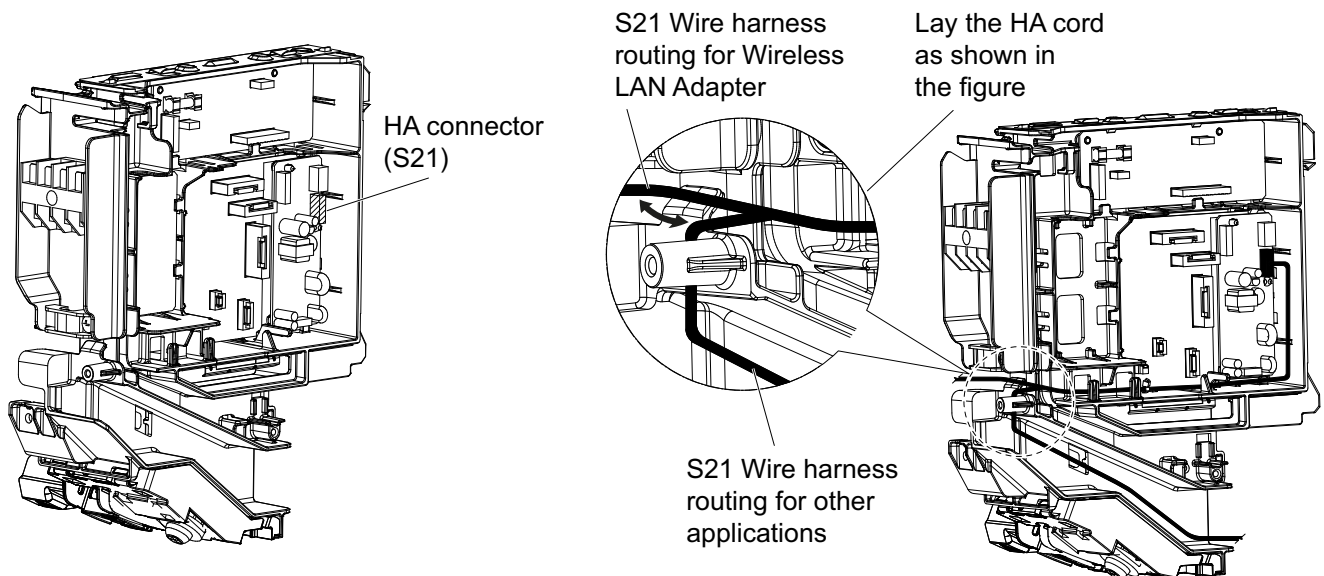


Removal method of metal plate electrical wiring covers

- 1) Remove the front grille.
- 2) Remove the electrical wiring box (1 screw).
- 3) Raise the upper part of the metal plate electrical wiring cover, pull the part frontward, and remove the 3 tabs.


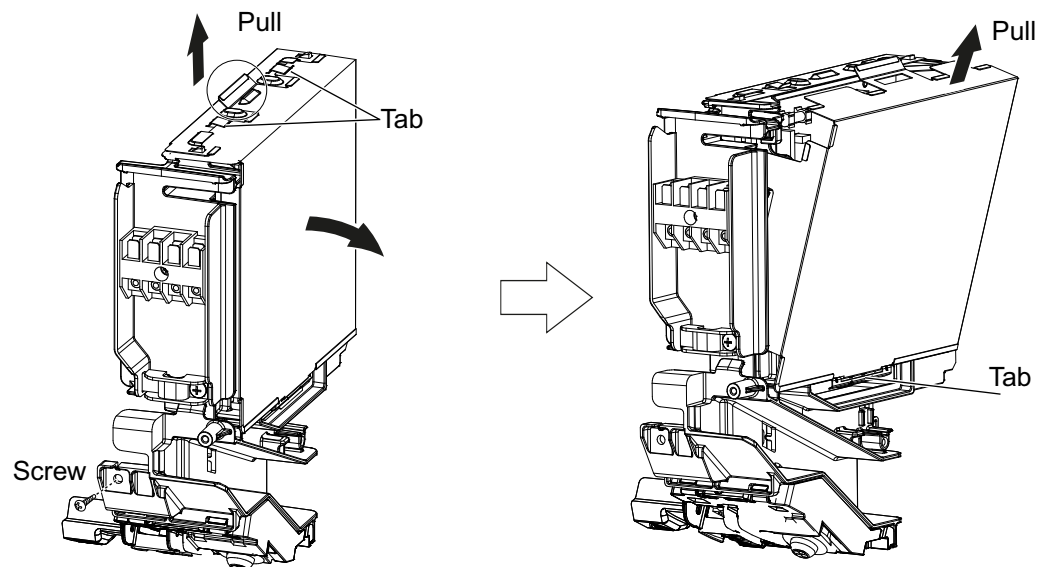


*The appearance of the box may differ for classes 25, 35.

Indoor Unit Installation Drawings

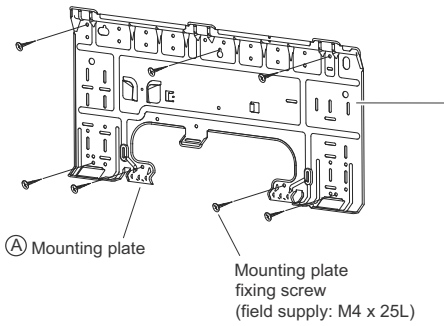

The ① mounting plate should be installed on a wall which can support the weight of the indoor unit.

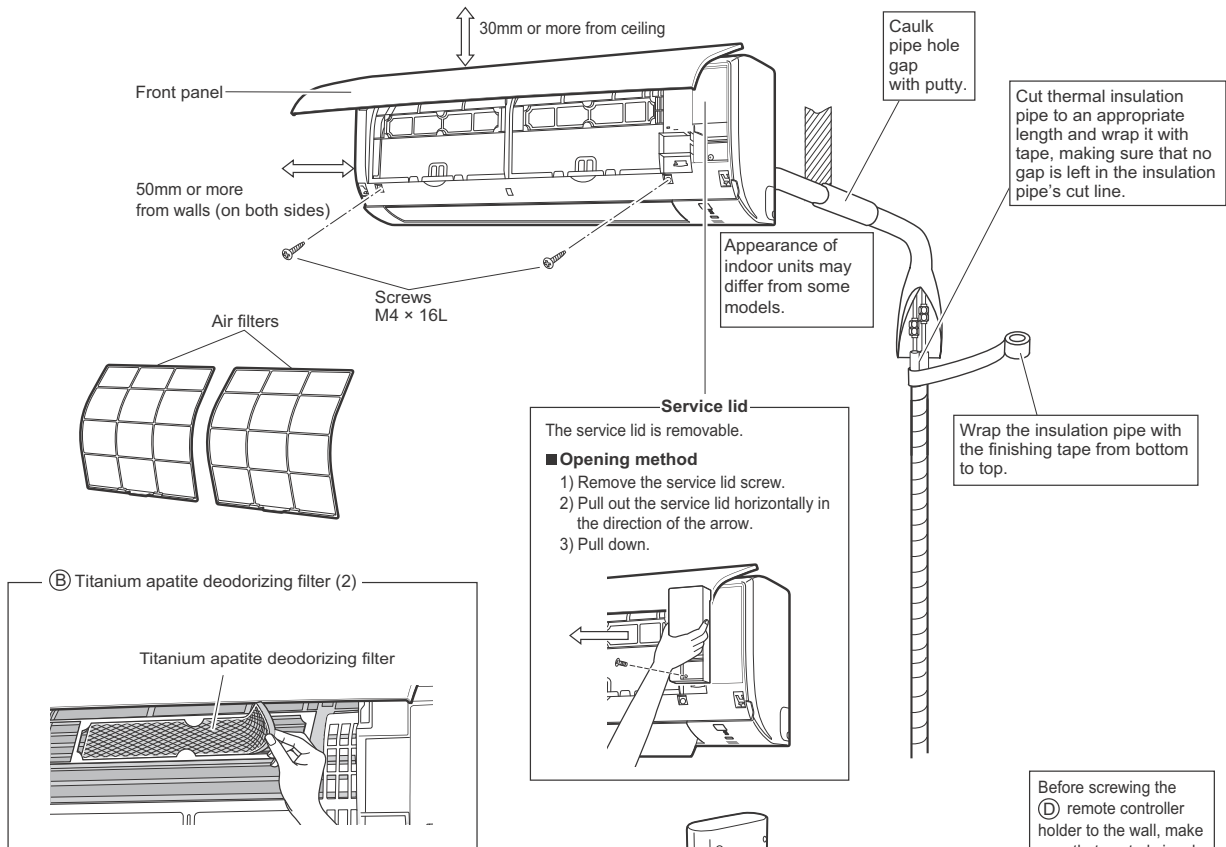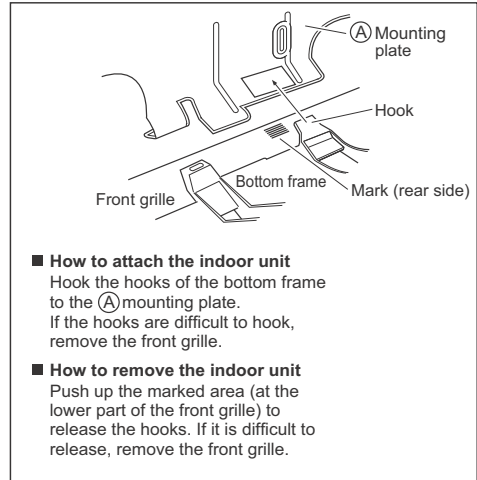

Indoor Unit Installation


WARNING

- Only use accessories, optional equipment and spare parts made or approved by DAIKIN.
- Installation shall be done by an installer, the choice of materials and installation shall comply with the applicable legislation. In Europe, the EN378 is the applicable standard that shall be used.

1. Installing the mounting plate


- The mounting plate should be installed on a wall which can support the weight of the indoor unit.
- 1) Temporarily secure the mounting plate to the wall, make sure that the panel is completely level, and mark the boring points on the wall.
 - 2) Secure the mounting plate to the wall with screws.

Recommended mounting plate retention spots and dimensions

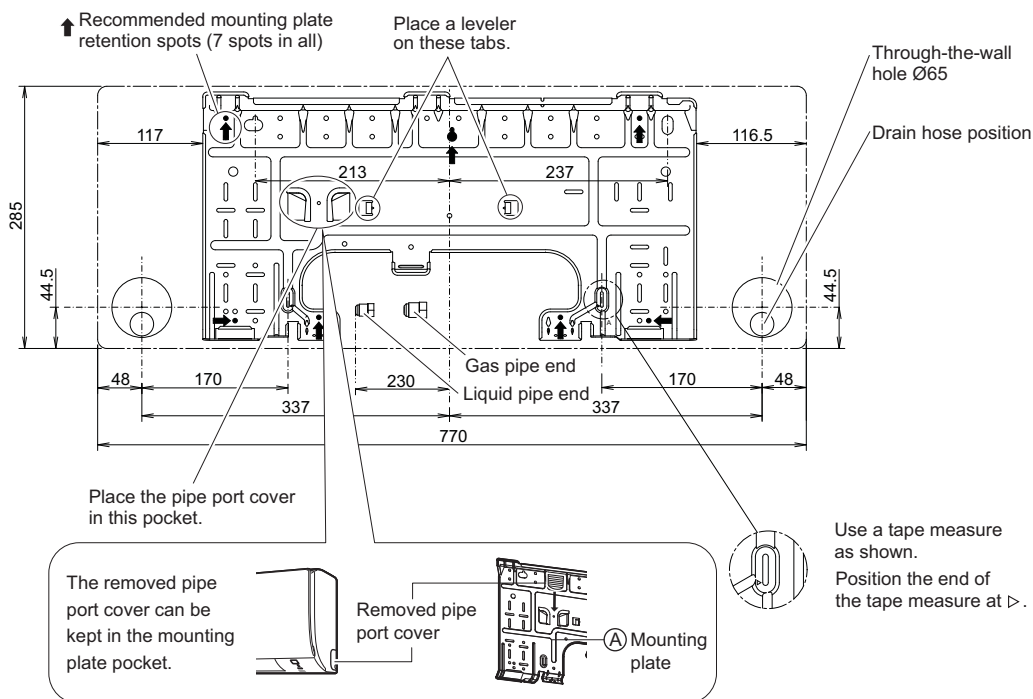

2. Boring a wall hole and installing wall embedded pipe

- For walls containing metal frame or metal board, be sure to use a wall embedded pipe and wall cover in the feed-through hole to prevent possible heat, electrical shock, or fire.
 - Be sure to caulk the gaps around the pipes with caulking material to prevent water leakage.
- 1) Bore a feed-through hole of 65mm in the wall so it has a down slope toward the outside.
 - 2) Insert a wall pipe into the hole.
 - 3) Insert a wall cover into wall pipe.
 - 4) After completing refrigerant piping, wiring, and drain piping, caulk pipe hole gap with putty.

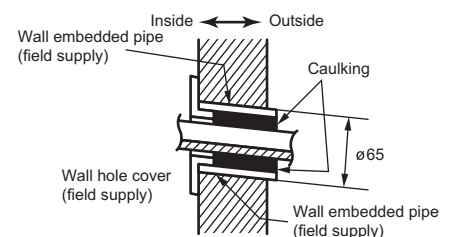


Indoor Unit Installation

3. Installing the indoor unit

- In the case of bending or curing refrigerant pipes, keep the following precautions in mind.

Abnormal sound may be generated if improper work is conducted.

- Do not strongly press the refrigerant pipes onto the bottom frame.
- Do not strongly press the refrigerant pipes on the front grille, either.

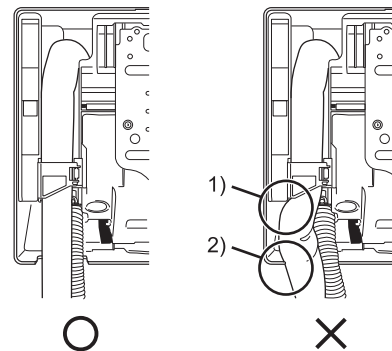


- Remove the pipe port cover as shown below.

- Cut off the pipe port cover from inside the front grille using a coping saw.

Apply the blade of the coping saw to the notch, and cut off the pipe port cover along the uneven inner surface.

- After cutting off the pipe port cover, perform filing. Remove the burrs along the cut section using a half round needle file.

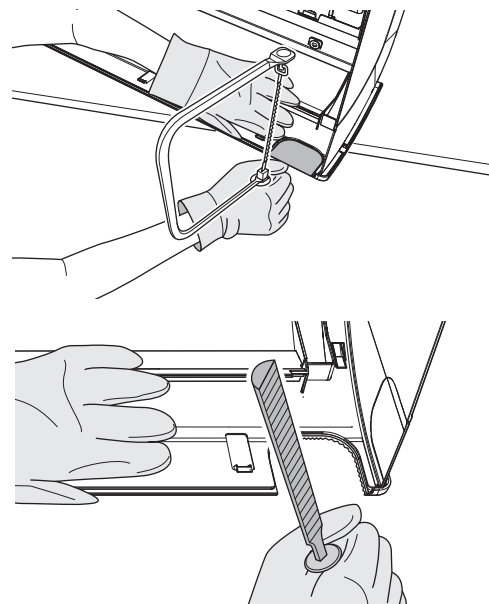


CAUTION

- If the pipe port cover is cut off using nippers, the front grille will be damaged. Please do not use nippers.
- Wear gloves during the pipe port cover removal.


3-1. Right-side, right-back, or right-bottom piping

- Attach the drain hose to the underside of the refrigerant pipes with adhesive vinyl tape.
- Wrap the refrigerant pipes and drain hose together with insulation tape.

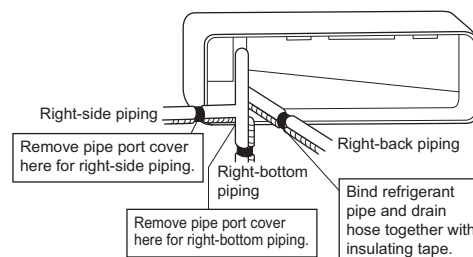


Indoor Unit Installation

- 3) Pass the drain hose and refrigerant pipes through the wall hole, then set the indoor unit on the mounting plate hooks by using the Δ markings at the top of the indoor unit as a guide.

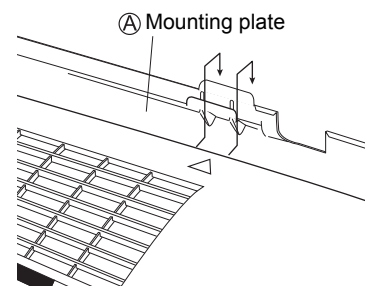

- 4) Open the front panel, then open the service lid.
(Refer to preparation before installation.)
- 5) Pass the inter-unit wire from the outdoor unit through the feed-through wall hole and then through the back of the indoor unit. Pull them through the front side. Bend the ends of tie wires upward for easier work in advance. (If the inter-unit wire ends are to be stripped first, bundle wire ends with adhesive tape.)
- 6) Press the bottom frame of the indoor unit with both hands to set it on the mounting plate hooks. Make sure the wires do not catch on the edge of the indoor unit.

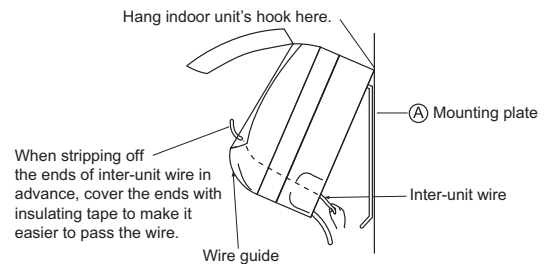

3-2. Left-side, left-back, or left-bottom piping


How to replace the drain plug and drain hose

• Replacing onto the left side


- 1) Remove the insulation fixing screw on the right and remove the drain hose.
- 2) Remove the drain plug on the left side and attach it to the right side.
- 3) Insert the drain hose and tighten with included insulation fixing screw.
* (Forgetting to tighten this may cause water leakages.)

Drain hose attachment position

* The drain hose is on the back of the unit.

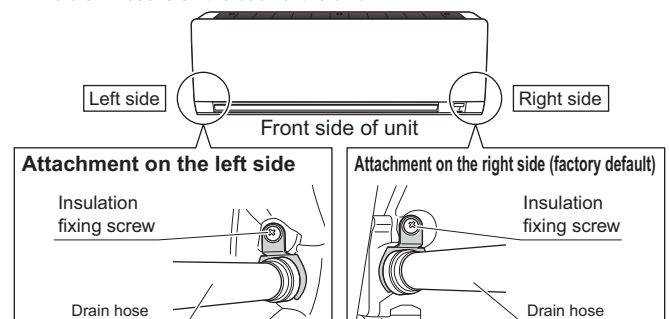


- 1) Attach the drain hose to the underside of the refrigerant pipes with adhesive vinyl tape.

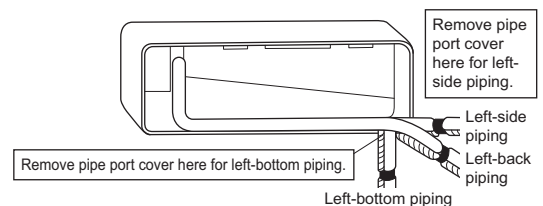


- 2) Be sure to connect the drain hose to the drain port in place of a drain plug.

How to set drain plug

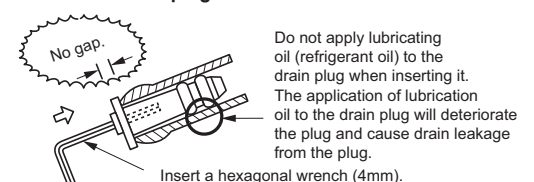


Indoor Unit Installation

- 3) Shape the refrigerant pipes along the pipe path marking on the mounting plate.
- 4) Pass the drain hose and refrigerant pipes through the wall hole, then set the indoor unit on mounting plate hooks, using the Δ markings at the top of the indoor unit as a guide.
- 5) Pull in the inter-unit wire.
- 6) Connect the inter-unit pipes.

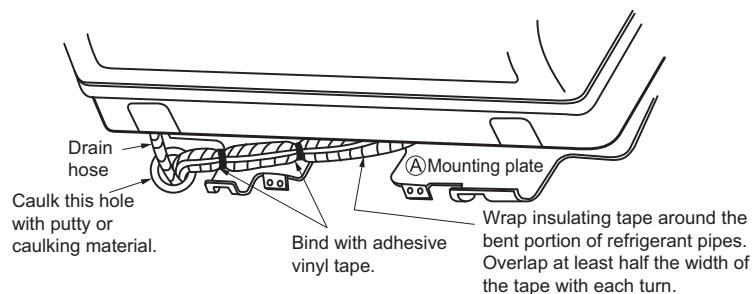


- 7) Wrap the refrigerant pipes and drain hose together with insulation tape as shown in the figure on the right (in case of setting the drain hose through the back of the indoor unit).
- 8) While exercising care so that the inter-unit wire does not catch indoor unit, press the bottom edge of indoor unit with both hands until it is firmly caught by the mounting plate hooks. Secure indoor unit to the mounting plate with indoor unit fixing screws (M4 × 12L).

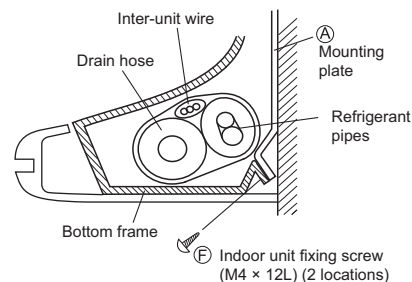

3-3. Wall embedded piping


Follow the instructions given under left-side, left-back, or left-bottom piping.

- 1) Insert the drain hose to this depth so it won't be pulled out of the drain pipe.

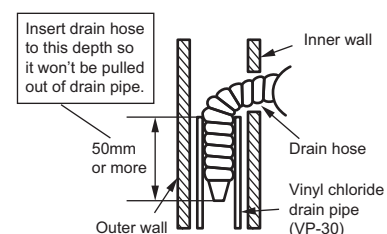

Indoor Unit Installation

Wiring diagram

Unified Wiring Diagram Legend			
For applied parts and numbering refer to the wiring diagram sticker supplied on the unit. Part numbering is realized by Arabic numbers in ascending order for each part and is represented in the overview below by symbol "*" in the part code.			
	: CIRCUIT BREAKER		: PROTECTIVE EARTH
	: CONNECTION		: PROTECTIVE EARTH (SCREW)
	: CONNECTOR		: RECTIFIER
	: EARTH		: RELAY CONNECTOR
	: FIELD WIRING		: SHORT CIRCUIT CONNECTOR
	: FUSE		: TERMINAL
	: INDOOR UNIT		: TERMINAL STRIP
	: OUTDOOR UNIT		: WIRE CLAMP
BLK : BLACK	GRN : GREEN	PNK : PINK	WHT : WHITE
BLU : BLUE	GRY : GREY	PRP, PPL : PURPLE	YLW : YELLOW
BRN : BROWN	ORG : ORANGE	RED : RED	
A*P : PRINTED CIRCUIT BOARD	PS : SWITCHING POWER SUPPLY		
BS* : PUSH BUTTON ON / OFF, OPERATION SWITCH	PTC* : THERMISTOR PTC		
BZ, H*O : BUZZER	Q* : INSULATED GATE BIPOLAR TRANSISTOR (IGBT)		
C* : CAPACITOR	Q*DI : EARTH LEAK CIRCUIT BREAKER		
AC*, CN*, E*, HA*, HE, HL*, HN*, HR*, MR*_A, MR*_B, S*, U, V, W, X*A, K*R_*	Q*L : OVERLOAD PROTECTOR		
D*, V*D : DIODE	Q*M : THERMO SWITCH		
DB* : DIODE BRIDGE	R* : RESISTOR		
DS* : DIP SWITCH	R*T : THERMISTOR		
E*H : HEATER	RC : RECEIVER		
F*U, FU* (FOR CHARACTERISTICS REFER TO PCB INSIDE YOUR UNIT)	S*C : LIMIT SWITCH		
FG* : CONNECTOR (FRAME GROUND)	S*L : FLOAT SWITCH		
H* : HARNESS	S*NPH : PRESSURE SENSOR (HIGH)		
H*P, LED*, V*L : PILOT LAMP, LIGHT EMITTING DIODE	S*NPL : PRESSURE SENSOR (LOW)		
HAP : LIGHT EMITTING DIODE (SERVICE MONITOR GREEN)	S*PH, HPS* : PRESSURE SWITCH (HIGH)		
HIGH VOLTAGE : HIGH VOLTAGE	S*PL : PRESSURE SWITCH (LOW)		
IES : INTELLIGENT EYE SENSOR	S*T : THERMOSTAT		
IPM* : INTELLIGENT POWER MODULE	S*W, SW* : OPERATION SWITCH		
K*R, KCR, KFR, KHuR, K*M : MAGNETIC RELAY	SA*, F1S : SURGE ARRESTOR		
L : LIVE	SR*, WLU : SIGNAL RECEIVER		
L* : COIL	SS* : SELECTOR SWITCH		
L*R : REACTOR	SHEET METAL : TERMINAL STRIP FIXED PLATE		
M* : STEPPER MOTOR	T*R : TRANSFORMER		
M*C : COMPRESSOR MOTOR	TC, TRC : TRANSMITTER		
M*F : FAN MOTOR	V*, R*V : VARISTOR		
M*P : DRAIN PUMP MOTOR	V*R : DIODE BRIDGE		
M*S : SWING MOTOR	WRC : WIRELESS REMOTE CONTROLLER		
MR*, MRCW*, MRM*, MRN*	X* : TERMINAL		
N : NEUTRAL	X*M : TERMINAL STRIP (BLOCK)		
n = *, N=*	Y*E : ELECTRONIC EXPANSION VALVE COIL		
PAM : PULSE-AMPLITUDE MODULATION	Y*R, Y*S : REVERSING SOLENOID VALVE COIL		
PCB* : PRINTED CIRCUIT BOARD	Z*C : FERRITE CORE		
PM* : POWER MODULE	ZF, Z*F : NOISE FILTER		



CAUTION

- When the main power is turned off and then back on again, operation will resume automatically.




WARNING

- **HIGH VOLTAGE** – be sure to discharge the capacitor completely before repair work.
- Risk of failure or water leakage!
Do not wash the inside of the air conditioner by yourself.

Indoor Unit Installation

4. Wiring

- 1) Strip wire ends (15mm).
- 2) Match wire colours with terminal numbers on indoor and outdoor unit's terminal blocks and firmly screw wires to the corresponding terminals.
- 3) Connect the earth wires to the corresponding terminals.
- 4) Pull wires to make sure that they are securely latched up, then retain wires with wire retainer.
- 5) Shape the wires so that the service lid fits securely, then close service lid.

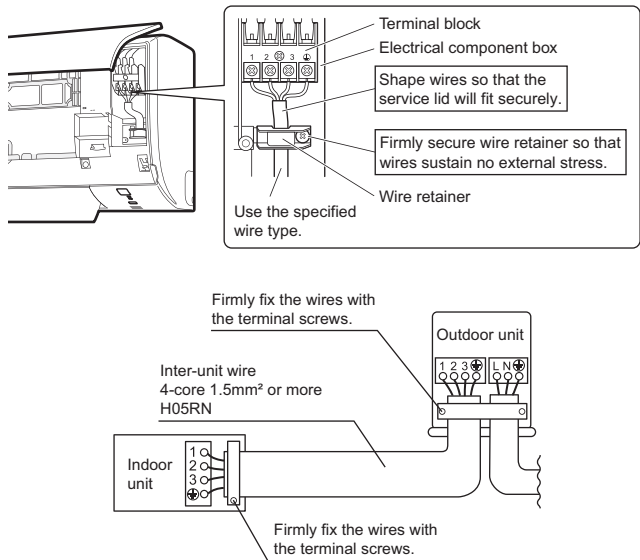

⚠ WARNING

- Do not use tapped wires, stranded wires, extension cords, or starburst connections, as they may cause overheating, electrical shock, or fire.
- Do not use locally purchased electrical parts inside the product. (Do not branch the power for the drain pump, etc., from the terminal block.) Doing so may cause electric shock or fire.
- Do not connect the power wire to the indoor unit. Doing so may cause electric shock or fire.
- Use an all-pole disconnection type breaker with at least 3mm between the contact point gaps.

5. Drain piping



1) Connect the drain hose, as described right. The drain hose should be inclined downward. No trap is permitted. Do not put the end of the hose in water.	2) Remove the air filters and pour some water into the drain pan to check the water flows smoothly	3) If drain hose extension or embedded drain piping is required, use appropriate parts that match the hose front end. [Figure of hose front end]
4) When extending the drain hose, use a commercially available extension hose with an inner diameter of 16mm. Be sure to thermally insulate the indoor section of the extension hose.	Indoor unit drain hose Extension drain hose Heat insulation tube (field supply)	
5) When connecting a rigid polyvinyl chloride pipe (nominal diameter 13mm) directly to the drain hose attached to the indoor unit as with embedded piping work, use any commercially available drain socket (nominal diameter 13mm) as a joint.	Drain hose supplied with the indoor unit Commercially available drain socket (nominal diameter 13mm) Commercially available rigid polyvinyl chloride pipe (nominal diameter 13mm)	

Indoor Unit Installation

6. Wireless adapter (option)

Installing:

- Place the wireless adapter against the hooks (1).
- Lock the adapter by pressing it down (2).

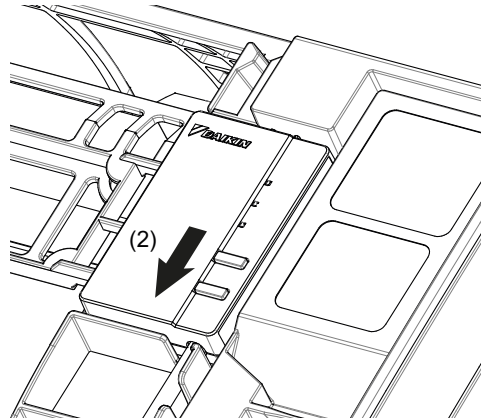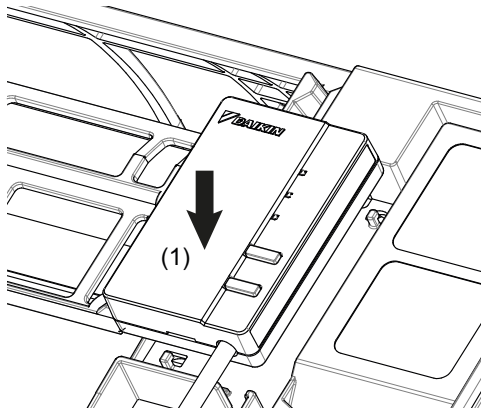

Removing: the reverse process of installing.


Refrigerant Piping Work

1. Flaring the pipe end

- 1) Cut the pipe end with a pipe cutter.
- 2) Remove burrs with the cut surface facing downward so that the chips do not enter the pipe.
- 3) Put the flare nut on the pipe.
- 4) Flare the pipe.
- 5) Check that the flaring is properly made.



Flaring			
Set exactly at the position shown below.			
	Flare tool for R32		Conventional flare tool
	Clutch-type	Clutch-type (Ridgid-type)	Wing-nut type (Imperial-type)
A	0-0.5mm	1.0-1.5mm	1.5-2.0mm

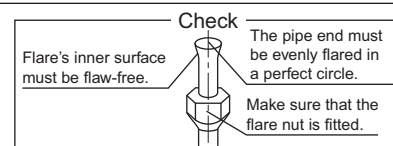

⚠ WARNING

- Do not use mineral oil on flared part.
- Prevent mineral oil from getting into the system as this would reduce the lifetime of the units.
- Never use piping which has been used for previous installations. Only use parts which are delivered with the unit.
- Never install a dryer to this R32 unit in order to guarantee its lifetime.
- The drying material may dissolve and damage the system.
- Protect or enclose the refrigerant tubing to avoid mechanical damage.
- Incomplete flaring may cause refrigerant gas leakage.


Refrigerant Piping Work

2. Refrigerant piping

⚠ CAUTION

- Use the flare nut fixed to the main unit. (To prevent cracking of the flare nut by aged deterioration.)
- To prevent gas leakage, apply refrigeration oil only to the inner surface of the flare. (Use refrigeration oil for R32.)
- Use torque wrenches when tightening the flare nuts to prevent damage to the flare nuts and gas leakage.


Align the centres of both flares and tighten the flare nuts 3 or 4 turns by hand. Then tighten them fully with the torque wrenches.

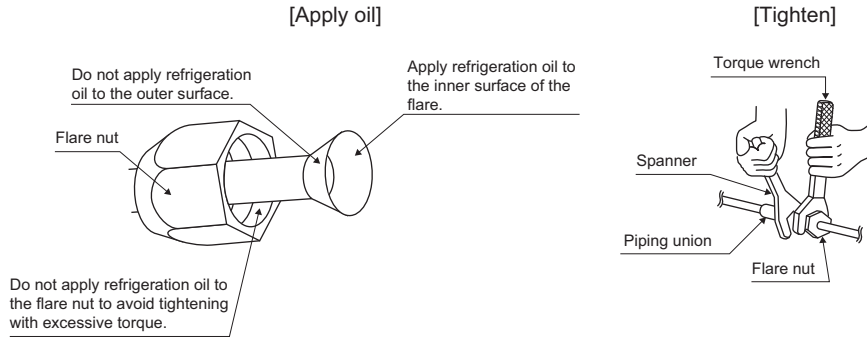

Flare nut tightening torque	
Gas side	Liquid side
3/8 inch	1/4 inch
32.7-39.9N • m (330-407kgf • cm)	14.2-17.2N • m (144-175kgf • cm)

2-1. Caution on piping handling


- 1) Protect the open end of the pipe against dust and moisture.
- 2) All pipe bends should be as gentle as possible. Use a pipe bender for bending.

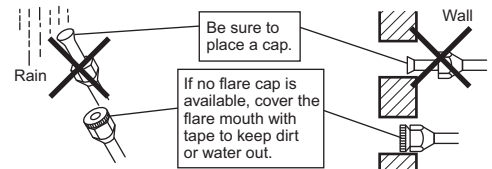

2-2. Selection of copper and heat insulation materials

- When using commercial copper pipes and fittings, observe the following:

- 1) Insulation material: Polyethylene foam
Heat transfer rate: 0.041 to 0.052W/mK (0.035 to 0.045kcal/mh°C)
Refrigerant gas pipe's surface temperature reaches 110°C max.
Choose heat insulation materials that will withstand this temperature.
- 2) Be sure to insulate both the gas and liquid piping and to provide insulation dimensions as below.

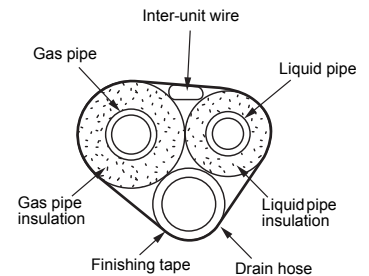

Gas side	Liquid side
O.D. 9.5mm	O.D. 6.4mm
Minimum bend radius - 30mm or more	
Thickness 0.8mm (C1220T-O)	Thickness 0.5mm

Gas pipe thermal insulation	Liquid pipe thermal insulation
O.D. 9.5mm	I.D. 8-10mm
I.D. 10-14mm	
Thickness ≥13mm	Thickness ≥10mm

- 3) Use separate thermal insulation for gas and liquid refrigerant pipes.

Trial Operation and Testing

1. Trial operation and testing

- Trial operation should be carried out in either COOL or HEAT operation.

1-1. Measure the supply voltage and make sure that it is within the specified range.

1-2. In COOL operation, select the lowest programmable temperature; in HEAT operation, select the highest programmable temperature.

1-3. Carry out the trial operation in accordance with the operation manual to ensure that all functions and parts, such as flap movement, are working properly.

- For protection, the system disables restart operation for 3 minutes after it is turned off.

1-4. After trial operation is complete, set the temperature to a normal level (26°C to 28°C in COOL operation, 20°C to 24°C in HEAT operation).

- When operating the air conditioner in COOL operation in winter, set it to the trial operation mode using the following method.

1) Press  ,  and  at the same time.

2) Press  , select  , press  .

3) Press  or  to turn on the system.

- Trial operation will stop automatically after about 30 minutes.



To stop the operation, press  .



- Some of the functions cannot be used in the trial operation mode.

- The air conditioner draws a small amount of power in its standby mode. If the system is not to be used for some time after installation, shut off the circuit breaker to eliminate unnecessary power consumption.
- If the circuit breaker trips to shut off the power to the air conditioner, the system will restore the original operation mode when the circuit breaker is opened again.

2. Test items

Test items	Symptom	Check
Indoor and outdoor units are installed properly on solid bases.	Fall, vibration, noise	
No refrigerant gas leaks.	Incomplete cooling/heating function	
Refrigerant gas and liquid pipes and indoor drain hose extension are thermally insulated.	Water leakage	
Draining line is properly installed.	Water leakage	
System is properly earthed.	Electrical leakage	
The specified wires are used for inter-unit wiring.	Inoperative or burn damage	
Indoor or outdoor unit's air inlet or air outlet are unobstructed	Incomplete cooling/heating function	
Stop valves are opened.	Incomplete cooling/heating function	
Indoor unit properly receives remote control commands.	No operation	

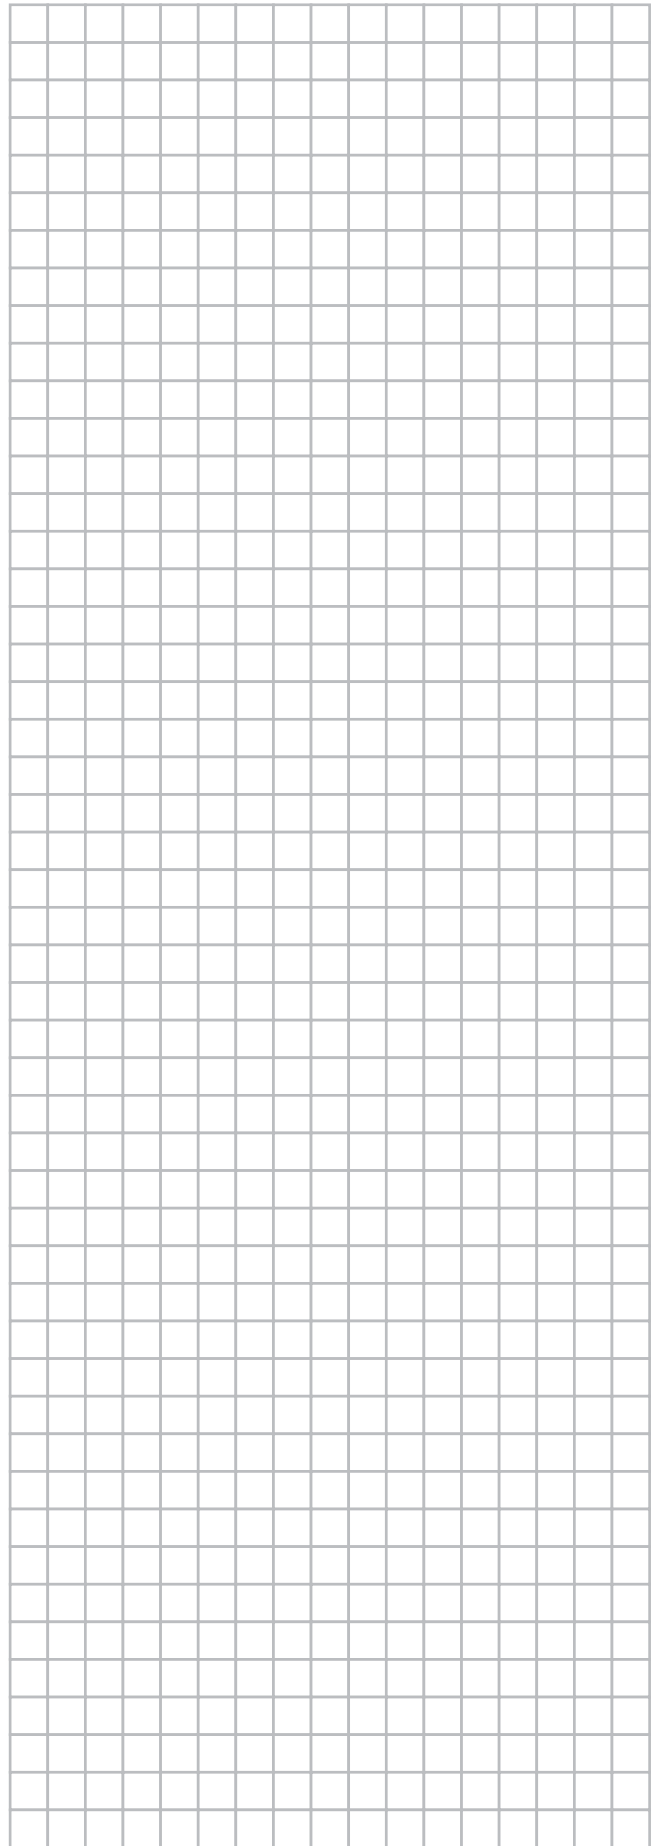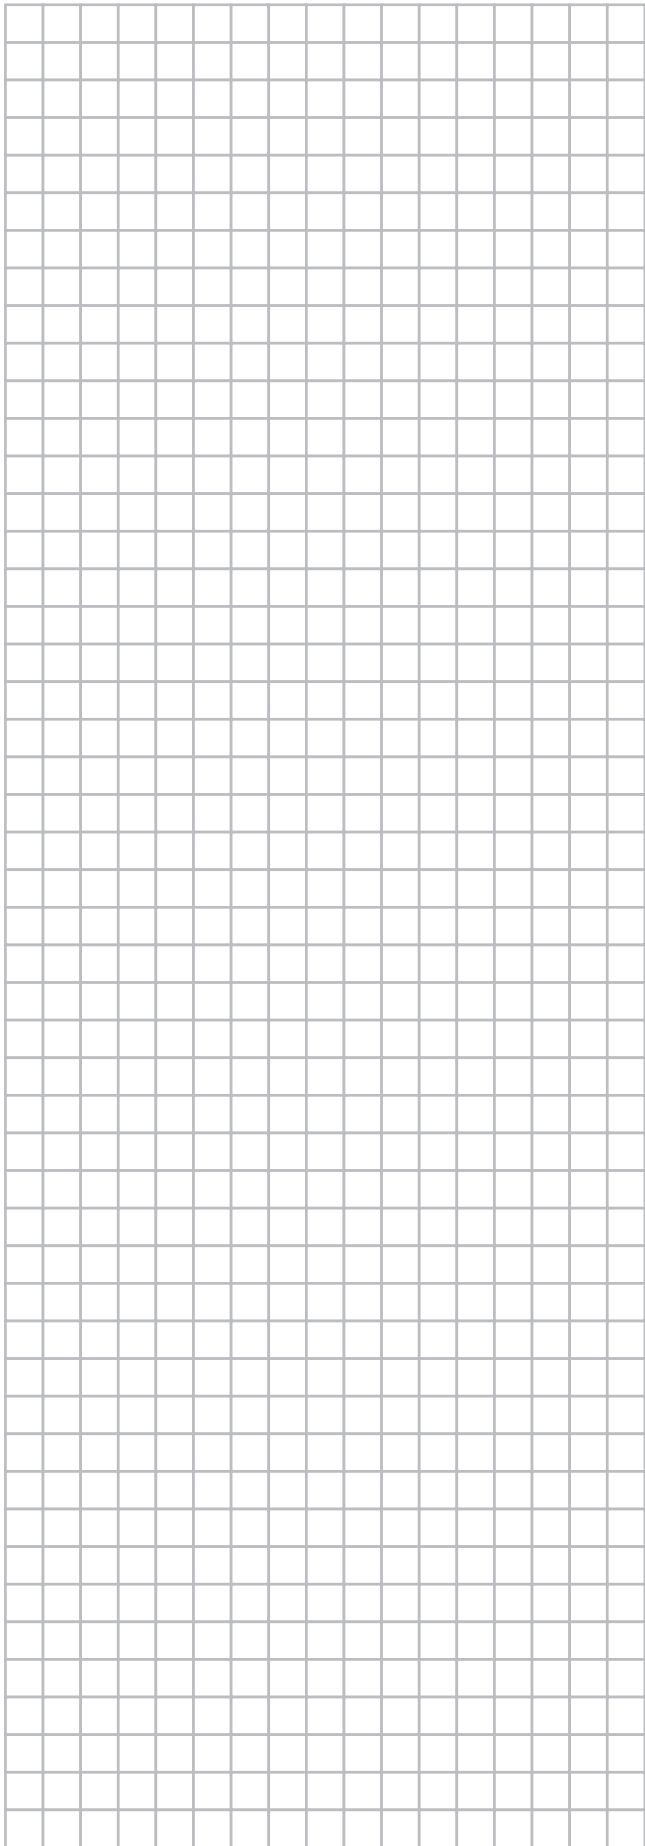

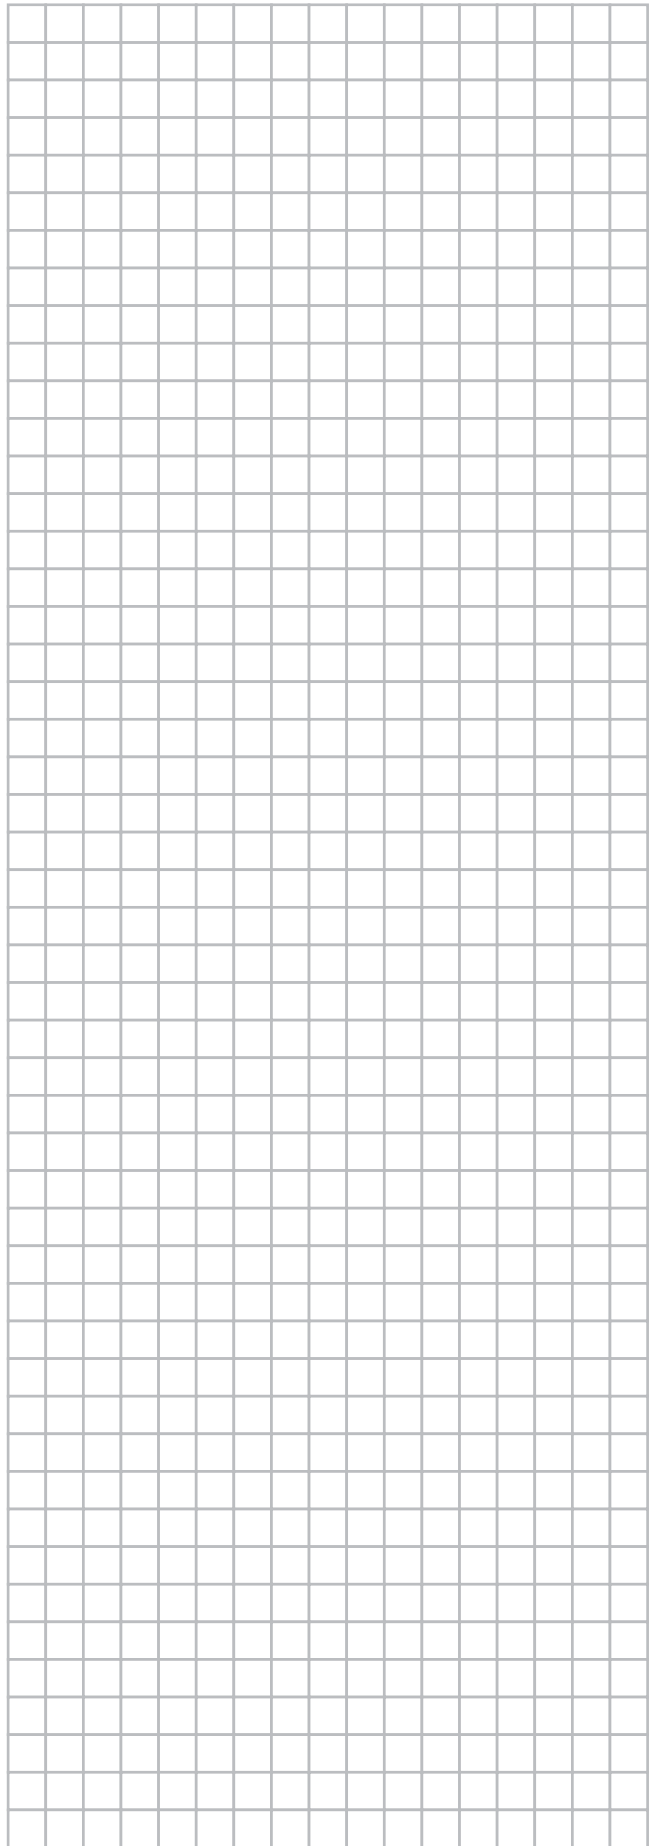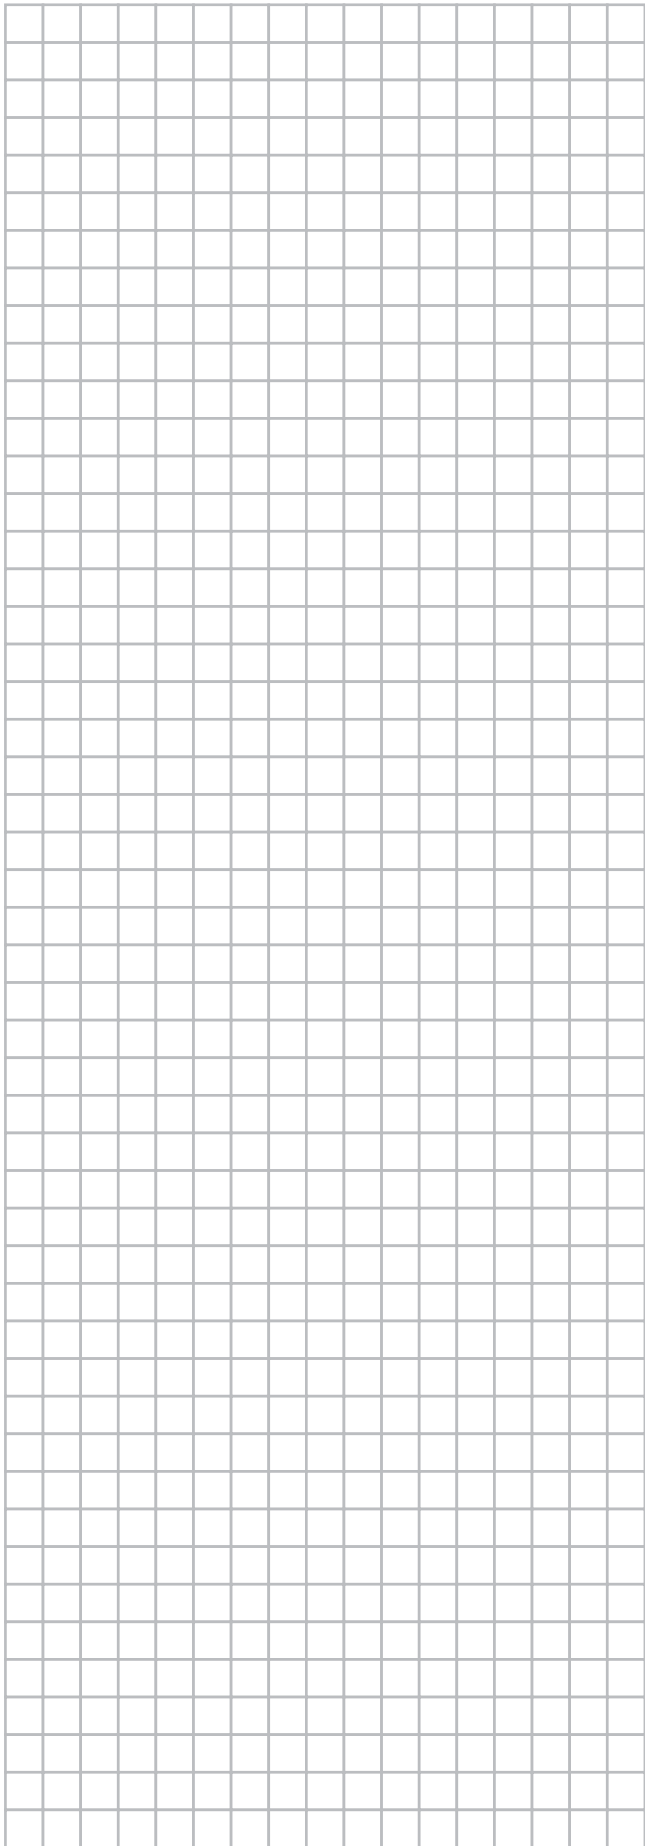

DAIKIN INDUSTRIES CZECH REPUBLIC s.r.o.

U Nové Hospody 1/1155, 301 00 Plzeň Skvrňany, Czech Republic

DAIKIN EUROPE N.V.

Zandvoordestraat 300, B-8400 Oostende, Belgium

Copyright 2017 Daikin



Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузки в транспортную компанию

Технические данные файла

Документ: Инструкция по монтажу Daikin FTXTP-K3V1B

Идентификатор библиотеки: LIB-002949

Исходный файл: daikin-ftxtp-k3v1b-instruktsiya-montazh.pdf

SHA-256 оригинала: 008bab22c691bcd24459aa3166f4eaf6c8bb890758ed88542a74e27a8b1d15ee

Постоянная ссылка: <https://iclim.ru/library/daikin-ftxtp-k3v1b-instruktsiya-montazh.pdf>

Копия сформирована: 03.10.2026 10:20 UTC