



Interface Adapter for Room Airconditioner < K R P 9 2 8 A 2 S >

Installation Manual

Safety Precautions

- Read these Safety Precautions carefully to ensure correct installation. This manual classifies precautions into WARNING and CAUTION.
 - WARNING** : Failure to follow WARNING is very likely to result in such grave consequences as death or serious injury.
 - CAUTION** : Failure to follow CAUTION may result in serious injury or property damage, and in certain circumstances, may result in a grave consequence.
- Be sure to follow all the precautions below ; they are all important for ensuring safety.

WARNING

- Installation should be left to the dealer or another qualified professional. Improper installation by yourself may cause malfunction, electrical shock, or fire.
- Install the set according to the instructions given in this manual. Incomplete or improper installation may cause malfunction,electrical shock,or fire.
- Be sure to use the standard attachments or the genuine parts. Use of other parts may cause malfunction,electrical shock,or fire.
- Disconnect power to the connected equipment before starting installation. Failure to do so may cause malfunction,electrical shock,or fire.

CAUTION

- An earth leakage circuit breaker should be installed. If the breaker is not installed,electrical shock may occur.
- Do not install the set in a location where there is danger of exposure to inflammable gas. Gas accumulated around the unit at the worst may cause fire.
- To prevent damage due to electrostatic discharge,touch your hand to a nearby metal object (doorknob,aluminum sash,etc.) to discharge static electricity from your body before touching this kit. Static electricity can damage this kit.
- Lay this cable separately from other power cables to avoid external electrical noises.

- After installation is complete,test the operation of the PCB set to check for problems, and explain how to use the set to the end-user.

1. Overview , Features and Compatible Models

This kit is an interface necessary for the connection of central control equipment to a room air conditioner, and can operate and monitor the things mentioned below in combination of central control equipment. This kit copes with the room air conditioner with HA terminal S21.


- Operation, stop, changeover of operation mode and setting temperature are carried out from a central control equipment. (18~32°C in cooling, 14~28°C in heating, no blow mode)
- Operation state, existence of abnormality and abnormal phenomena are monitored from a central control equipment.
- A central control equipment, a card key restricts the operation by a remote controller such as starting, stop, operation mode changeover and setting temperature.
- Zone control through a central control equipment.
- When power failure occurs, it returns to the operation before the power failure.
- Monitoring the operation and stop through devices complied with HA JEM-A (Tele-con kit).

This kit does not support the following controls.

- Group control (control of plural indoor units by one remote controller).
- Monitoring the following items. Room temperature/ thermostat condition/ compressor operation state/ indoor fan operation state/electric heater and humidifier operation state.
- Controlling the following items. Forced thermostat off/ filter sign display and reset/air flow direction and air flow rate/air conditioning charge management.
- Save energy command/Low noise command/"Demand" command.

2. Components

This kit includes the following components. Check to ensure that none of these are missing.


Parts	Q'ty	Parts	Q'ty
Kit assembly	1	Connection harness with connector	1set
PCB is in the housing.		Mounting screws	3pcs.
		Binding band	1pc.
		Double-sided tape	2pcs.
		Installation manual	1set

3. Initial Setting

Put initial setting of each switch on the PCB after the casing of this kit is opened. (Set it to ■)

①Settings for overseas and Japanese models(SW3)

The setting is required for room air conditioners because the temperature setting in Auto Mode differs between overseas models and Japanese ones.

SW3	Setting
	When connecting to Japanese models.(Delivery setting) Auto Mode cannot be selected from central control equipment. When Auto Mode is selected using the remote controller, Auto cooling or Auto heating is displayed at the central remote controller. (At this time,the temperature display is fixed at 25°C)
	When connecting to overseas models. Auto Mode can be selected from central control equipment. When Auto Mode is selected using the remote controller, Auto Cooling or Auto Heating is displayed on the central remote controller.

②Setting group numbers (SW1,SW2-1to 3)

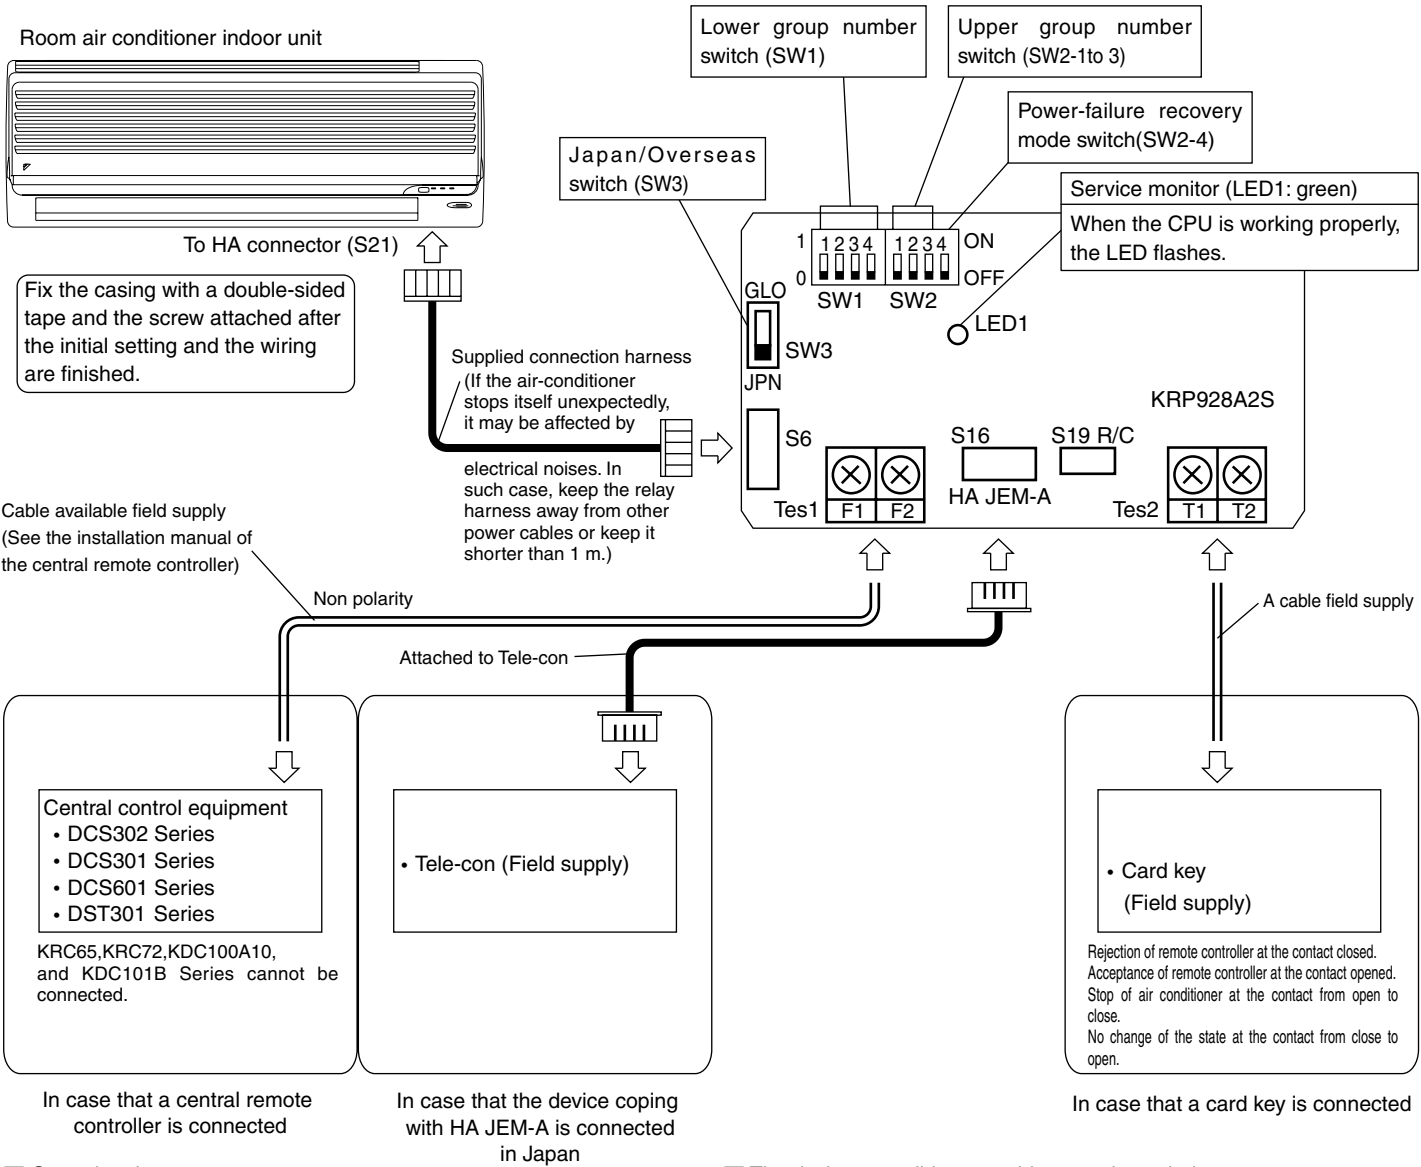
Set it as shown in the table below. The same number should not be set for two units or more.

SW2 setting	Upper groupNO.	SW1 setting	Lower groupNO.	SW1 setting	Lower groupNO.
1	1	0	0	0	8
2	2	1	1	1	9
3	3	2	2	2	10
4	4	3	3	3	11
5	5	4	4	4	12
6	6	5	5	5	13
7	7	6	6	6	14
8	8	7	7	7	15

③Auto restart ON/OFF(SW2-4)

In case that the switch is ON, the unit returns to the original operation before power failure when the power failure is canceled. In case that the switch is OFF, the unit is secure to stop when the power failure is canceled. When an auto restart ON/OFF jumper is provided in the indoor unit, control from this kit takes priority. The following status information is stored regardless of on/off state. (Operation mode, Set temperature, Rejection of remote controller)

4. Gist of wiring



■ Control code

When the central remote controller is used, the operation code and the rejection on remote controller of room air conditioner are as follows. (The device coping with HA JEM-A is not restricted)

Remote controller operation mode	Tes	Control code	Control by remote controller
ON/OFF control is rejected by remote controller	open	0 1 3	ON/OFF operation,timer setting is not possible
Only OFF control is accepted by remote controller	open	10 11	Only air flow and air direction can be set
Central priority	open	2 12~19	Only off operation,air flow and air direction can be set
Last command priority	open	4 5	Last command takes priority
Timer operation is accepted by remote controller	open	6 7	Last command takes priority
Forced stop	close	8 9	Last command takes priority
		0~19	Not possible

■ The devices possible to combine are shown below.

	Card key	Device coping with HA JEM-A	Schedule timer	Central controller	Wireless remote controller
Card key	×	○	○	○	○
Device coping with HA JEM-A	○	×	○	○	○
Schedule timer	○	○	×	○	○
Central controller	○	○	○	×	○
Wireless remote controller	○	○	○	○	×

Техника для климата

Доставляем оборудование по всей России от 3 дней транспортными компаниями. Реализуем проекты в десятках регионов — от Калининграда до Владивостока.

9600+

объектов и поставок

от 1 дня

отгрузка в транспортную компанию

Технические данные файла

Документ: Инструкция по монтажу Daikin KRP928A2S: вспомогательная инструкция

Идентификатор библиотеки: LIB-000207

Исходный файл: daikin-vspomogatelnye-krp928a2s-instruktsiya-montazh.pdf

SHA-256 оригинала: 4abd2c6d9e4f9cb3eef17caa8cb1decc44136694d921ce5868e1c846dd7ba0e8

Постоянная ссылка: <https://iclim.ru/library/daikin-vspomogatelnye-krp928a2s-instruktsiya-montazh.pdf>

Копия сформирована: 02.10.2026 08:33 UTC